

Wellhead Protection Plan

Part I

**Wellhead Protection Area Delineation
Drinking Water Supply Management Area Delineation
Well and Aquifer Vulnerability Assessment**

For

The City of Bovey

February 8, 2007

James F. Walsh

Minnesota Department of Health

Table of Contents

	Page
Glossary of Terms.....	1
Introduction.....	2
Source Water Assessment.....	2
Delineation of the Wellhead Protection Area.....	5
Delineation of the Drinking Water Supply Management Area.....	16
Assessment of Well Vulnerability.....	16
Vulnerability Assessment for the Drinking Water Supply Management Area.....	16
Selected References.....	18
Appendix I (Municipal Well Information).....	19
Appendix II (Figures Used in This Report).....	22
Appendix III (Method Used to Estimate Transmissivity from Specific Capacity).....	36

List of Tables

Table 1: Municipal Water Supply Well Information.....	20
Table 2: Well Used by the Public Water Supplier.....	3
Table 3: Annual Volume of Water Discharged From Bovey Water Supply Well.....	9
Table 4: Pumping Rate Used for WHP Area Delineation.....	9
Table 5: Parameters Used for WHP Area Delineation.....	12
Table 6: Model Calibration Data.....	13

List of Figures

Figure 1: WHPA, DWSMA and ERA for the City of Bovey.....	23
Figure 2: Surficial Geology of the Bovey Area.....	24
Figure 3: Geologic Cross-Sections Through the Bovey Area.....	25
Figure 4: Chloride Data Through Time.....	26
Figure 5: Sulfate Data Through Time.....	27
Figure 6: Stable Isotopes of Water.....	28
Figure 7: Groundwater Flow Direction in the Bovey Area in 2006.....	29
Figure 8: Distribution of Transmissivity.....	30
Figure 9: Ten-Year Time of Travel Particle Traces.....	31
Figure 10: Graphical View of Comparison Between Measured and Modeled Heads.....	32
Figure 11: Map View of Comparison Between Measured and Modeled Heads.....	33
Figure 12: Conjunctive Delineation for the City of Bovey WHPA.....	34
Figure 13: Vulnerability of the Aquifer Used by the City of Bovey Throughout the DWSMA.....	35

Glossary of Terms

Assimilative Capacity. The ability of the saturated or unsaturated zones of a formation to attenuate the concentrations of contaminants to acceptable levels before they reach the well (U.S. EPA, June 1987). An assimilative capacity boundary can be any combination of 1) surface and subsurface geologic materials, and 2) groundwater flow paths that prevent contaminants from reaching a public water supply well at levels that present a risk to human health.

Capture Zone. The subsurface area surrounding a well or well field that supplies a public water supply system through which water is likely to move toward and reach the well. The capture zone and the surface water contribution area, when needed, comprise the wellhead protection area (WHPA).

Conjunctive Delineation. A WHPA that is defined by two components, consisting of 1) the capture zone for a well that is based on generating flow pathlines within the subsurface area(s) of contribution, and 2) a surface area that may contribute recharge to the capture zone.

Drinking Water Supply Management Area (DWSMA). The area delineated using identifiable land marks, defined in this report, that reflects the scientifically calculated wellhead protection area boundaries as closely as possible (Minnesota Rules 4720.5100, subpart 13).

Source Water Protection Area (SWPA). A source water assessment includes a description of 1) the area to be protected, 2) potential contamination sources that may impact the source of drinking water, and 3) the susceptibility of the public water supply to potential contamination sources. For the purposes of this delineation report, the SWPA and the DWSMA are the same.

Wellhead Protection Area (WHPA). The surface and subsurface area surrounding a well or well field that supplies a public water system, through which contaminants are likely to move toward and reach the well or well field (Minnesota Statutes, part 103I.005, subdivision 24).

Introduction

This report documents the technical information necessary to prepare Part I of a wellhead protection plan that will help ensure an adequate and safe drinking water supply for the city of Bovey, public water supply identification number 1310003. It documents the delineation of the wellhead protection area (WHPA), the drinking water supply management area (DWSMA), and the vulnerability assessments for the public water supply well and DWSMA. An updated source water assessment with a new protection area (SWPA) also is included. Definitions explaining the differences between the terms WHPA, DWSMA, and SWPA are provided in the "Glossary of Terms" at the beginning of this report.

The delineation was performed in accordance with Minnesota Rules 4720.5100-4720.5590 for preparing and implementing wellhead protection plans for public water supply wells. The Minnesota Department of Health (MDH) administers these rules and the results described in this report reflect those of the MDH to 1) identify the capture zones for delineation of the WHPA, and 2) prepare well and DWSMA vulnerability assessments. Also, this report presents the findings of the public water supplier to identify the boundaries of the DWSMA.

The public water supplier operates a single well, termed Well No. 1 (Unique No. 228834). The well is located in Section 32 of Township 56 North, Range 24 West in Itasca County. Table 1 in Appendix I presents some of the key information about this well that affects its vulnerability assessment.

The WHPA for Well No. 1 (Unique No. 228834) was determined using a computer model to simulate groundwater flow towards it. The DWSMA boundaries were determined using U.S. Public Land Survey boundaries, city streets, and roads. Figure 1 shows the boundaries for the WHPA and the DWSMA.

Source Water Assessment

The MDH is required under Section 1453 of the 1996 Amendments to the federal Safe Drinking Water Act to prepare source water assessments for all public water supply systems. Congress intends that assessments should be used to educate public water suppliers and the customers they serve about the source of their drinking water and potential contaminants that may affect people's health. The following Source Water Assessment for the public water supplier contains the information specified in Minnesota's source water assessment program description.

**Source Water Assessment for
The City of Bovey**

Public Water Supplier ID Number: 1310003

Water Supplier Contact: Mike Bibitch
218-245-1633
Bovey, MN 55709

MDH Contact: Beth Kluthe
Minnesota Department of Health
218-755-6315
705 Fifth Street, Suite A
Bemidji, MN 56601
beth.kluthe@health.state.mn.us

Status of the Source Water Protection Plan –

The Minnesota Department of Health has approved the 1) delineation of the wellhead protection area, 2) delineation of the drinking water supply management area, and 3) assessments of well and aquifer vulnerability. The public water supplier is proceeding with the development of the remainder of the wellhead protection plan.

Source Water Protection Area - See Figure 1.

Description of the Source Water - The water supply for the city of Bovey comes from a sand and gravel aquifer that exhibits confined hydraulic conditions at the city well. The aquifer is about 50 feet thick and is covered by 30-40 feet of clay rich till. Generally, groundwater moves in a southwesterly direction in the wellhead protection area, although the flow directions are variable and influenced by the water level within the Canisteo Mine Pit.

**Table 2
Well Used by the Public Water Supplier**

Well No.	Unique No.	Well Use	Aquifer Type	Well Depth (ft)	Well Sensitivity	Aquifer Sensitivity
1	228834	Primary	Sand and Gravel	92	High	Moderate

Source Water Assessment

City of Bovey

Page 2

Aquifer Sensitivity - The sensitivity of the aquifer used by the public water supplier is variable throughout the drinking water supply management area. It ranges from highly sensitive where the aquifer is exposed at the land surface, such as around the Canisteo Mine Pit, to moderately sensitive where covered by till. Existing data suggest that the overlying till is leaky. A tritium sample taken from city Well 1 (228834) on February 10, 2004, showed 18.3 tritium units, indicating that most of the water pumped by the well entered the ground within the last 50 years.

Well Construction Assessment - Existing construction information for Well 1 (228834) suggests that grout was not drawn into the annular space of the well casing as it was driven, as is currently required by the State Well Code. This factor could provide a pathway for near-surface contamination to enter the source water. However, it is also possible that the limited annular space created during cable tool well construction may have become sealed due to swelling of clay minerals present in the surficial till.

Susceptibility of the Source Water to Contamination - The source water used by the public water supplier is considered susceptible to potential sources of contamination principally because of the geologic setting, although the construction of Well 1 (228834) may also provide an avenue for contamination. The land uses within the drinking water supply management area may potentially contribute contaminants that may present a health concern to the users of the public water supply.

Contaminants of Concern - Routine water testing from Bovey Well 1 (228834) has shown that it has generally been free from contaminants and meets all potability standards of the federal Safe Drinking Water Act. However, the well is considered susceptible to contamination from a variety of sources. These include contaminants that may persist in groundwater for long periods of time and which are not susceptible to retardation or removal by movement through fine-grained sediment.

Delineation of the Wellhead Protection Area

Physical Setting

The City of Bovey is located in Itasca County near the western end of the Mesabi Iron Range. The town is surrounded by features associated with a nearly 100-year old history of iron mining, which ceased in this area in the mid-1980's (Jones, 2002). These features include tailings ponds, waste rock stockpiles, and, most prominently, the Canisteo Mine Pit lake (Figure 2). The Canisteo Mine Pit lake is situated approximately 2,400 feet north of Well 1 (228834). It has an average depth of approximately 100 feet, but is up to 300 feet in depth locally. It is nearly five miles in length, averages approximately 0.5 miles in width, and was created when water levels rose following the cessation of mining at a series of closely-spaced, abandoned natural ore mine pits.

Assessment of Data Elements

This section documents how the data elements specified under Minnesota Rules 4720.5400 were used to describe the physical environment.

Soils: The aquifer used by the city of Bovey is buried beneath a layer of till, except where exposed locally along the margins of the Canisteo Mine Pit lake. As a result, soils maps are not useful for delineating its boundaries. However, the Itasca County soils survey (Nyberg, 1987) was useful for assessing the vulnerability of the aquifer.

Precipitation: The mean annual precipitation for the area is 27.54 inches (Minnesota State Climatologist, 2001). Jones (2002) derived estimates of groundwater recharge for the area using stream-hydrograph analysis methods on daily streamflow records for the Prairie River near the city of Taconite for the 1968-1982 time period. These recharge estimates were used in the WHPA delineation.

Geology: Figures 2 and 3 show the distribution of the aquifer and its stratigraphic relationships with adjacent geologic materials. They were prepared using existing geologic maps (Jennings and Reynolds, 2005) and well record data that is contained in the County Well Index database. A complete listing of the geological maps and studies that were used to further define local hydrogeologic conditions is provided in the section of this report entitled "Selected References."

The natural landscape of the Bovey area was strongly affected by late-Pleistocene glaciation. Although the town of Bovey is situated on relatively flat ground, the surrounding area consists of an irregular topography of small hills and depressions (Figures 2 and 3). This distribution of landforms is attributed to rapidly shifting depositional environments commonly found near the margins of glacial ice, probably of the Koochiching lobe (Jennings and Reynolds, 2005). Dominant glacial landforms in the Bovey area include Trout Lake, attributed to a subglacial drainage feature known as a tunnel valley, and the irregular hills adjacent to and west of Trout Lake, indicative of ice contact deposits (Jennings and Reynolds, 2005).

Although surficial materials in the Coleraine area near Bovey are dominated by sediments of the Koochiching lobe, interpretations are complicated by apparent admixture with sediments of the Rainy lobe. This was probably caused by collapse of both units related to late melting of buried

ice (Jennings and Reynolds, 2005). The total thickness of glacial sediments in the Bovey area is on the order of 160 feet. Generally, drift thickens to the south and thins to the north, approaching zero along the crest of the Giants Range, a linear ridge composed of Archean granitic and metasedimentary rocks that trends northeast to southwest (Jones, 2002). It is located north of the Canisteo Mine Pit.

Winter (1971) identified three major morainal till units and associated glaciofluvial outwash deposits in this general area, but only two appear to occur in Bovey. These are the upper surficial and middle boulder till units (Jones, 2002). The surficial till is brown in color, sandy, silty, and calcareous and is generally less than 30 feet thick in this area (Jones, 2002). The boulder till ranges widely in color from gray to yellow, consists of sands and silts with abundant cobbles and boulders, and is generally less than 50 feet thick (Winter, 1971). Glaciofluvial outwash deposits lie stratigraphically between the surficial and boulder tills, and often lie between the boulder till and deeper tills or bedrock (Winter, 1973a). Those that occur between the surficial and boulder tills are the thickest and most continuous outwash deposits in the Bovey area. They are often greater than 50 feet thick, and sometimes exceed 100 feet in portions of buried valleys (Winter, 1973a). These outwash deposits consist of fine-grained sands throughout much of the study area. However, they are highly transmissive, coarse-grained sands, gravels and boulders occurring within buried valleys and at other locations where the bedrock surface is low (Jones, 2002). These deposits form the aquifer that is tapped by the Bovey city well.

The uppermost bedrock beneath the city of Bovey consists of the Virginia Formation, a Paleoproterozoic package of argillites, siltstones and greywackes (Jones, 2002). This unit thins to the north so that the uppermost bedrock present within the Canisteo Mine Pit is the Biwabik Iron Formation (Jirsa and others, 2005).

Groundwater Quantity and Quality: The Minnesota Department of Natural Resources permits high-capacity wells and documents their pumping volumes in the State Water Use Database (SWUDs). It is important to identify other high-capacity wells in the vicinity of the Bovey well because they may affect the boundary of the capture zone in the WHPA. The only high-capacity wells identified within two miles of the Bovey well are the municipal wells for Coleraine and Taconite. The Taconite city wells are completed in the Biwabik Iron Formation and are unlikely to constitute a flow boundary to the Bovey well. The Coleraine municipal wells are completed in the same aquifer as Bovey Well 1 (228834) and, therefore, may constitute a flow boundary.

Water quality information on the Bovey city well was obtained from MDH records, as well as published data (Cotter and others, 1965). These data show that significant changes have occurred in the chemical makeup of the city water over time (Figures 4 and 5). The earliest data for the Bovey well date to 1957 and 1971, at which time the Canisteo Pit was dewatered. Chloride and sulfate values recorded from that time period show values of 3.5-5.0 mg/l and 50-68 mg/l, respectively. Follow-up sampling conducted in 2004 showed markedly different results. The chloride and sulfate values for the Bovey city well had risen to 32-34 mg/l and 160-190 mg/l, respectively. This may be attributed to changing groundwater flow patterns in the area related to rising Canisteo Mine Pit water levels, as described below.

When the Canisteo Mine Pit was dewatered, it functioned as a drain, collecting groundwater from surrounding aquifers in addition to precipitation and surface water runoff. At its lowest levels, the dry pit floor would have been approximately 200 feet below the level of Trout Lake.

As a result, groundwater flow in the Bovey area would have been directed from Trout Lake towards the Canisteo Pit. It is likely that the Bovey municipal well would have captured some water from Trout Lake during this time. This theory is supported by 1) water level observations of the lake and the city well noted in Cotter and others (1965), and 2) historic water chemistry data from Trout Lake and the municipal wells of Bovey and Coleraine. Trout Lake water quality data were obtained from published data (Cotter and others, 1965) and compared with sampling conducted in 2004 in support of this delineation. The chloride and sulfate results from Trout Lake were consistent over this time period, with values of 5.9-6.2 mg/l and 39-52 mg/l, respectively. These values are very similar to those observed from early samples taken from the Bovey and Coleraine municipal wells. Note that the 2004 sample results for the Coleraine city wells suggest that they were still capturing some Trout Lake water at that time (Figure 5).

As the Canisteo Pit water level has risen since the cessation of mining, now exceeding that of Trout Lake by 20 feet, the groundwater flow dynamic in the Bovey area has changed. Water level data now suggest that groundwater is flowing from the Canisteo Pit towards Trout Lake, at least locally (Jones, 2002). Because of this change in groundwater gradient, the capture area for the Bovey city well has likely shifted from a southerly direction to more northeasterly. Stable isotope data obtained on samples from the Bovey city well in 2004 show no significant evidence of evaporated surface water, indicating that any capture of Trout Lake water had ceased and that Canisteo Pit water had not yet arrived (Figure 6).

The elevated levels of chloride and sulfate observed in the 2004 samples from the Bovey city well likely reflect ambient water quality in the aquifer within the current northeasterly capture area. Elevated chloride is likely related to road de-icing salt, although fertilizer and wastewater are other possible sources. Elevated sulfate is generally related to naturally-occurring minerals, although wastewater is a possible source. Common mineral sources include gypsum, a soluble calcium sulfate mineral that occurs in minor amounts in some rocks, or the oxidation of sulfide-bearing minerals such as pyrite. Gypsum is not known to occur in the Biwabik Iron Formation or associated Precambrian rocks of the Bovey area, although it could be present in minor amounts in glacial drift.

Pyrite is known to occur at some locations within the Biwabik Iron Formation, the Virginia Formation, and the Cretaceous Coleraine Formation. It is possible that some of the waste rock stockpiles in the Bovey area contain pyrite, and result in localized occurrences of sulfate-rich groundwater. Evidence for this comes from water quality sampling conducted in 2004 on a ditch that drains into the north side of Trout Lake. The ditch originates at a wetland located at the toe of a waste rock stockpile along the south shore of the Canisteo Pit north of Coleraine (Figure 2). The chloride and sulfate values determined for the ditch water were 69 mg/l and 210 mg/l, respectively, similar to values currently seen from the Bovey city well (Figure 5). Note that the sulfate and chloride values noted for the Canisteo Pit in 2004 were significantly lower than those observed at the Bovey well, further suggesting that water from the pit had not yet reached the city well.

Hydrogeological Setting

In the geographic area that includes the WHPA, the aquifer from which the city well pumps has the following characteristics:

- It is composed of sand and gravel and is 30 to 50 feet thick;
- It exhibits a porosity that is estimated to be 25%;
- It exhibits a base elevation of approximately 1,216 feet above sea level at the city well and probably rises to the north, consistent with the bedrock surface;
- It exhibits a stratigraphic top elevation of approximately 1,269 feet above sea level at the city well and probably rises to the north, consistent with the bedrock surface;
- It exhibits a wide range of aquifer transmissivity, as described below, and these zones of differing transmissivity may constitute flow boundaries. An attempt has been made to subdivide the aquifer into zones of differing transmissivity based on existing geologic mapping and aquifer test data (Figure 8).

The ambient flow field in the aquifer upgradient of the city well is currently oriented westerly to southerly (from approximately 180 to 280 degrees), with an average hydraulic gradient of approximately 0.008 (Figure 7).

The aquifer generally exhibits confined hydraulic conditions. This was determined by comparing the static water level measurements from wells completed in the aquifer with its stratigraphic top (Figure 3). In most instances, the static water levels occur in the till that commonly overlies the aquifer. However, the aquifer is unconfined where it is intersected by the Canisteo Mine Pit and at some other locations where ice contact deposits are prevalent, particularly around Trout Lake (Figures 2 and 3).

The Minnesota Department of Natural Resources (DNR) has developed a procedure for determining geologic sensitivity at well sites (DNR, 1991). The Bovey city well exhibits a geologic sensitivity rating of moderate using the DNR criteria.

Criteria Used to Delineate the Wellhead Protection Area

The criteria for delineating the WHPA, as required in Minnesota Rules 4720.5510, were addressed as follows.

Time of Travel - A 10-year time of travel was used to characterize groundwater movement in the aquifer and the pumping of the water supply well. Also, a one-year time of travel was used to define the emergency response area (ERA), as specified under Minnesota Rules 4720.5250. The 1- and 10-year capture zone boundaries are shown in Figure 1.

Daily Volume of Water Pumped - Information provided by the city of Bovey was used to determine the maximum discharge from their well. The results are presented in the following table. The daily volume of discharge used as an input parameter in the model was calculated by dividing the greatest annual pumping volume by 365 days.

Table 3
Annual Volume of Water Discharged From Bovey Water Supply Well

Well No.	Unique No.	2001	2002	2003	2004	2005	Future Pumping
1	228834	26,800,000	20,900,000	35,391,000	29,673,000	32,178,000	

(Expressed as gallons. Bolding indicates greatest annual pumping volume.)

The values shown in Table 3 are the total number of gallons pumped annually by the Bovey city well and reported to the Minnesota Department of Natural Resources under Groundwater Appropriations Permit No. 842085. The city of Bovey indicates that it intends to pump approximately the same amounts of water during the next five years. As a result, the maximum amount of annual pumping, shown in bold above, was used to express the daily volume of water pumped from the city well.

The maximum annual volume pumped by Bovey Well 1 (228834) over the 2001-2005 time period was incorporated as a daily volume in the groundwater flow model used to designate the capture zone for the well. For delineation purposes, the following pumping rate was applied to the well in the groundwater flow model. The rate selected is consistent with WHP rule requirements because the maximum volume is used.

Table 4
Pumping Rate Used for WHPA Delineation

Well Number	Equivalent Annual Volume (gallons)	Model Input (cubic meter/day)
1	35,391,000	367

Groundwater Flow Field - The groundwater flow field was determined by compiling static water level elevations from 1) wells that are completed in the same aquifer used by the city of Bovey, and 2) fully-penetrating surface water features such as the Canisteo Mine Pit lake and Trout Lake (Figure 7). The ambient flow field in the aquifer upgradient of the city well is oriented westerly to southerly (from 180 to 280 degrees) with an average hydraulic gradient of approximately 0.008.

Aquifer Transmissivity - The transmissivity of the aquifer used by Bovey Well 1 (228834) was estimated from 1) single well aquifer tests on monitoring wells conducted as part of USGS Water Resources Investigations Report 02-4198 (Jones, 2002), and 2) specific capacity data from the Bovey and Coleraine city wells, including other wells completed in the same formation (Figure 8). The specific capacity data were corrected for partial penetration, assuming an aquifer thickness of 50 feet using the method described in Appendix III.

These results suggest an aquifer transmissivity that ranges from approximately 220 ft²/day to 6,800 ft²/day. The wide range in transmissivity probably reflects variations in aquifer grain size, and possibly differences in well development. The low end of the range is representative of data from Jones (2002). The upper value represents the geometric mean from the specific capacity data for the five wells that were pumped in excess of 50 gallons per minute for at least two hours. The geometric mean of the entire 14-well data set is 1,480 ft²/day.

The groundwater flow model developed for this area by Jones (2002) utilized relatively low values of aquifer hydraulic conductivity to achieve calibration for the aquifer used by Bovey. Those values spanned from 13.1 ft/day to 32.8 ft/day, which yield aquifer transmissivity values of approximately 650 ft²/day in the area of the Bovey city well. However, based on the specific capacity data set, an aquifer transmissivity value of 6,800 ft²/day is considered representative of the area around the Bovey city well. Apparently the aquifer consists of narrow, high transmissivity zones within a broader, moderate transmissivity domain. The high transmissivity regions probably correspond with glacial drainage pathways where coarse sediment was locally deposited. As indicated by Jones (2002), the Bovey-Coleraine aquifer generally consists of fine sand, but coarse sand and gravel are present locally, generally in low spots on the bedrock surface. Figure 8 shows a possible channel configuration that accommodates most of the high transmissivity wells analyzed for this study, and aligns with 1) a bedrock valley of Jirsa (2005), and 2) an exposure of potential aquifer material in a wall of the Canisteo Mine Pit mapped by Jennings and Reynolds (2005). This channel morphology was used in the model simulations used to delineate the WHPA. This method of determining transmissivity meets the requirements of Minnesota Rules 4720.5510, subpart 6. The aquifer test plan was approved by MDH on November 9, 2006.

Flow Boundaries - The following conditions define the extent to which flow boundaries must be considered:

The aquifer used by the city of Bovey appears to be laterally persistent except where it was removed within the Canisteo Mine Pit. However, it does appear to vary widely in transmissivity, and boundaries to groundwater flow undoubtedly occur where significant contrasts are found. In addition, the overlying and underlying tills that are generally present serve to retard vertical movement of groundwater into or out of the aquifer and constitute flow boundaries.

The aquifer generally exhibits confined hydraulic conditions in the vicinity of the city well. However, the aquifer is unconfined where it is intersected by the Canisteo Mine Pit and at some other locations where ice contact deposits are prevalent, particularly around Trout Lake (Figures 2 and 3). These fully-penetrating hydraulic features constitute hydrologic flow boundaries.

The State Water Use Data System maintained by the DNR was accessed and identified the following high-capacity wells, in addition to that operated by the city of Bovey, that may impact the delineation of the WHPA:

* City of Coleraine Wells 1 and 4 (241430 and 110457, respectively)

Method Used to Delineate the Wellhead Protection Area - The WHPA for Bovey Well 1 (228834) was delineated using the three-dimensional, numerical groundwater flow model Modflow 2000, along with Modpath particle tracking software. These programs were accessed using the GMS modeling software, Version 6.0. This program is capable of simulating complex hydrologic scenarios, such as spatial variability in aquifer recharge and geology, including the presence of flow boundaries. The model input and solution files are on file at the MDH and available upon request.

Groundwater Flow Model Used to Define the Well Capture Zones - The groundwater flow model used to delineate the WHPA for Bovey was derived from an existing regional model of the Canisteo Mine Pit area (Jones, 2002). The model simulates flow in the complete glacial drift package, plus the uppermost bedrock. Because the original model consists of a relatively coarse (100 m) uniform grid, it was deemed necessary to create a subset of the model with a grid that was refined based on the locations of the pumping wells in the Bovey area. The local model used for WHPA delineation was extracted from the regional model using the telescopic refinement process in GMS (Figure 9). In this process, boundary conditions and hydraulic properties assigned to individual cells in the original three-dimensional model are exported to two-dimensional scatter points. Following creation of the new, refined grid for the local model, grid cells are re-populated with the original boundary conditions and hydraulic properties via interpolation from the two-dimensional data sets. Finally, constant head boundary conditions are applied along the boundaries of the model. It should be noted that the grid for the local model was oriented in such a way that at least two of the four local model boundaries approximately parallel potentiometric contours from the original model, therefore satisfying constant head conditions at those boundaries.

Glaciofluvial sediments, such as those tapped by the Bovey city well, are predominantly represented in two layers of the model (Layers 2 and 4). Layer 2 represents the aquifer utilized by the cities of Bovey and Coleraine. Glacial clays and till are present in three layers of the model (Layers 1, 3 and 5). Layer 6 represents uppermost bedrock. The geometry of these bodies was determined from surficial geologic maps and well record data. The porosity of the aquifer material was set at 0.25, typical of a sand aquifer (Fetter, 1988). The hydraulic conductivity and recharge values assigned to these units are shown in Table 5.

In addition to the grid refinement, the local model used to delineate the Bovey WHPA differs from the regional model of Jones (2002) in that 1) the hydraulic conductivity of the Bovey-Coleraine aquifer was increased within the outwash channel, as shown in Figure 8, and 2) the conductance of the Trout Lake bed material was increased from 0.02 m²/d/m to 1.0 m²/d/m. The latter change was implemented to allow a better fit to the chemical and isotopic data obtained from the Coleraine city wells, as described in the section of this report dealing with model calibration.

Table 5
Parameters Used for WHP Area Delineation

Type of Simulated Cell	Recharge (ft/day)	Hydraulic Conductivity (ft/day)	
		Calibrated Values from Regional Model	Values Used to Create WHPA
Glaciofluvial Sediments	1.1×10^{-3}	13.1 – 32.8	13.1 - 136
Glacial Till	3.9×10^{-6}	7.0×10^{-2}	7.0×10^{-2}
Bedrock	2.3×10^{-4}	7.0×10^{-3}	7.0×10^{-3}
Canisteo Mine Pit	1.4×10^{-3}	3.28×10^4	3.28×10^4

Lakes and perennial wetlands are represented in the model as general head boundaries. The most locally significant of these is Trout Lake. The water level elevation at this lake has ranged from 1,283.9 to 1,290.1 feet above sea level over the period from 1911 to present, and most recent readings place the level at approximately 1,288 feet. An hydraulic conductivity of 0.07 ft/day and a vertical thickness of 3.28 ft were used in calculating the conductance in these cells. The thickness value is an estimate of Jones (2002), whereas the hydraulic conductivity was derived from single well hydraulic tests (Jones, 2002) and values determined for lake-bed material at Shingobee Lake (Kishel and Gerla, 2002).

Perennial streams and rivers not simulated as part of the wetlands were simulated using the river module. The same hydraulic conductivity and bed thickness values applied to wetlands and lakes noted above were applied to the river segments. River stage values were assumed to be 6.56 feet above the altitude of the riverbed (Jones, 2002).

Recharge was applied to the surficial layer of the model using a specified flux boundary. Initial recharge rates were proportioned based on results from stream hydrograph analyses and geology in the surficial layer of the model. The largest recharge rates were simulated where glaciofluvial sediments were present at the land surface. Smaller rates were applied where clay, till, or bedrock were present at the land surface (Table 5).

The Canisteo Mine Pit was represented in the model as a series of highly conductive, constant head cells. An hydraulic conductivity value of 3,280 ft/day was used for these cells (Table 5). This value was used because it allows water levels in the pit cells to be relatively consistent and to respond similarly to a lake (Jones, 2002). The water level in this pit has varied greatly over the past 100 years in response to mining activities, which ceased in the mid 1980s (Jones, 2002). Since 1989, the water level in the pit has risen from 1,250 feet above sea level to its current elevation of approximately 1,310 feet above sea level (DNR records). For the purposes of the WHPA delineation, Canisteo Pit water levels were simulated at 1,300, 1,310 and 1,320 feet in separate model runs. The 1,300-foot level is consistent with the original model of Jones (2002) and represents the level at which the DNR proposes to control the pit level in the future (Bob Liebfried, personal communication, 2006). The 1,310-foot level represents current conditions (DNR data). The 1,320-foot level represents the approximate overflow elevation for the pit. Given the past rate of the rising water level within the pit, this level could be reached within the next ten years, which is the time period that the city's WHP plan is intended to cover.

The capture zones generated by the model were created by releasing particles from the well and tracing backward. The particles were released at the center of the model cell containing the well, and twenty path lines were generated for each well. The groundwater component of the WHPA for the city of Bovey is a composite of each of the model scenarios shown in Figure 9. Note that some of the particle tracks from the Bovey city well intersect the Canisteo Mine Pit within a 10-year time of travel for both the 1,310-foot and 1,320-foot pit water level simulations. This observation is consistent with the original results presented by Jones (2002), although no time of travel estimates accompanied the flow paths shown in that document.

Results of Model Calibration and Sensitivity Analysis - The local model used for the WHPA delineation was extracted from the original calibrated Canisteo Pit regional model of Jones (2002). As a result, no additional attempts were made to further calibrate the model to hydraulic heads. However, 16 of the 18 monitoring wells from the original model that were located within the boundaries of the local model were used to generate calibration results for the local model runs, where synoptic water level data existed for comparison (Table 6). Water level data for all 16 of the monitoring wells were available from the DNR for 2001 for the 1,300-foot pit level simulation, and from 13 of the wells in 2006 for the 1,310-foot pit level simulations. A representative plot of measured versus simulated water level elevations for the 1,310-foot level simulation is shown in Figure 10, and a plot of model-generated potentiometric contours for Layer 2 versus water level data from wells is shown in Figure 11.

Table 6
Model Calibration Data (all values in meters)

Model Run	Mean Error	Mean Absolute Error	Root Mean Squared Error
Canisteo Pit Level = 1,300 ft	-0.83	4.1	5.21
Canisteo Pit Level = 1,310 ft	-0.25	4.71	5.47

Although no efforts were made to improve the head calibration, the conductance of the Trout Lake bed materials was varied in the local model to better reflect the chemical and isotopic data obtained from the municipal wells of Bovey and Coleraine. Water sampling conducted in 2004 showed that the Coleraine municipal wells were strongly affected by surface water capture. Water from Trout Lake appeared to be a significant component, although the presence of some Canisteo Mine Pit water could not be ruled out. In contrast, the Bovey city well water showed no significant evidence of surface water influence. The local model was calibrated to the 1,300-foot Canisteo Mine Pit level because it most closely simulates the period prior to the 2004 water-sampling episode. The calibration was considered successful when 1) a significant number of particles traced from the Coleraine city wells terminated at, or passed-through, the Trout Lake general head boundary cells, and 2) none of the particles released from the Bovey well passed through Trout Lake or the Canisteo Mine Pit lake within a 3-year time of travel. This time of travel criterion was selected because it represents the elapsed time between the dates when the Canisteo Mine Pit water level was simulated (2001) and the sampling was conducted (2004).

In his sensitivity analysis of the regional model, Jones (2002) varied horizontal hydraulic conductivity by 0.2-10 times the calibrated values, vertical hydraulic conductivity by 0.1-10 times the calibrated values, and recharge by 0.5-1.5 times the calibrated values. He found that the regional model was most sensitive to changes in horizontal hydraulic conductivity and much less sensitive to changes in vertical hydraulic conductivity and recharge. When varied over the ranges described above, maximum water level differences from the calibrated model, as observed at all monitoring wells, ranged from -21.13 to +59.91 feet for horizontal hydraulic conductivity, -17.29 to +21.69 feet for vertical hydraulic conductivity, and -10.93 to +9.28 feet for recharge.

Conjunctive Delineation - As noted above, some of the particle tracks from the Bovey city well intersect the Canisteo Mine Pit within a 10-year time of travel for the 1,310-foot and 1,320-foot pit water level simulations (Figure 10). As a result, this feature must be considered to be a component of the city's WHPA unless an assimilative capacity boundary can be established (see glossary of terms). At this point, data are insufficient to establish an assimilative capacity boundary for the Canisteo Mine Pit. Existing chemical data appear limited to a relatively narrow range of parameters, leaving many parameters on the National Primary Drinking Water Standards list uncharacterized at this time. Any attempt to establish the basis for an assimilative capacity boundary would need to factor the modeled travel time from the pit to the well, which is believed to range from a minimum of 5 years at a pit water level of 1,320 feet, to at least 8 years when assuming a pit water level of 1,310 feet.

Figure 12 depicts the final WHPA for the city of Bovey. This area was determined by merging 1) the 10-year time of travel groundwater capture zones for the city well, and 2) the surface watershed area for the Canisteo Mine Pit lake, as determined by the DNR (Bob Liebfried, personal communication, 2006).

Uncertainty Analysis - A primary source of uncertainty in the WHPA delineation is the actual three-dimensional geometry of the coarse-grained outwash channel that is thought to provide a high transmissivity pathway for groundwater flow between the Bovey city well and both the Canisteo Mine Pit and Trout Lake. The boundaries of this feature have a significant impact on the groundwater capture zone for the Bovey city well. In addition, the transmissivity of this feature could be more accurately quantified to provide greater confidence in the model output. The following section describes steps that could be taken to provide a greater degree of certainty in the modeled capture zone.

Recommendations for Future Data Collection

1) Enhancing the Understanding of Local Hydrogeologic Conditions.

Subsurface Geology -

Every five years, the city of Bovey should work with the MDH so that the locations of new wells constructed within one mile of the city's well field can be verified and accurate elevations obtained. This information will help address uncertainties related to 1) the areal extent, thickness, and compositional variability of the Bovey-Coleraine aquifer, and 2) the distribution of hydraulic head in this aquifer.

Aquifer Transmissivity -

The transmissivity of the Bovey-Coleraine aquifer in the vicinity of the Bovey municipal well was estimated from specific capacity data. Such estimates tend to be less accurate than those determined from aquifer test data. In order to confirm that the estimates derived from specific capacity tests are appropriate for the area around the city well, it would be helpful if the city were able to conduct an appropriate aquifer test. Such a test would benefit from an observation well that is located within relatively close proximity to the city well. The MDH can work with the city to design a proper aquifer test that provides drawdown and recovery data from both the pumping well and the observation well.

2) Surface Water/Groundwater Exchange.

Chemical and Isotopic Data -

Groundwater modeling results suggest that the Bovey city well is likely to capture water a significant amount of water from the Canisteo Mine Pit within the next ten years, assuming the water level in the pit remains at or exceeds current levels. The MDH recommends that the city initiate an annual program of water sampling from their well in order to track such changes. The results will help to validate the groundwater model and refine resulting capture zones in the future. To support the proposed sampling program, the MDH will assist with the selection of sampling points and analytical parameters. The city will be responsible for most of the sampling, but the MDH will pay for the analyses using funding that it has dedicated for this work. There would be no cost to the city for these analyses and related MDH staff time.

3) Water Use and Water Level Considerations.

Revisions to the WHPA -

The following water use factors should be monitored to determine if a revision of the WHPA or DWSMA is required: 1) the installation of any new high-capacity wells within 1.5 miles of the city well field, 2) increased discharge from the city wells over the values used in this report, and 3) changes in water levels at the Canisteo Mine Pit lake and Trout Lake. The third point refers to the fact that the groundwater gradient in the Bovey and Coleraine areas is largely set by the water level elevations of these two water bodies. If the water level of Trout Lake is maintained around current levels and the Canisteo Mine Pit level is dropped to 1,300 feet or less, then it is unlikely that the Bovey city well will capture Canisteo Mine Pit water within a 10-year time of travel, based on current data. If such a scenario were to be maintained for at least a 10-year time period, then the Canisteo Mine Pit and its surface watershed could be removed from the city of Bovey WHPA.

Delineation of the Drinking Water Supply Management Area

Method Used to Designate the Drinking Water Supply Management Area – The Drinking Water Supply Management Area (DWSMA) was determined by overlaying the WHPA on a map of area roads, railroads, and public land survey boundaries, using a geographic information system to select the closest such feature. This area was then reviewed and modified by staff from the city of Bovey and the MDH.

Assessment of Well Vulnerability

This part documents the vulnerability of the wells used by the public water supplier and is required under Minnesota Rules 4720.5210. The protocol for determining well vulnerability is defined in the MDH document entitled Methodology for Phasing Wells into Minnesota's Wellhead Protection Program (1993), which was approved by the U.S. Environmental Protection Agency as part of its review of Minnesota's wellhead protection program description. The MDH uses the protocol to maintain a database defining the potential vulnerability of community and noncommunity public water supply wells. A score is calculated for each well using 1) construction criteria defined in the State Well Code, 2) geologic sensitivity, and 3) the results of water quality monitoring conducted by the MDH. A numeric score is assigned to each well based on the results of the three areas of evaluation. A cutoff score is used to define wells that are most likely to be vulnerable based on their construction, geologic setting, and sampling history. The printouts of the vulnerability ratings for the city well are presented in Appendix I.

The results of the well vulnerability assessments suggest that the well used by the city of Bovey is potentially vulnerable to contamination. This conclusion is based primarily on a water sample collected from the city well on February 10, 2004, that contained tritium at 18.3 tritium units, indicating the predominance of young (post-1954) water in the sample. An additional factor is that the well does not meet current State Well Code standards for construction.

Vulnerability Assessment for the Drinking Water Supply Management Area

The aquifer used by the Bovey city well was evaluated for its vulnerability to contamination throughout the extent of the DWSMA on the basis of 1) surficial geologic and soils maps, 2) geologic logs from wells in the area, and 3) the chemical and isotopic data noted above.

The Itasca County Soil Survey includes an assessment of the geologic sensitivity at the water table based on the criteria of the DNR (1991). The geologic sensitivity ratings within the Bovey DWSMA range from very high to low (Figure 13). These ratings correlate strongly with the surficial geologic mapping of Jennings and Reynolds (2005). Geologic sensitivity ratings of very high or high correspond to the occurrence of relatively coarse sediments associated with glacial outwash or ice contact deposits. These are most prevalent around Trout Lake, which has been interpreted to be the remnant of a sub-glacial drainage feature (Jennings and Reynolds, 2005). Very high geologic sensitivity ratings are also assigned within the Canisteo Mine Pit

lake, where till that originally overlay the city's aquifer has been removed by mining. Geologic sensitivity ratings of moderate and low are assigned where the soil has a relatively high clay or loam content, suggesting that till was the parent material. These areas are strongly correlated with those areas mapped as Koochiching lobe till by Jennings and Reynolds (2005).

The geologic sensitivity ratings described above were compared with those determined from the geologic logs for wells located within and immediately adjacent to the city's DWSMA (Figure 13). In general, a strong correlation was noted between the two data sources. Wells located adjacent to Trout Lake generally show vulnerability ratings of high to moderate, whereas those located away from the lake and associated ice-contact deposits generally show ratings of moderate to low. Although a very low rating is documented at some wells, this amount of geologic protection appears to be very localized.

The chemical and isotopic data for the Bovey and Coleraine city wells suggest that, even where the geologic sensitivity rating for the aquifer is low to moderate, it is characterized by the presence of young water that is elevated in chloride. As a result, the overlying till cover is considered to be leaky. Those areas determined to exhibit a low geologic sensitivity rating were increased to a vulnerability rating of moderate to reflect the leaky nature of the till. Finally, mapped areas smaller than approximately 10-acres in size were incorporated within the surrounding mapped area to avoid small slivers of land that would be difficult to identify and manage.

In summary, the vulnerability of the Bovey-Coleraine aquifer ranges from moderate to very high. Within areas rated as moderate, the time required for water moving vertically from the land surface to reach the aquifer is probably on the order of several years to decades (DNR, 1991). Within areas rated as very high or high, water from the land surface can probably reach the aquifer in weeks to years.

Selected References

Cotter, R.D., Young, H.L., Petri, L.R., and Prior, C.H. (1965), *Water resources in the vicinity of municipalities on the western Mesabi Iron Range, northeastern Minnesota*, U.S. Geological Survey Water Supply Paper 1759-B.

Geologic Sensitivity Project Workgroup (1991), *Criteria and guidelines for assessing geologic sensitivity of ground water resources in Minnesota*, Minnesota Department of Natural Resources, Division of Waters, St. Paul, Minn., 122 p.

Fetter, C.W. (1988), *Applied hydrogeology*, Merrill Publishing Company, Columbus, Ohio, 592 p.

Jones, P.M. (2002), *Characterization of ground-water flow between the Canisteo Mine Pit and surrounding aquifers, Mesabi Iron Range, Minnesota*, U.S. Geological Survey Water Resources Investigations Report 02-4198.

Jennings, C.E., and Reynolds, W.K. (2005), *Surficial geology of the Mesabi Iron Range, Minnesota*, Miscellaneous Map Series, M-164, Minnesota Geological Survey, St. Paul, Minn., 1 sheet, scale 1:100,000.

Jirsa, M.A., Chandler, V.W., and Lively, R.S. (2005), *Bedrock geology of the Mesabi Iron Range, Minnesota*, Miscellaneous Map Series, M-163, Minnesota Geological Survey, St. Paul, Minn., 1 sheet, scale 1:100,000.

Kishel, H.F., and Gerla, P.J. (2002), *Effects of small-scale hydraulic variation on ground-water discharge to Shingobee Lake, Minnesota*, University of North Dakota, Department of Geology web page; URL http://www.geology.und.nodak.edu/gerla/home/cur_res.html.

Minnesota Department of Health (1996), *Methodology for phasing wells into Minnesota's wellhead protection program*, Minnesota Department of Health, St. Paul, Minn., 18 p.

Minnesota Department of Health (2006), *Guidance for preparing a conjunctive delineation*, Draft of unpublished guidance document.

Minnesota State Climatologist (2001), *Normal precipitation and temperature data*, at URL <http://climate.umn.edu/doc/historical/normals.htm>.

Nyberg, P.R. (1987), *Soil survey of Itasca County, Minnesota*, Soil Survey, U.S. Department of Agriculture, Soil Conservation Service, Fort Worth, Tex., 197 p., 65 sheets, scale 1:24,000.

Winter, T.C. (1971), *Sequence of glaciation in the Mesabi-Vermillion Iron Range area, northeastern Minnesota*, U.S. Geological Survey Professional Paper 750-C, p. C82-C88.

Winter, T.C. (1973a), *Hydrogeology of glacial drift, Mesabi Iron Range, northeastern Minnesota*, U.S. Geological Survey Water Supply Paper 2029-A, 23 p.

Appendix I
Municipal Well Information

Table 1
Municipal Water Supply Well Information
Bovey, Minnesota

Local Well Name	Unique Number	Use/ Status¹	Casing Diameter (inches)	Casing Depth (feet)	Well Depth (feet)	Date Constructed/ Reconstructed	Well Vulnerability	Aquifer
1	228834	P	16	74	92	1953	Vulnerable	QBAA

Note: 1. Primary (P) or Emergency backup (E) well



**MINNESOTA DEPARTMENT OF HEALTH
SECTION OF DRINKING WATER PROTECTION
SWP Vulnerability Rating**



625 Robert St. N. St. Paul MN 55155
P.O. Box 64975 St. Paul MN 55164 - 0975

PWSID: 1310003
SYSTEM NAME: Bovey
WELL NAME: Well #1

TIER: 3
WHP RANK:
UNIQUE WELL #: 00228834

COUNTY: Itasca TOWNSHIP NUMBER: 56 RANGE: 24 W SECTION: 32 QUARTERS: BDA

<u>CRITERIA</u>	<u>DESCRIPTION</u>	<u>POINTS</u>
Aquifer Name(s) :	Quaternary Buried Unconfined	
DNR Geologic Sensitivity Rating :	Medium	25
L Score :	2	
Geologic Data From :	Well Record	
Year Constructed :	1953	
Construction Method :	Cable Tool/Bored	0
Casing Depth :	74	10
Well Depth :	92	
Casing grouted into borehole?	Unknown	0
Cement grout between casings?	Not applicable	0
All casings extend to land surface?	Yes	0
Gravel - packed casings?	Unknown	0
Wood or masonry casing?	No	0
Holes or cracks in casing?	Unknown	0
Isolation distance violations?		0
Pumping Rate :	650	10
Pathogen Detected?		0
Surface Water Characteristics?		0
Maximum nitrate detected :	1.3	10
Maximum tritium detected :	18.3 02/10/2004	VULNERABLE
Non-THMS VOCs detected?		0
Pesticides detected?		0
Carbon 14 age :	Unknown	0
Wellhead Protection Score :		55
Wellhead Protection Vulnerability Rating :		VULNERABLE

Vulnerability Overridden :

COMMENTS

NITRATE DATA FROM PWSD 1989, 11/71 SAMPLE

Appendix II
Figures Used In This Report

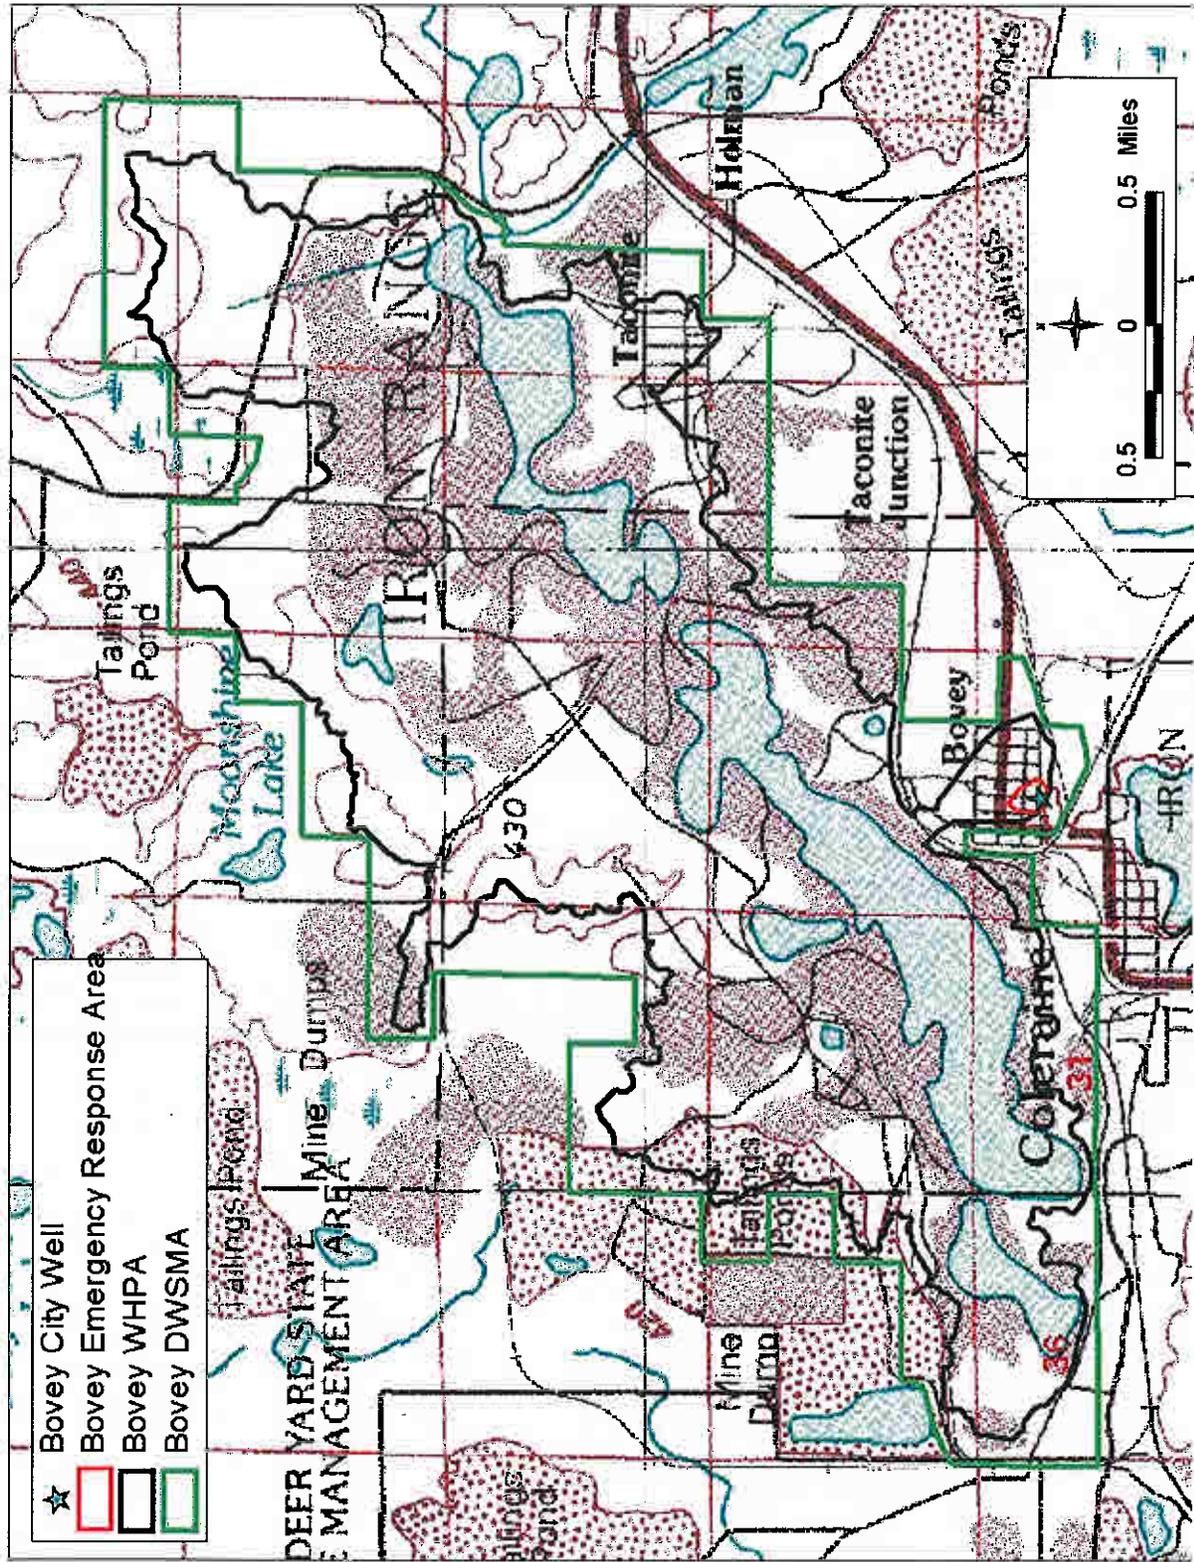


Figure 1. Wellhead protection area (WHPA), drinking water supply management area (DWSMA) and emergency response area (ERA) for the city of Bovey.

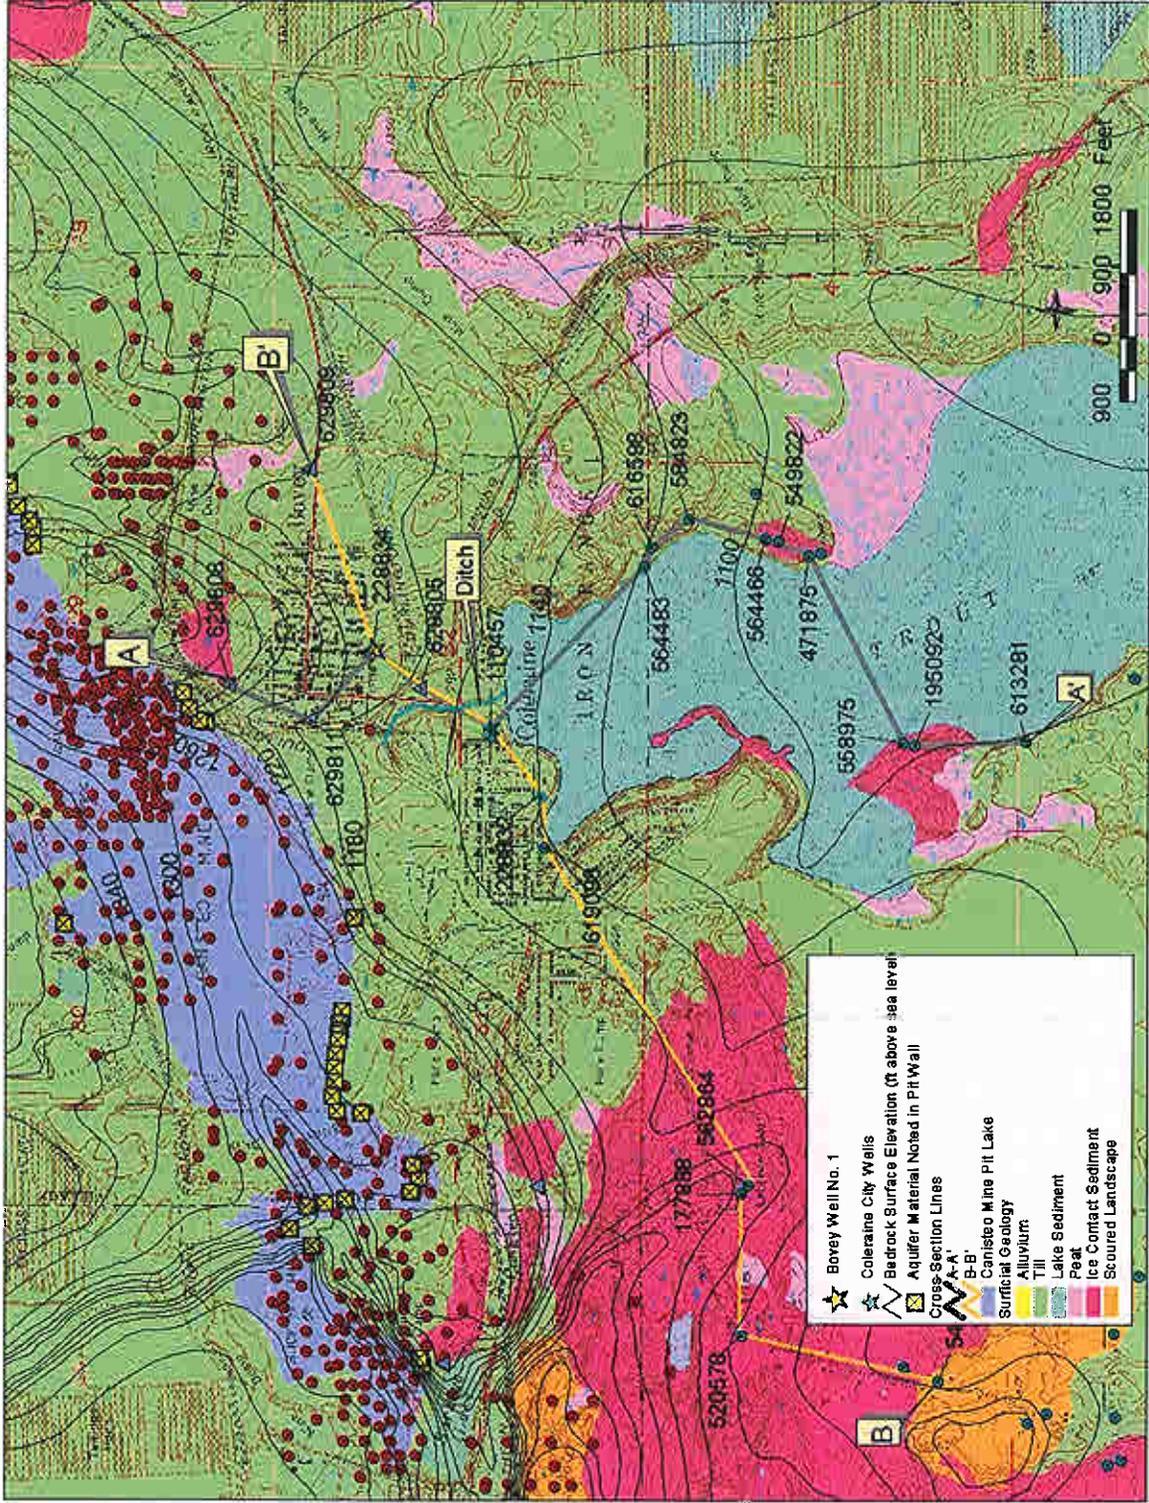


Figure 2. Surficial geology of the Bovey area (Jennings and Reynolds, 2005).

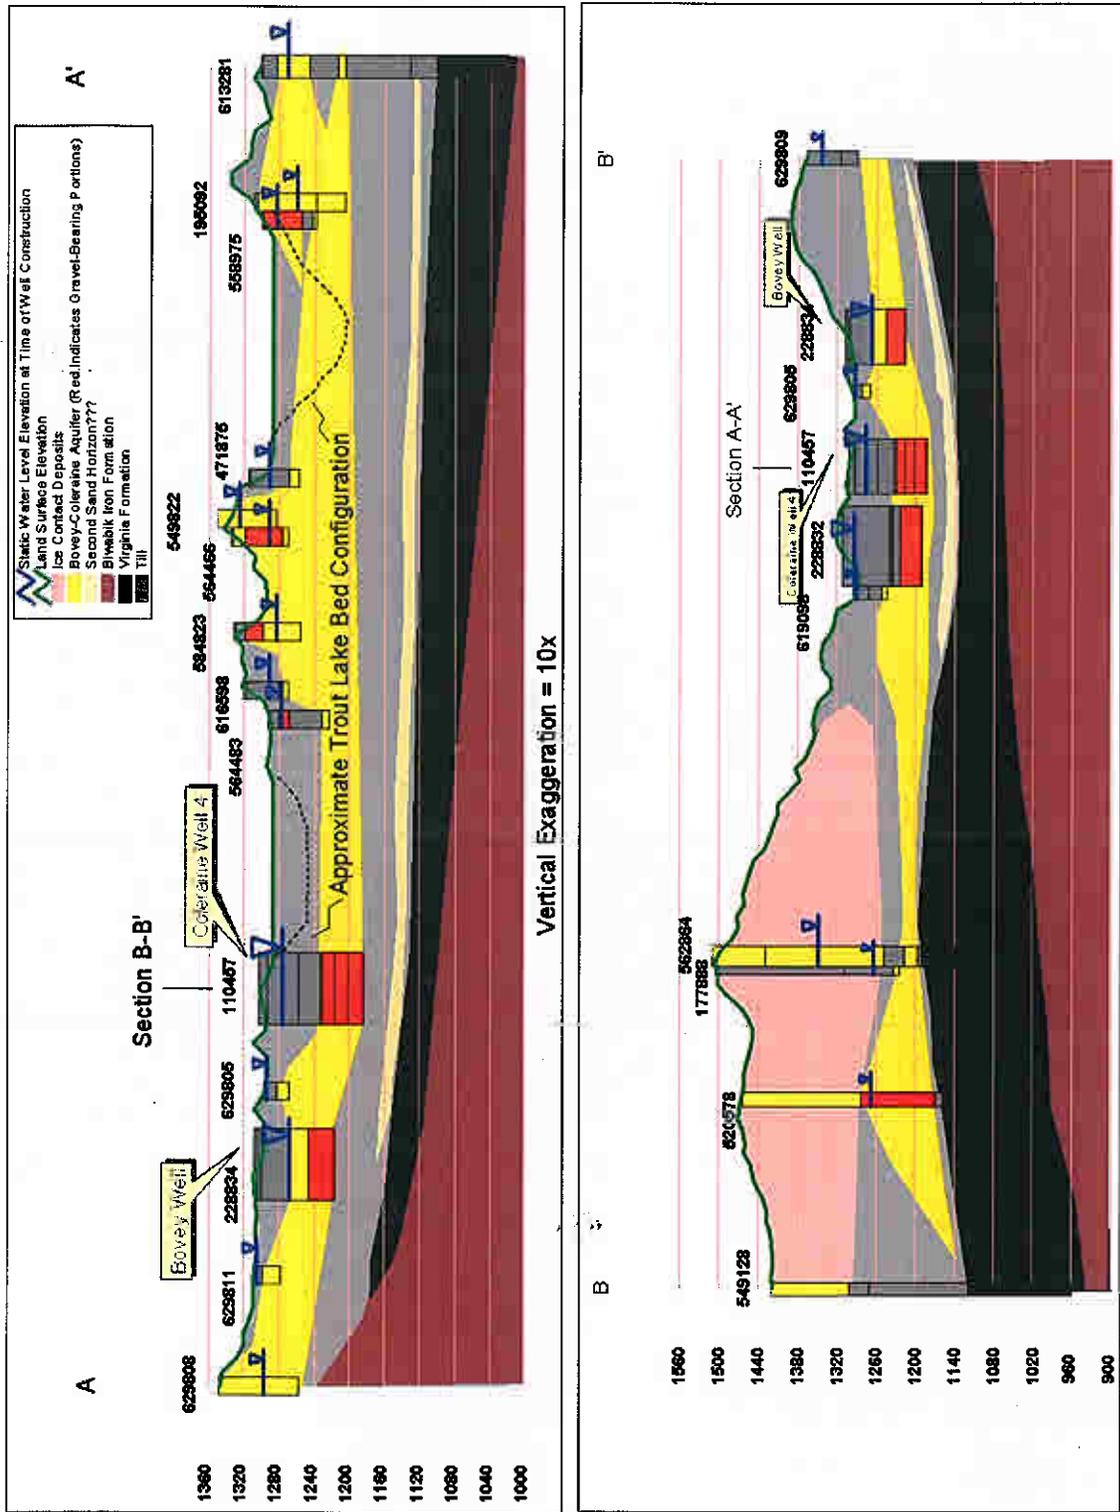


Figure 3. Geologic cross-sections through the Bovey area.

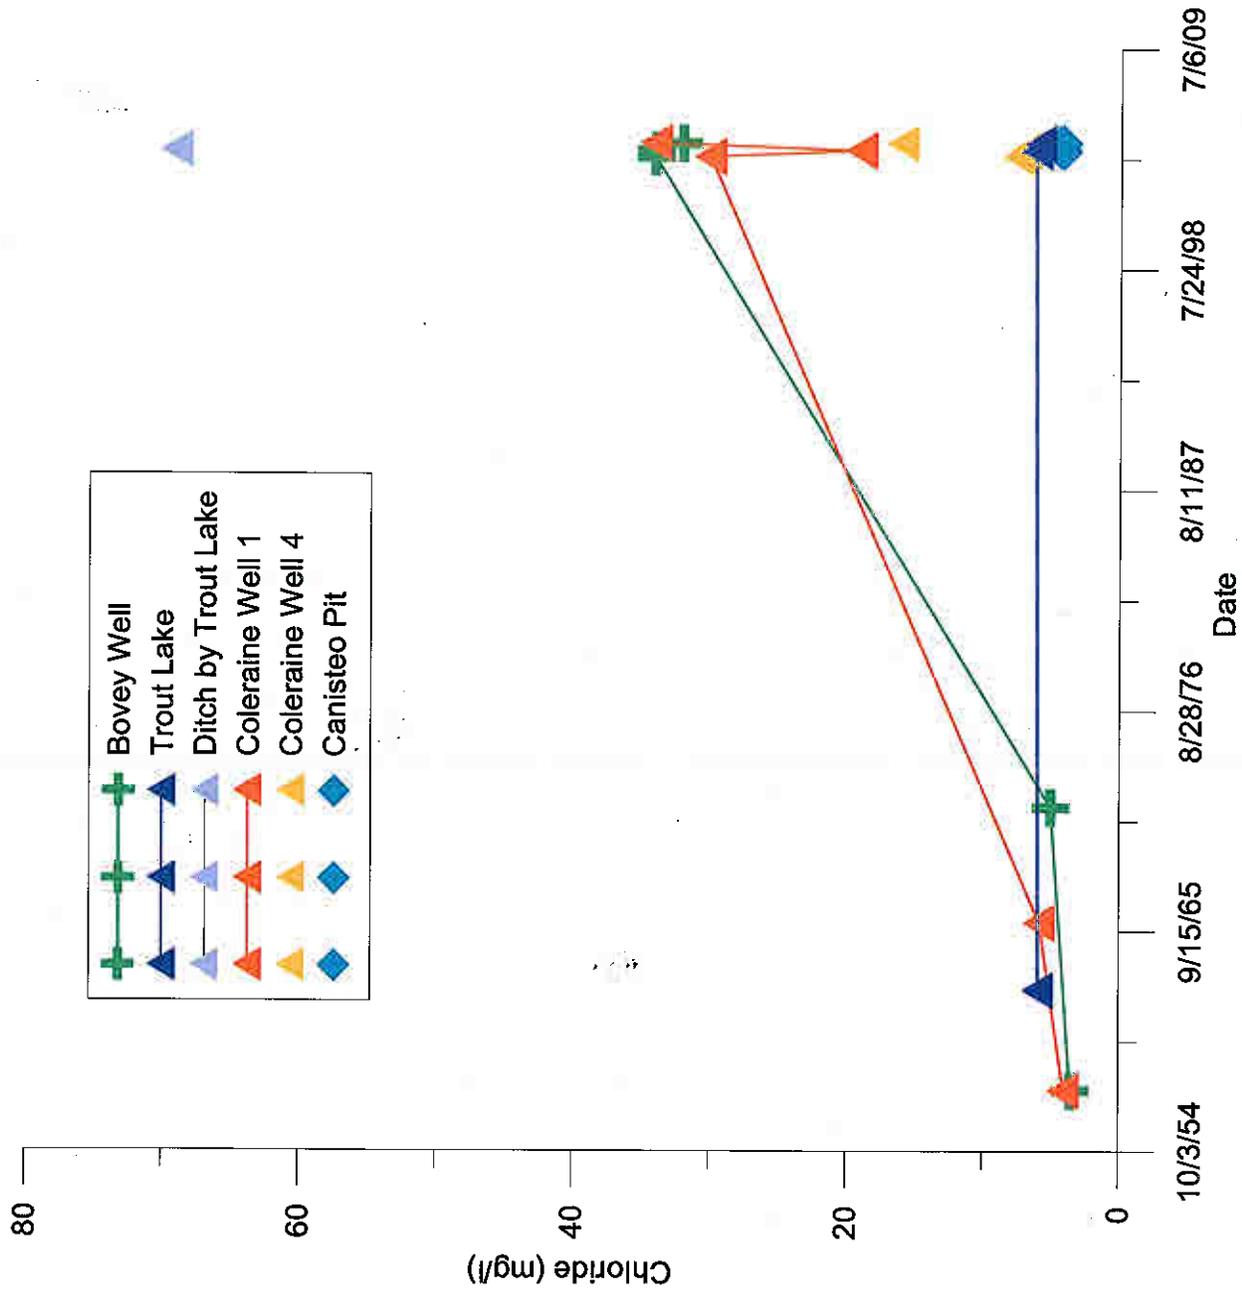


Figure 4. Chloride data through time.

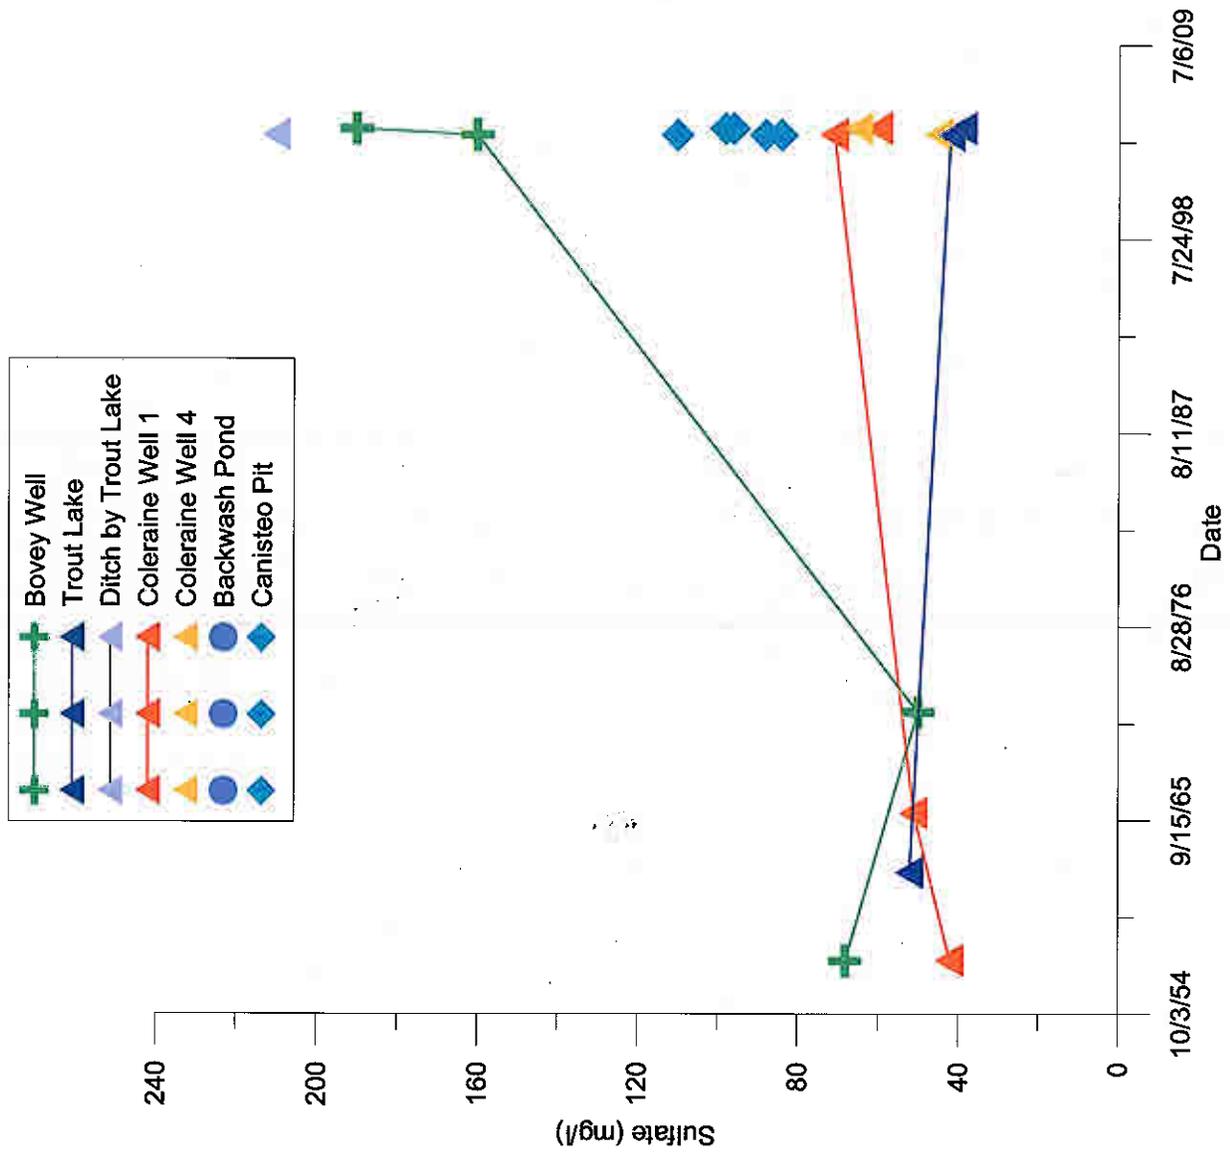


Figure 5. Sulfate data through time.

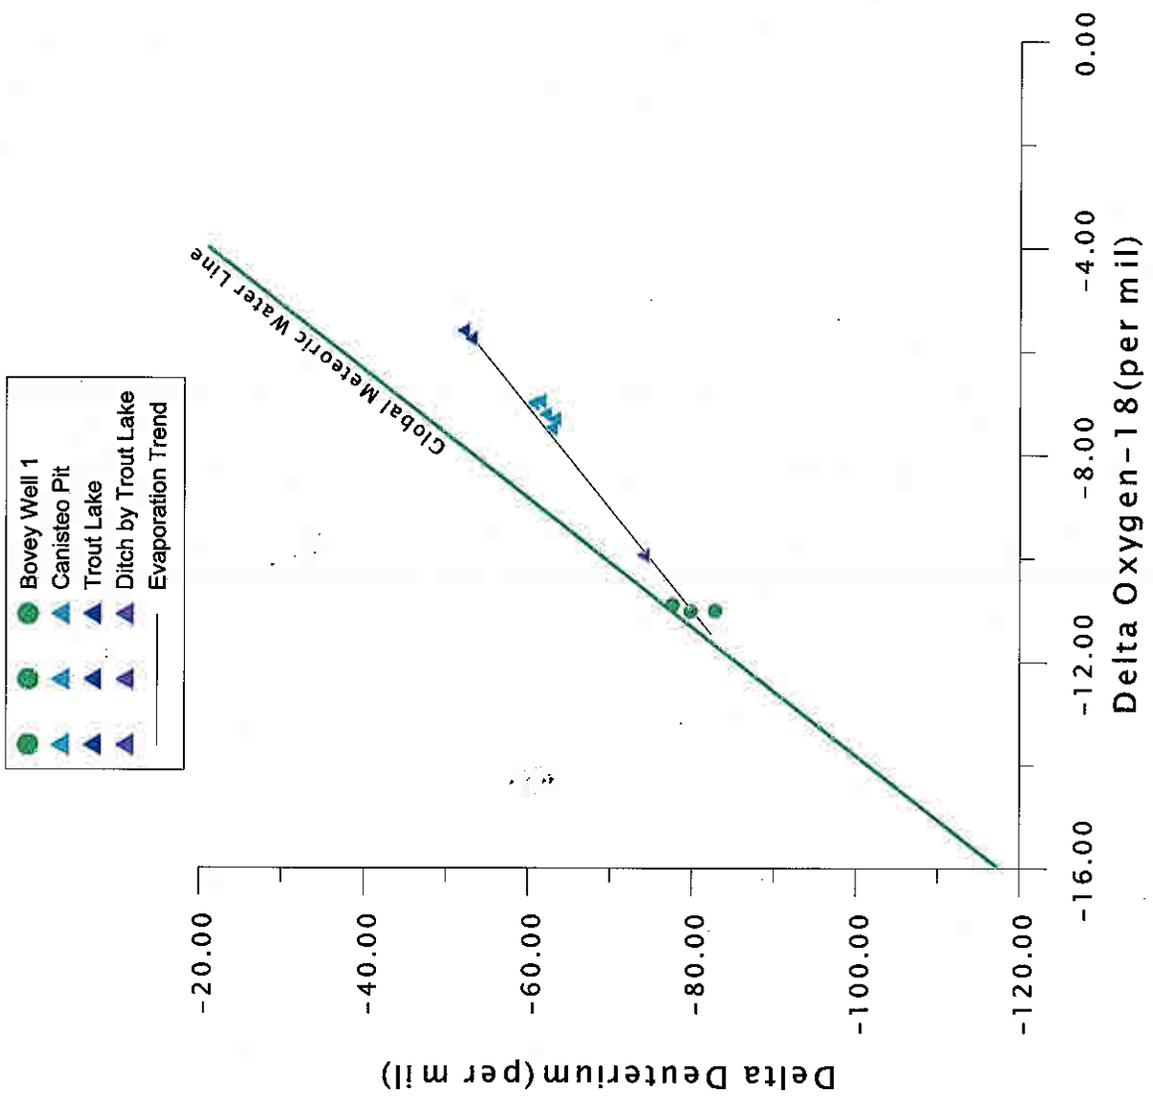


Figure 6. Stable isotopes of water.

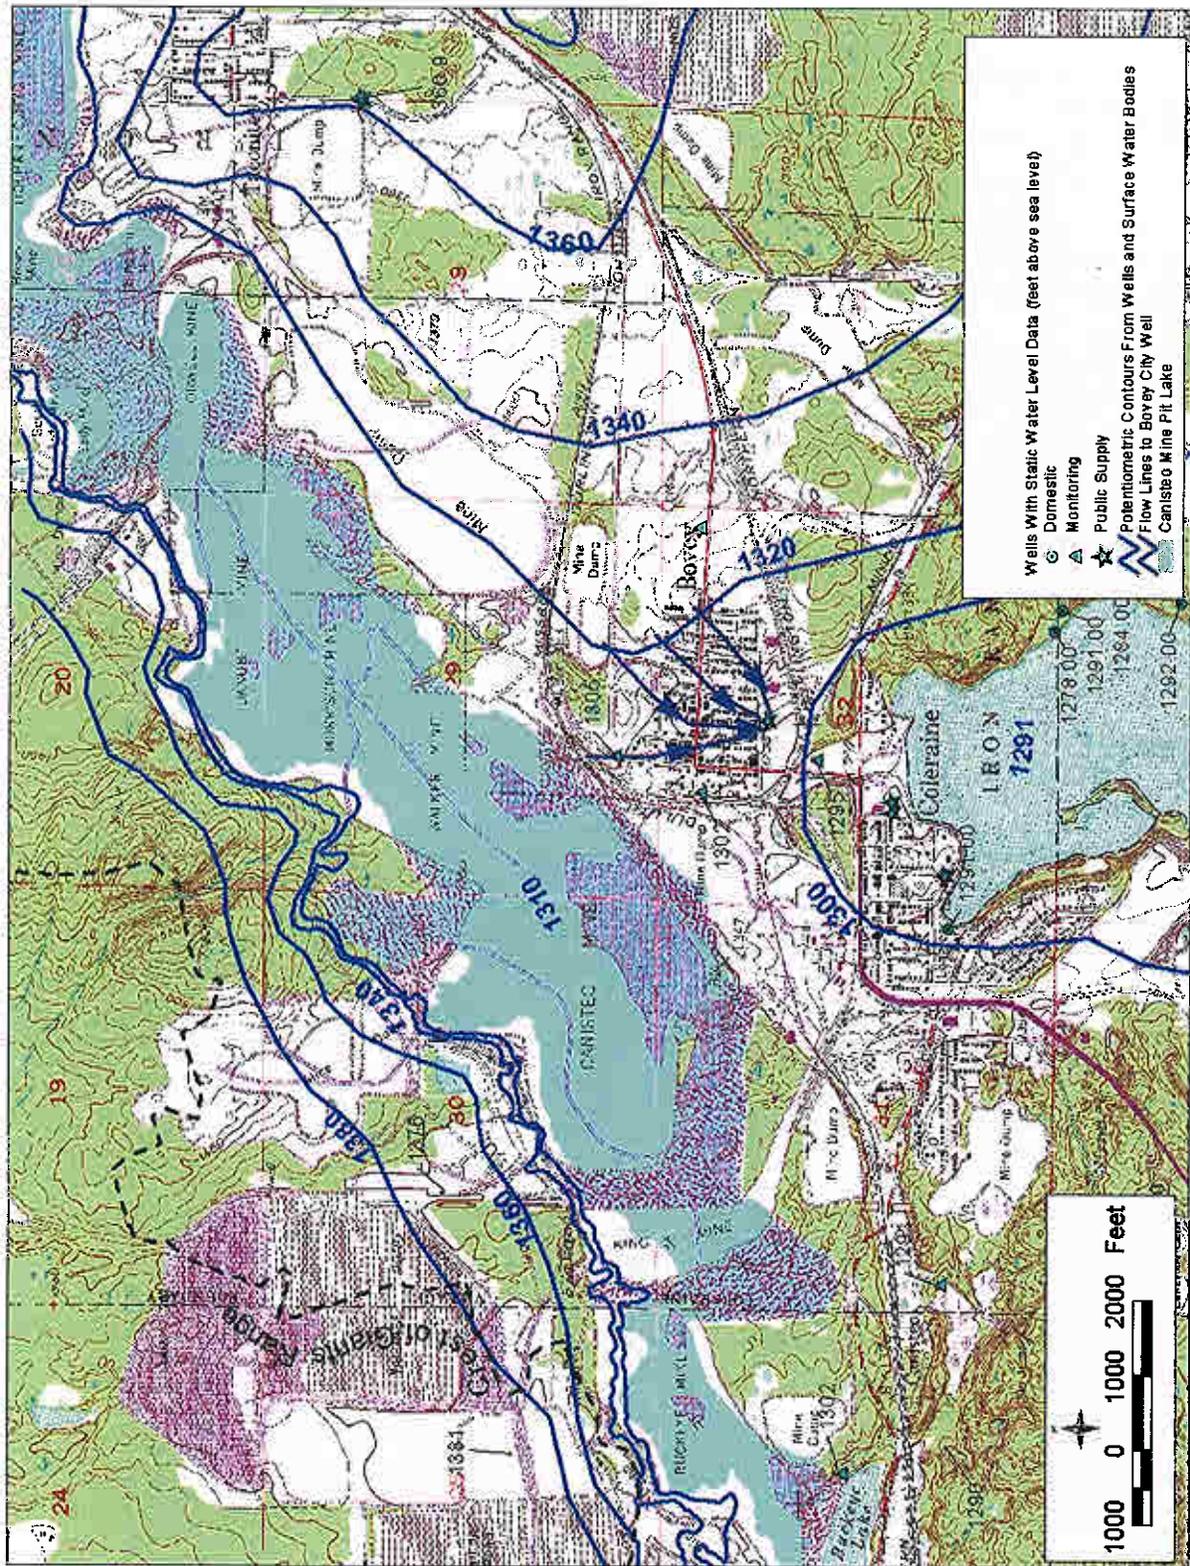


Figure 7. Groundwater flow direction in the Bovey area in 2006.

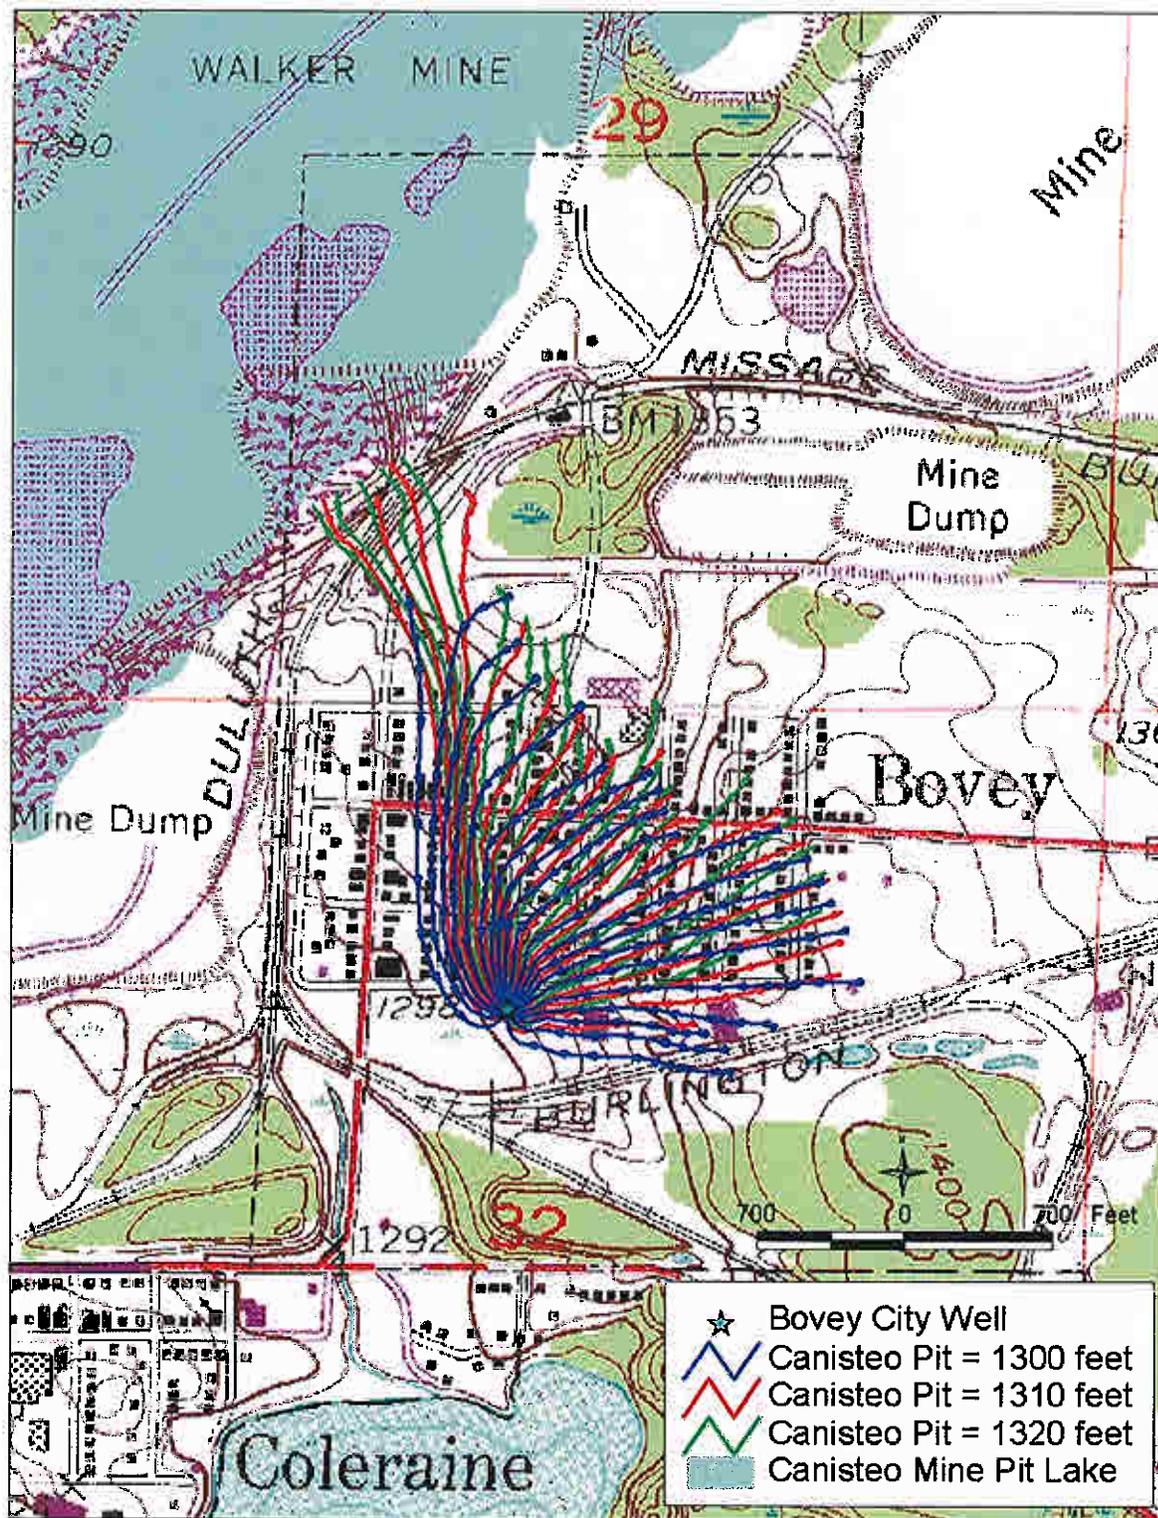


Figure 9. Ten-year time of travel particle traces. Tick marks are shown at each one-year travel time.

Computed vs. Observed Values

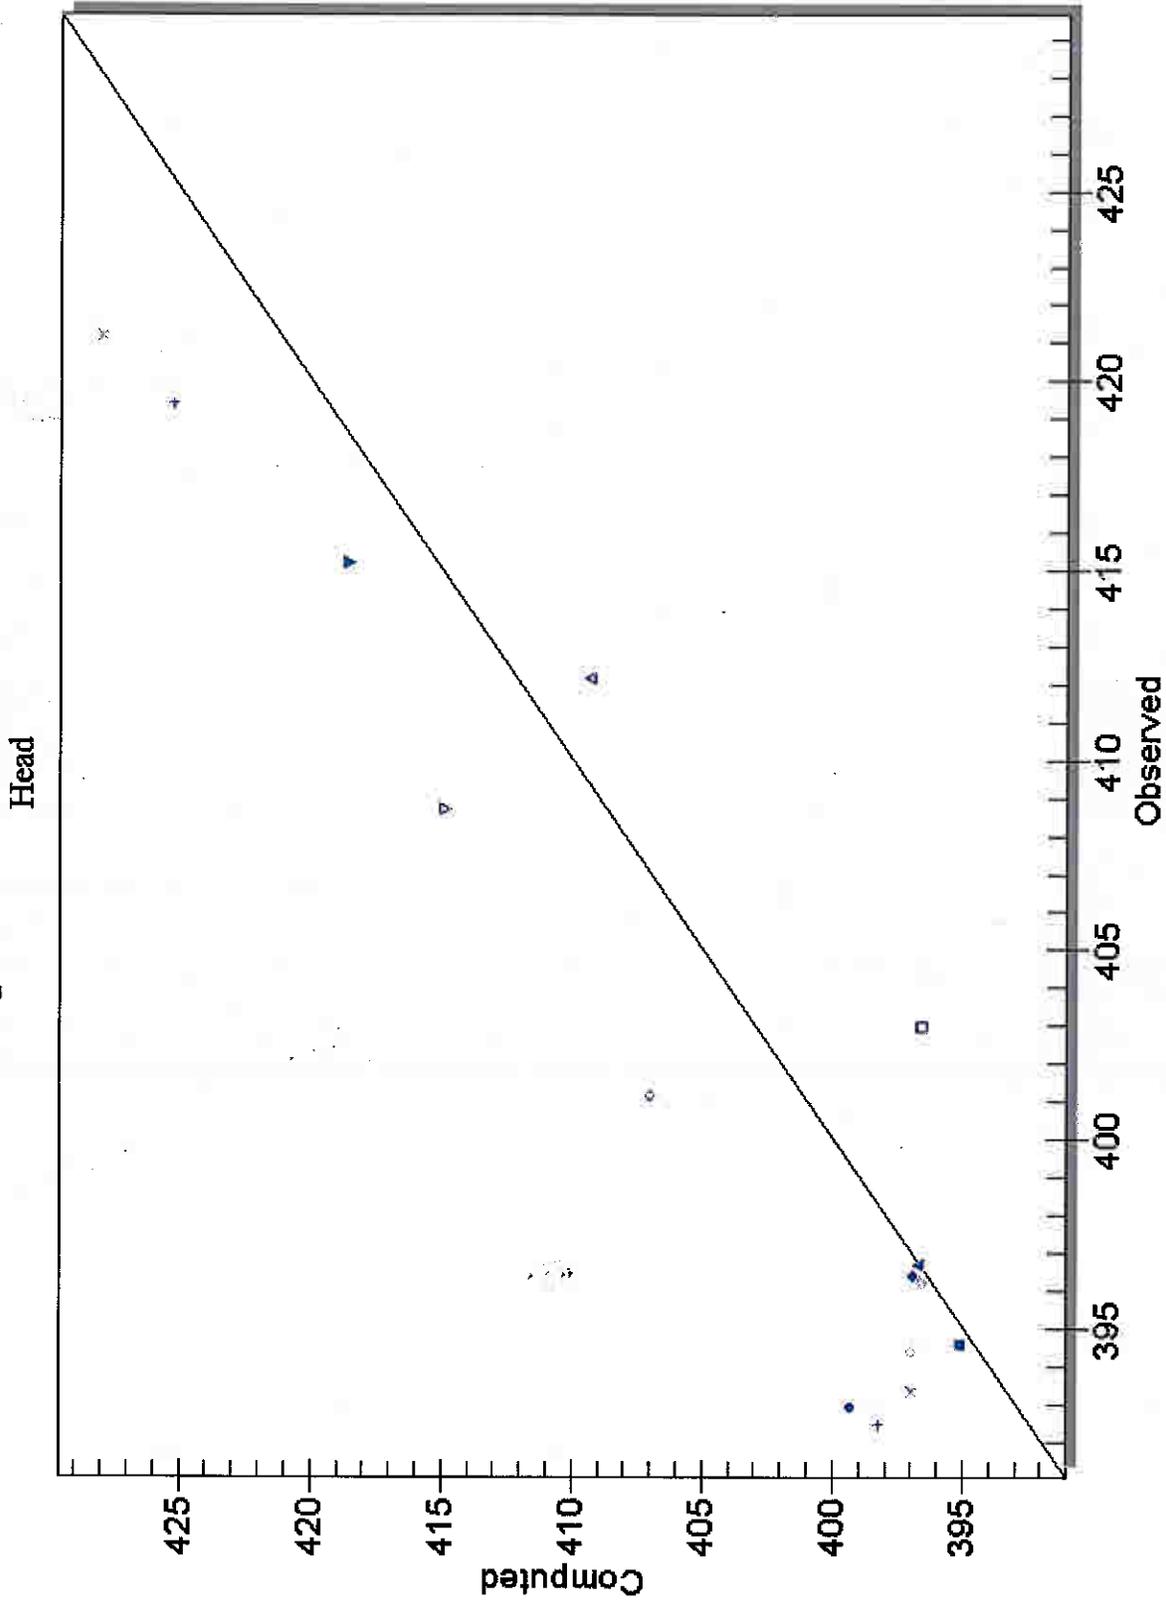


Figure 10. Graphical view of comparison between measured and modeled heads.

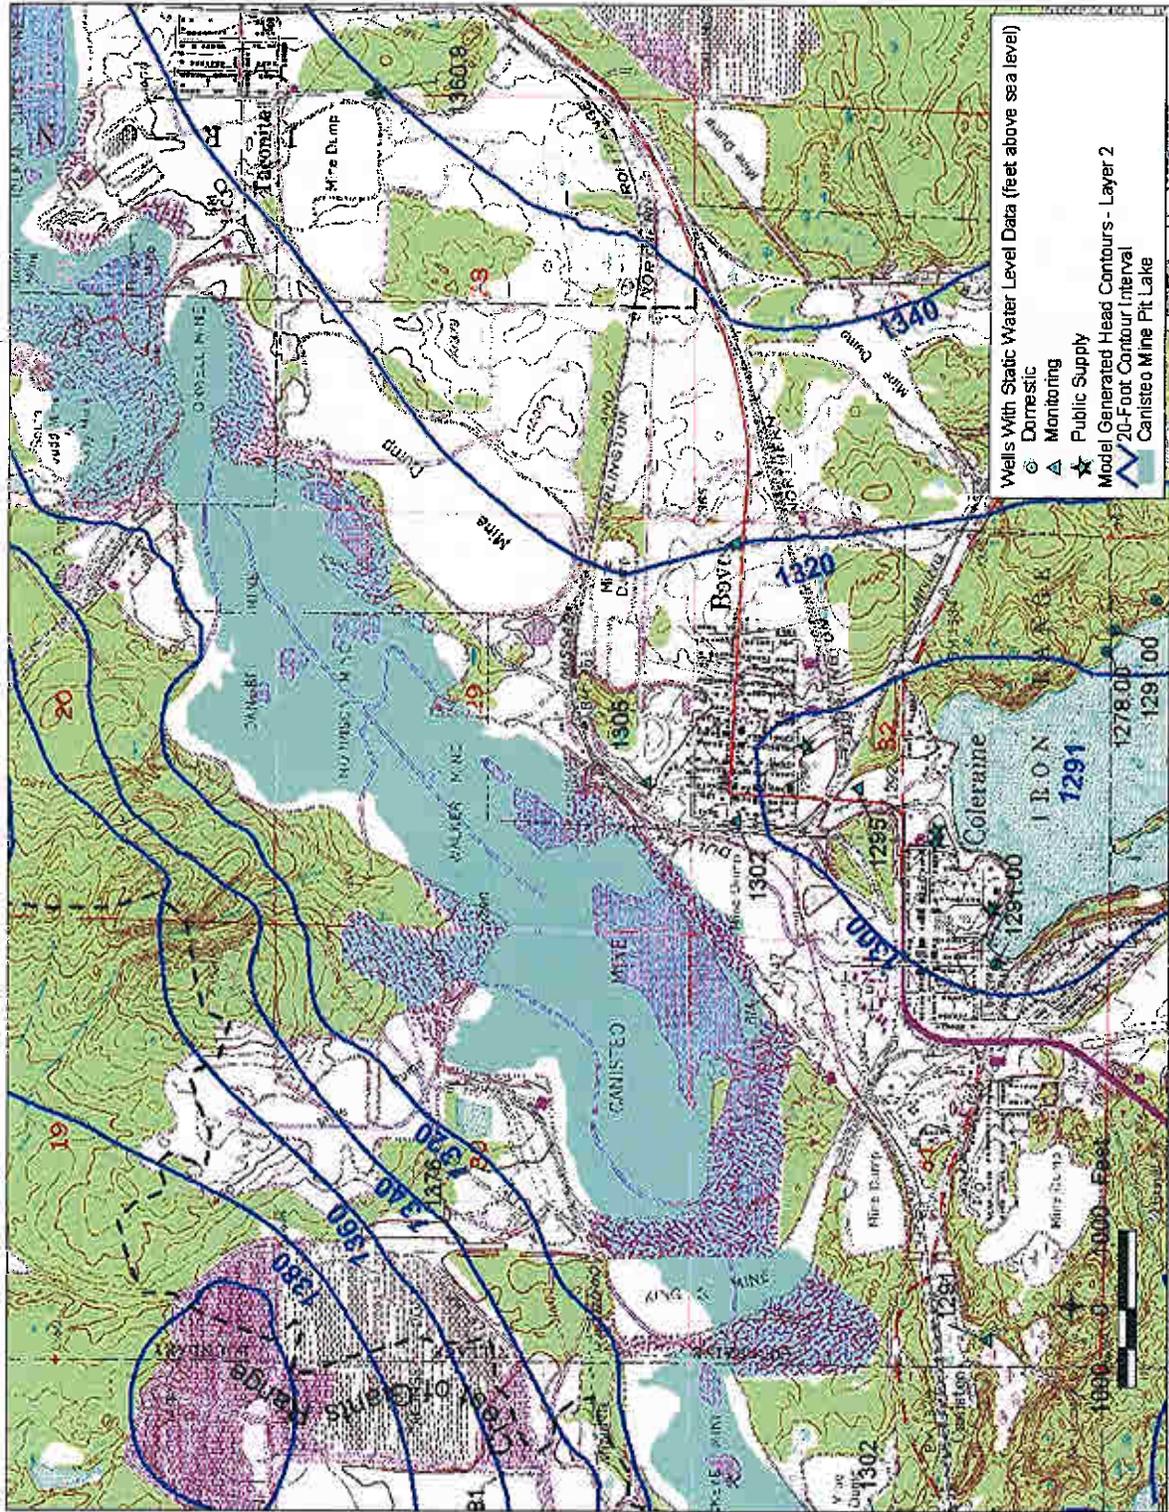


Figure 11. Map view of comparison between measured and modeled heads.

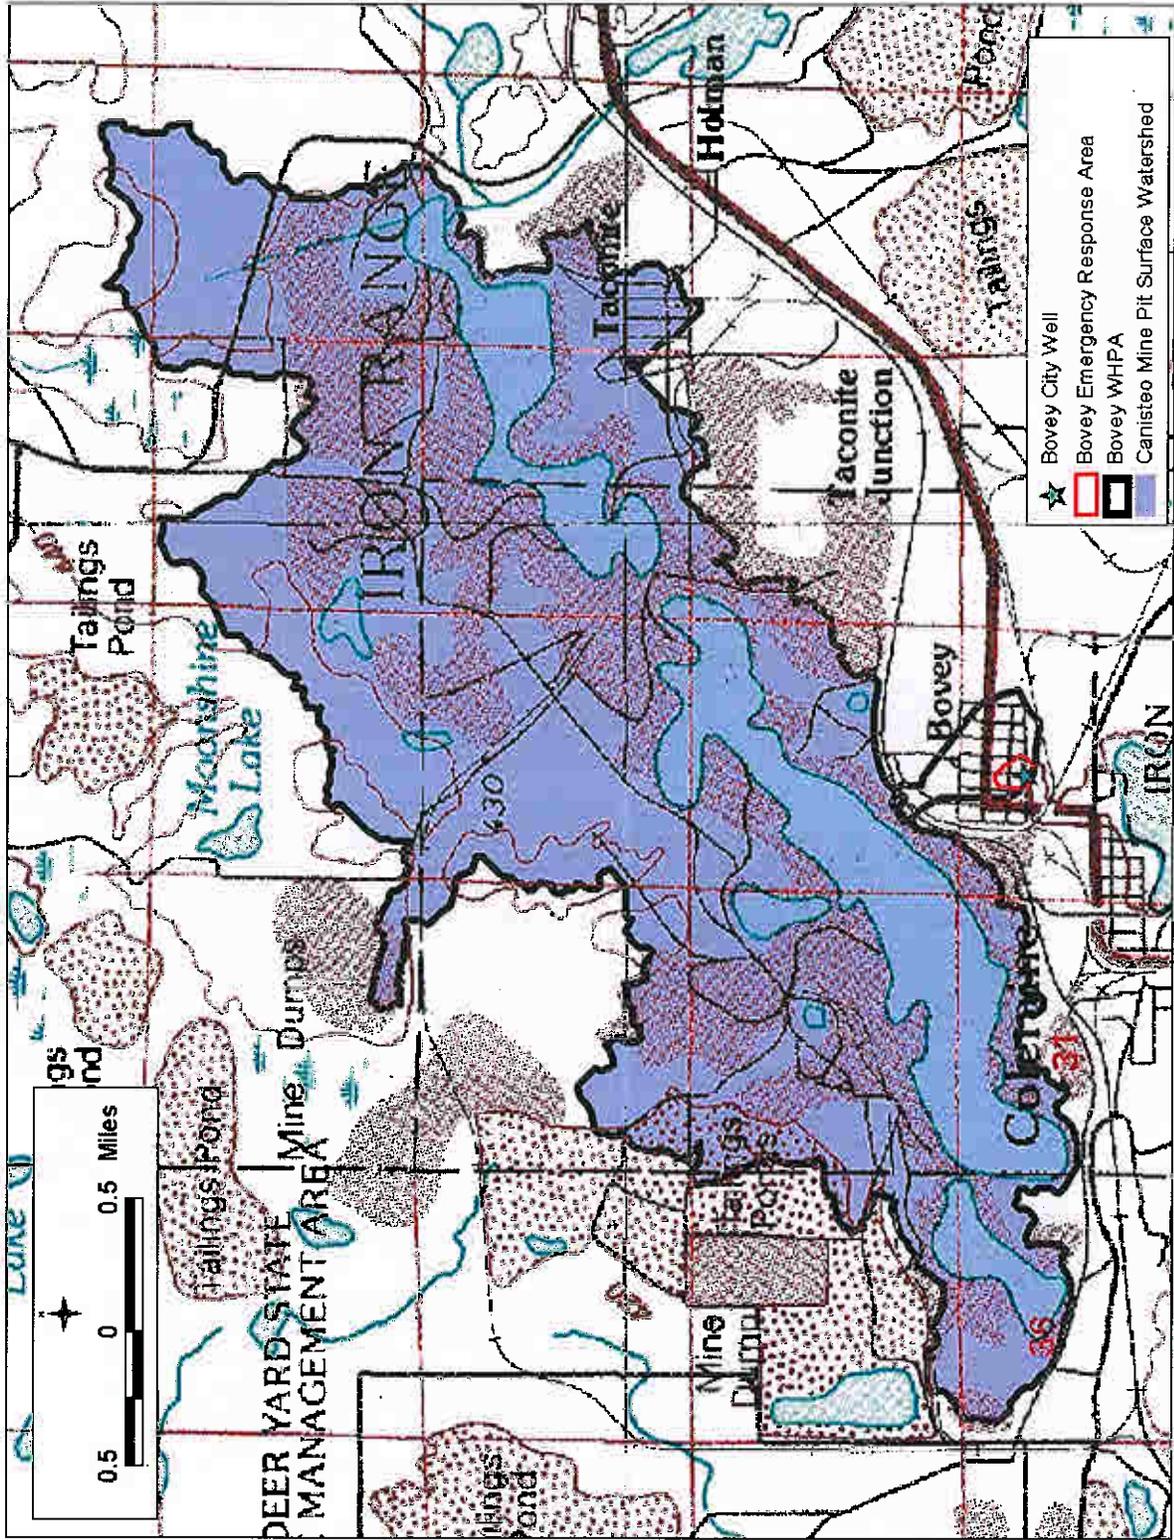


Figure 12. Conjunctive delineation for city of Bovey WHPA.

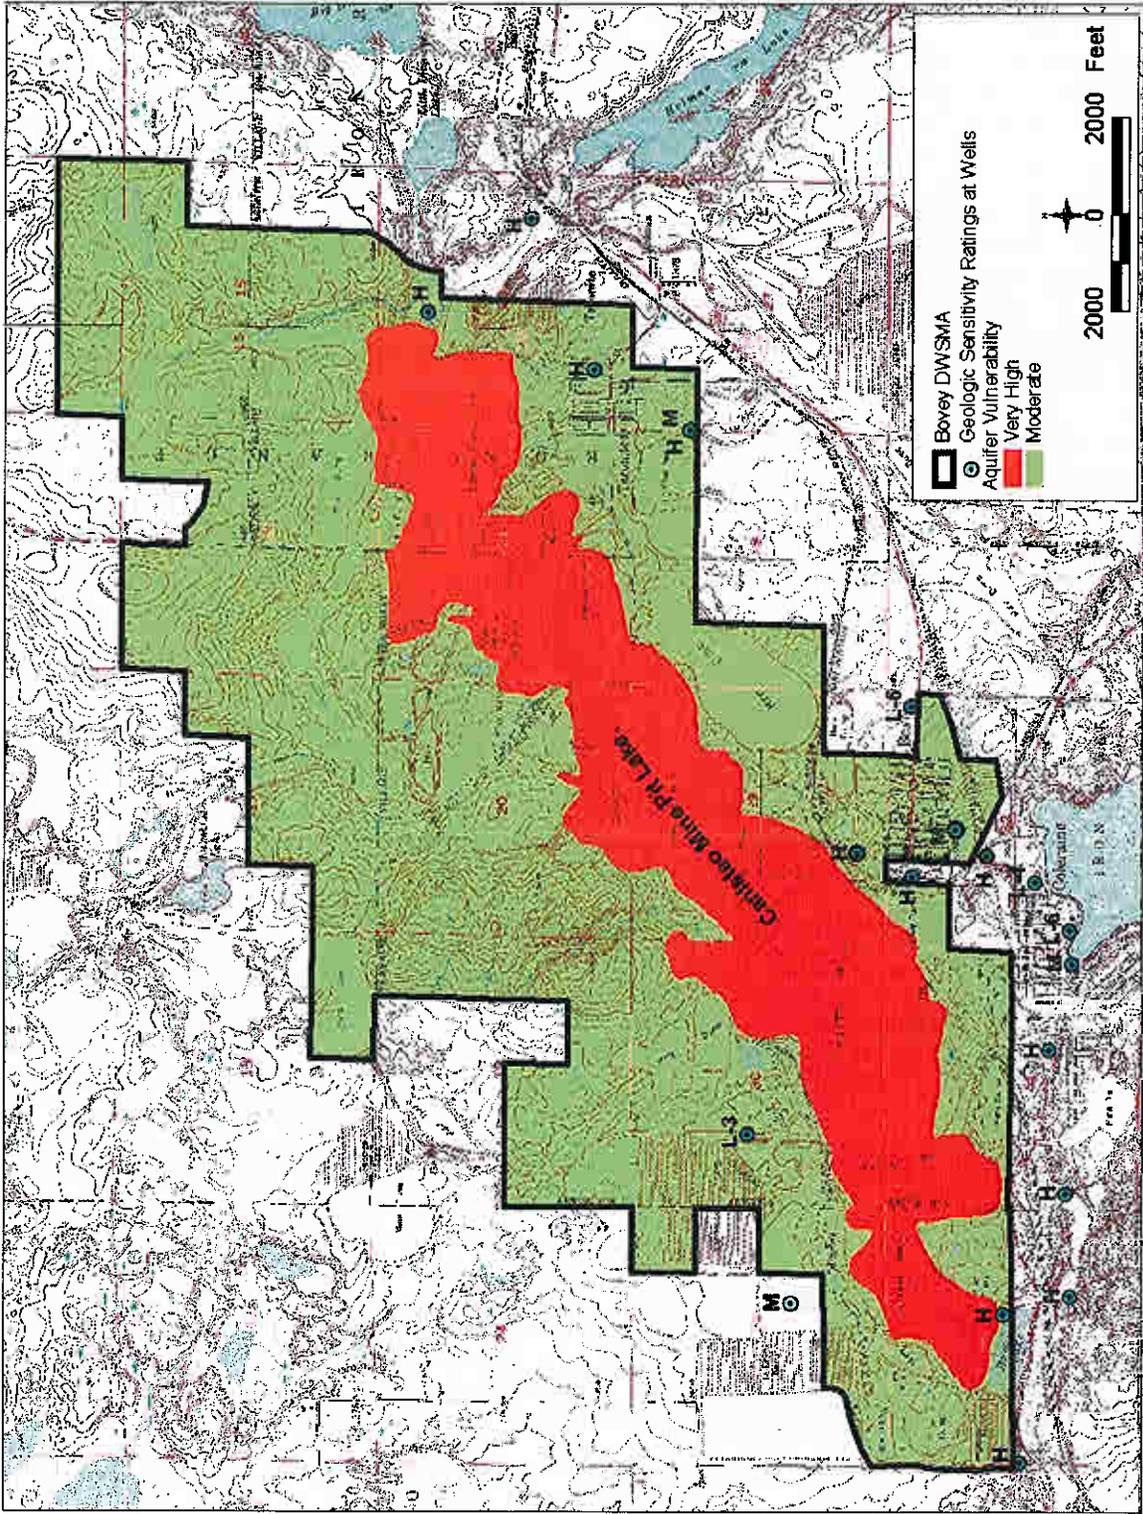


Figure 13. Vulnerability of the aquifer used by the city of Bovey throughout the DWSMA.

Appendix III

Method Used to Estimate Transmissivity from Specific Capacity

Method Used to Estimate Transmissivity

The method used to estimate transmissivity from specific capacity data is similar to that of Bradbury and Rothschild, 1985, and Mace (2000) but with some differences. The method is described in some detail here.

Starting with a rearrangement of Sternberg's (1973) equation that relates specific capacity (S_c) to transmissivity (T), the duration of pumping (t) the well radius (r_w) and storativity (S) for a partially penetrating well:

$$S_c = \frac{4 \pi T}{\left[\ln \left(\frac{2.25 T t}{r_w^2 S} \right) + 2 s_p \right]} \quad 1$$

where s_p is the partial penetration factor defined base on the physical properties of the well and aquifer, L is the length of the screen portion of the aquifer and H is the aquifer thickness Brons and Marting (1961):

$$s_p = \frac{1 - (L/H)}{(L/H)} \left[\ln \left(\frac{H}{r_w} \right) - G(L/H) \right] \quad 2$$

Where the function G is approximated by Bradbury and Rothschild (1985) using the following polynomial with 0.992 correlation coefficient:

$$G(L/H) = 2.948 - 7.363(L/H) + 11.447(L/H)^2 - 4.675(L/H)^3 \quad 3$$

Rearranging Equation 1 to solve for transmissivity and substituting for S_c in terms of the discharge of the well (Q) and the observed draw down at time t (s), $S_c = Q/s$:

$$T = \frac{Q}{4 \pi s} \left[\ln \left(\frac{2.25 T t}{r_w^2 S} \right) \right] + \frac{Q s_p}{2 \pi s} \quad 4$$

The second term in Equation 4 was solved directly from the draw down, discharge, well construction, and aquifer thickness information. The first term was solved iteratively with assumed values of storativity for confined (0.001) and unconfined (0.075) conditions.

References:

- Bradbury, K.R., and Rothschild, E.R. (1985), *A computerized technique for estimating the hydraulic conductivity of aquifers from specific capacity data*, Ground Water, Vol. 23, No. 2, p. 240-246.
- Brons, F., and Marting, V.E. (1961), *The effect of restricted fluid entry on well productivity*, Journal of Petroleum Technology, Vol. 13, No. 2, p. 172-174.
- Sternberg, Y.M. (1973), *Efficiency of partially penetrating wells*, Ground Water, Vol. 11, No. 3, p. 5-7.