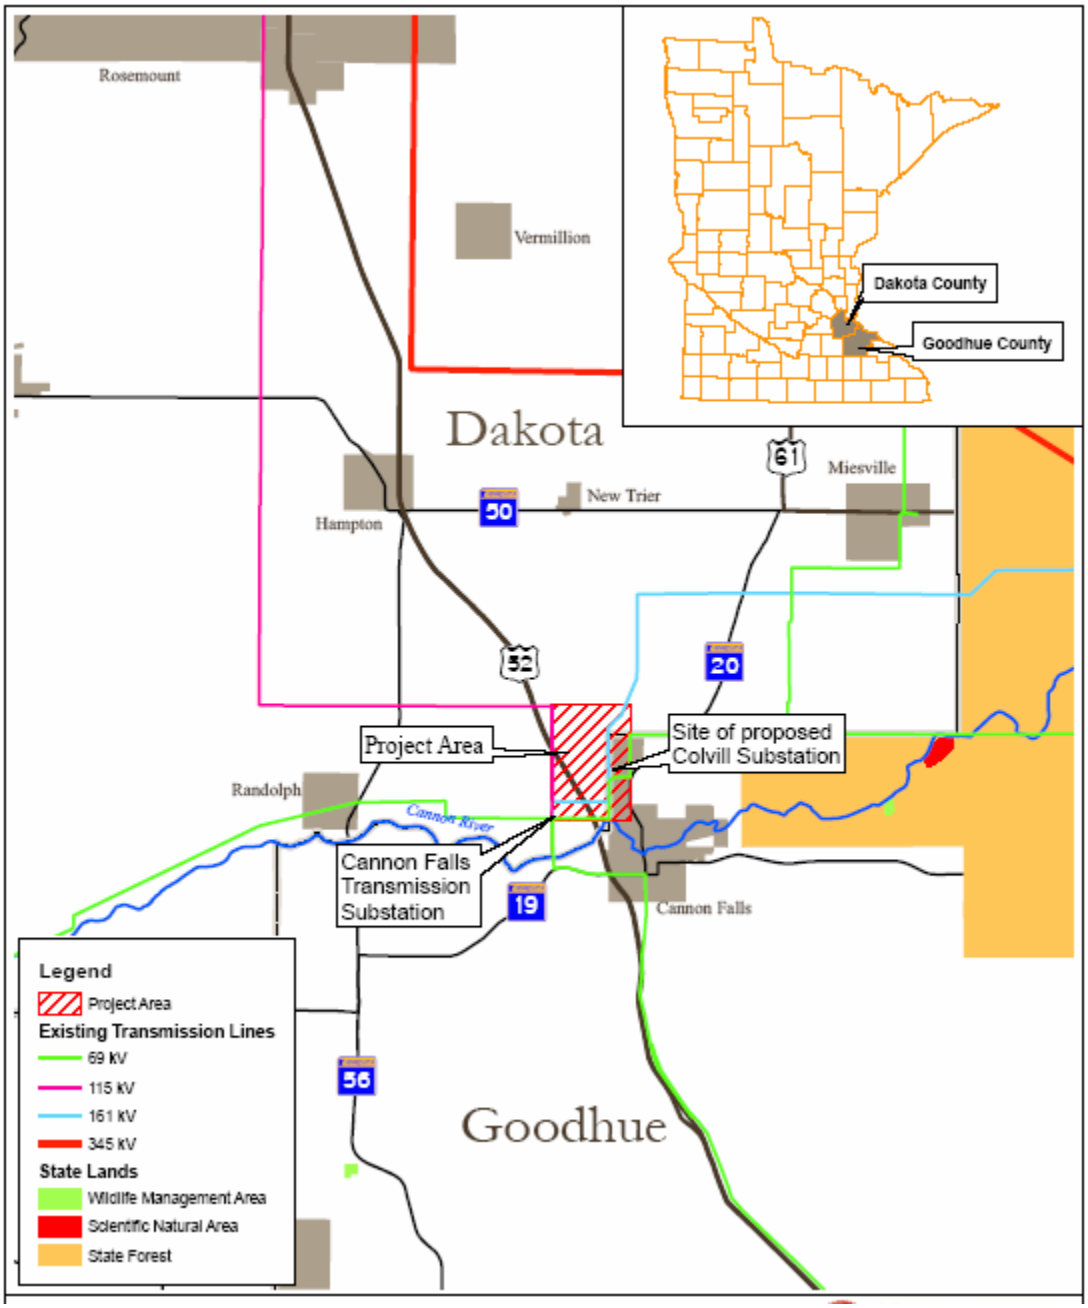

FIGURE 1 SITE LOCATION MAP

FIGURE 2 ROW REQUIREMENTS ADJACENT to ROADWAYS

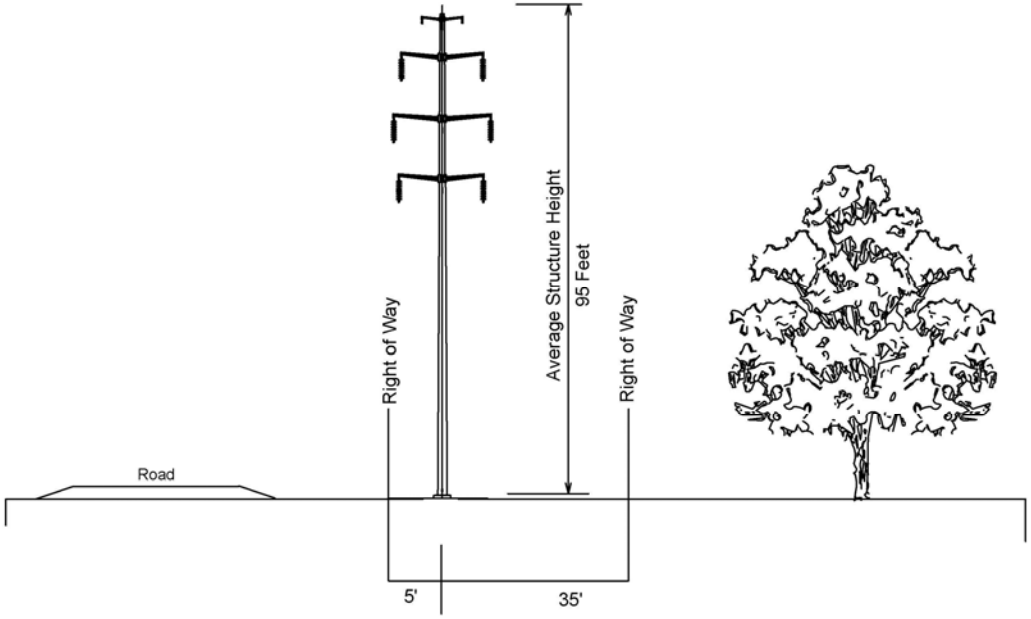

Xcel Energy 115 kV/115 kV Double Circuit Davit Arm Structure
Right-of-Way Requirements
Adjacent to a Road Right of Way

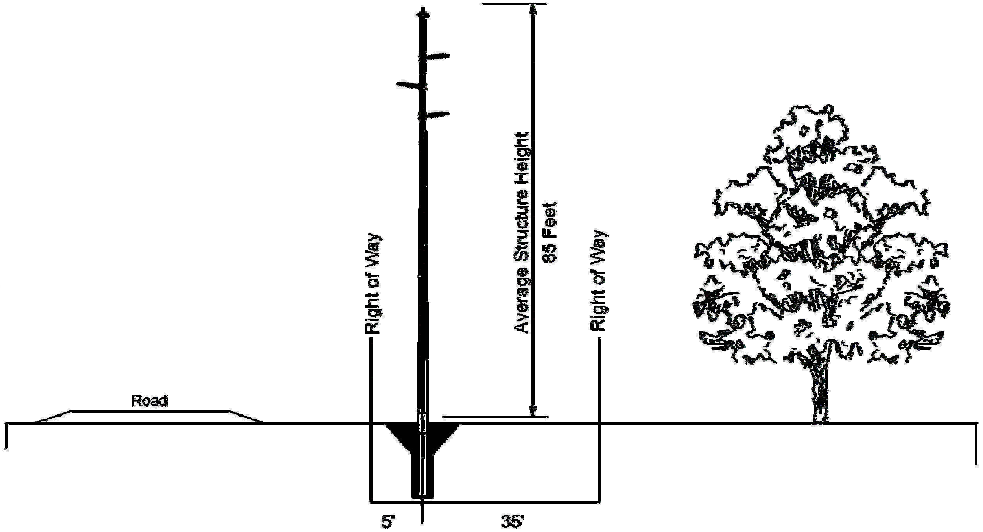

Xcel Energy 115 kV Single Circuit Horizontal Line Post Structure
Right-of-Way Requirements
Adjacent to a Road Right of Way

FIGURE 3 ROW REQUIREMENTS CROSS COUNTRY

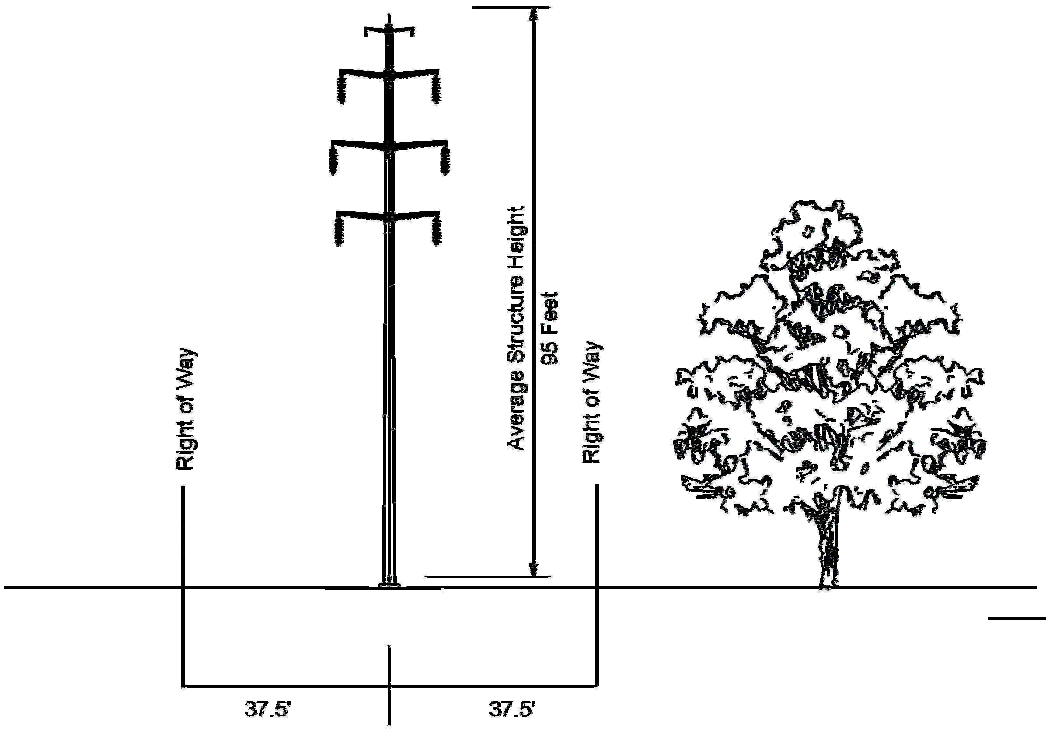

Xcel Energy 115 kV/115 kV Double Circuit Davit Arm Structure
Right-of-Way Requirements
Cross-Country

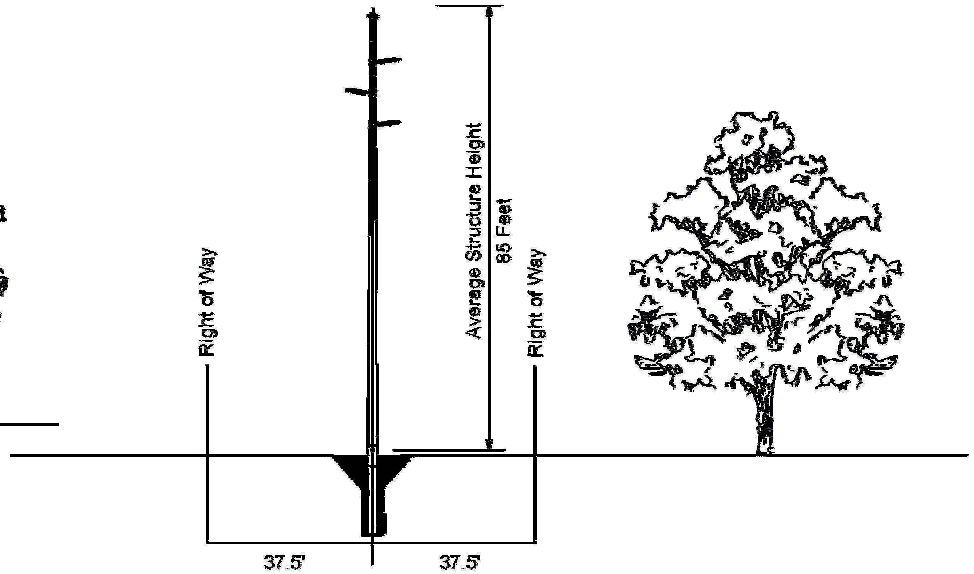

Xcel Energy 115 kV Single Circuit Horizontal Line Post Structure
Right-of-Way Requirements
Cross-Country