



FIGURE 1 SITE LOCATION MAP

FIGURE 2 ROW REQUIREMENTS ADJACENT to ROADWAYS

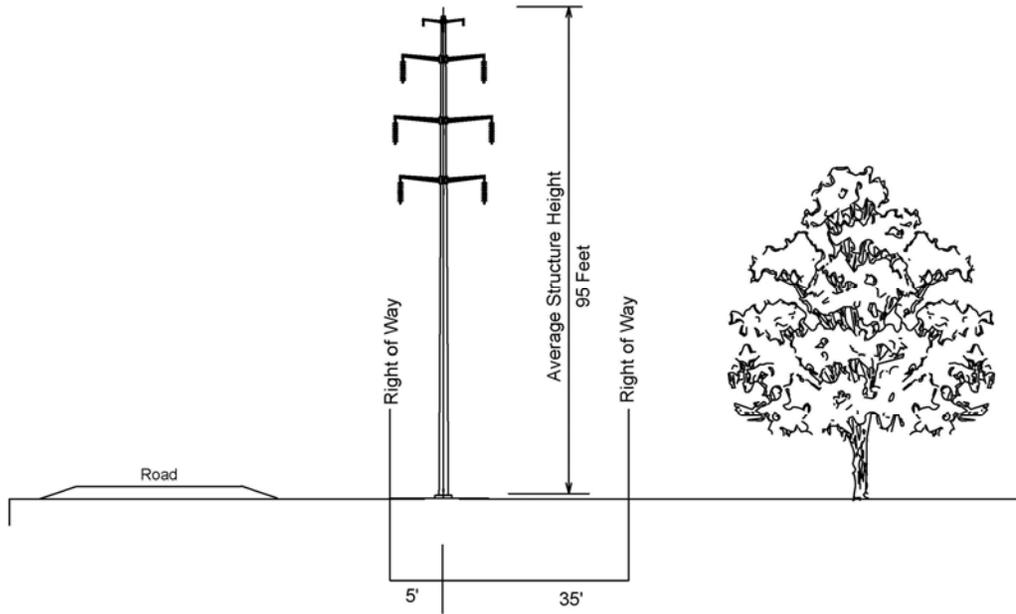


**Xcel Energy 115 kV/115 kV Double Circuit Davit Arm Structure
Right-of-Way Requirements
Adjacent to a Road Right of Way**

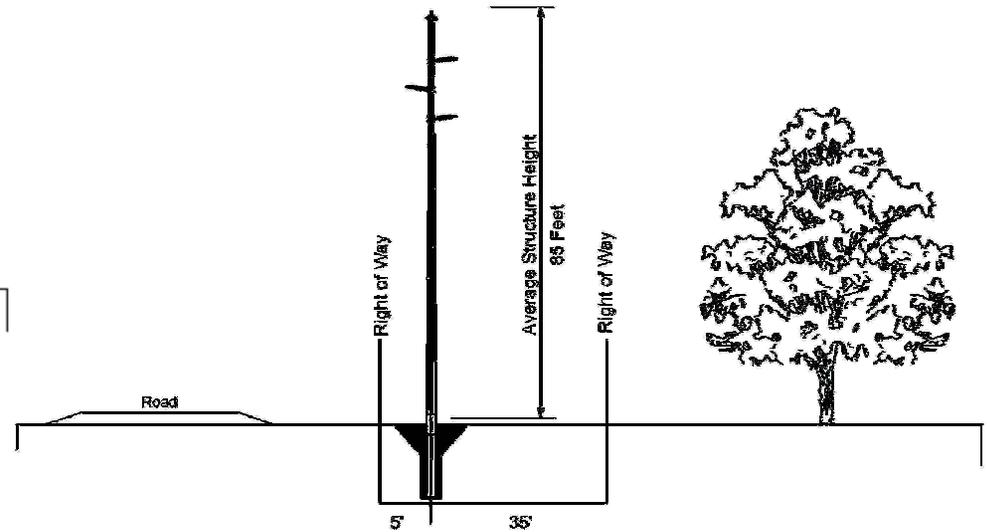


**Xcel Energy 115 kV Single Circuit Horizontal Line Post Structure
Right-of-Way Requirements
Adjacent to a Road Right of Way**

FIGURE 3 ROW REQUIREMENTS CROSS COUNTRY

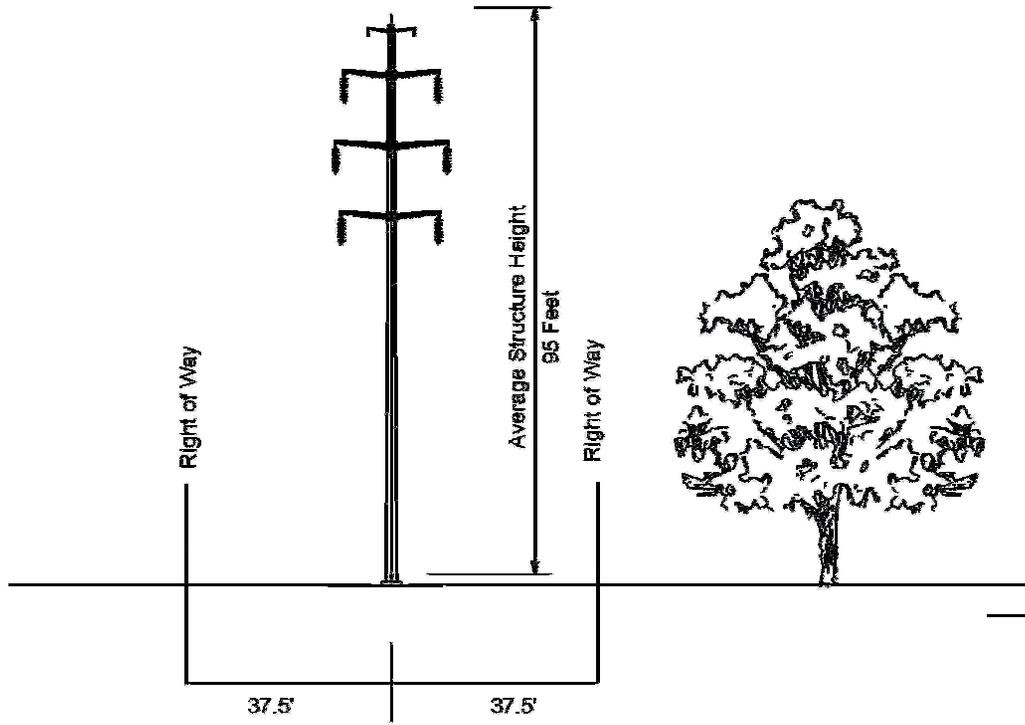

**Xcel Energy 115 kV/115 kV Double Circuit Davit Arm Structure
Right-of-Way Requirements
Cross-Country**

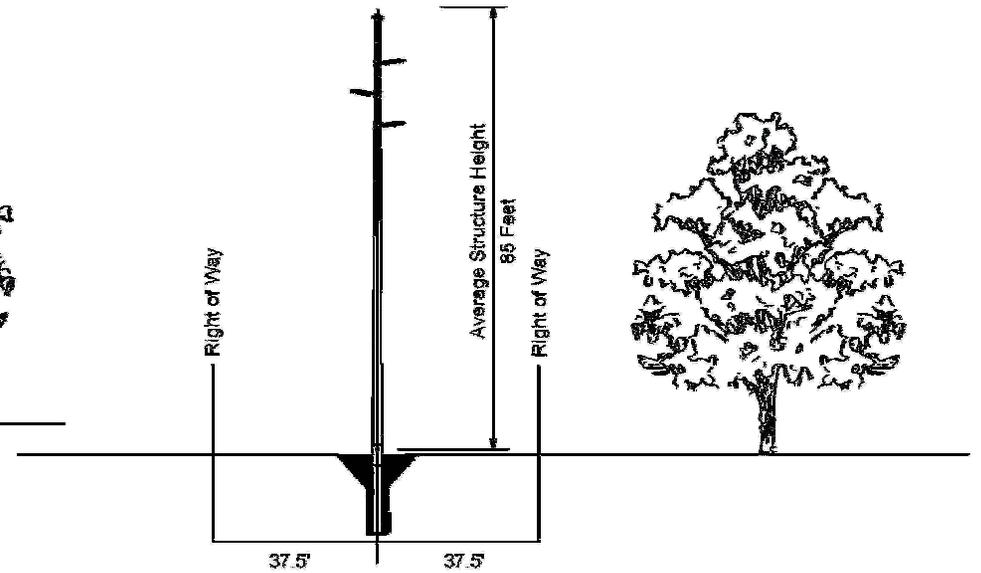

**Xcel Energy 115 kV Single Circuit Horizontal Line Post Structure
Right-of-Way Requirements
Cross-Country**

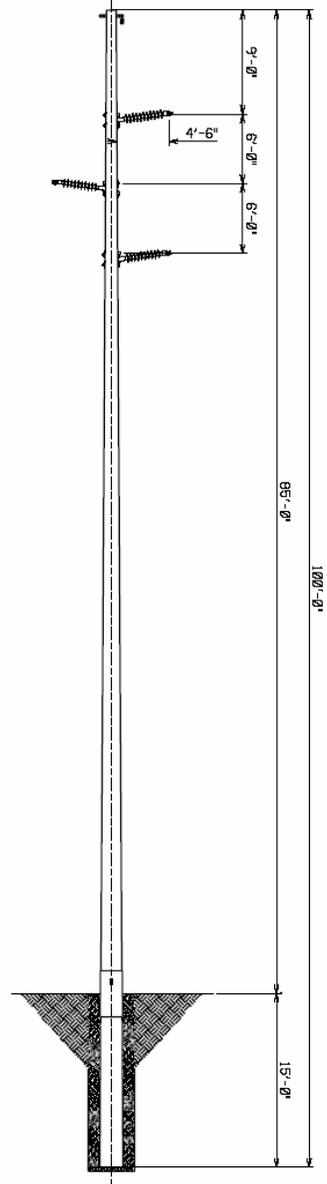


FIGURE 4 115 kV SINGLE-CIRCUIT STRUCTURE

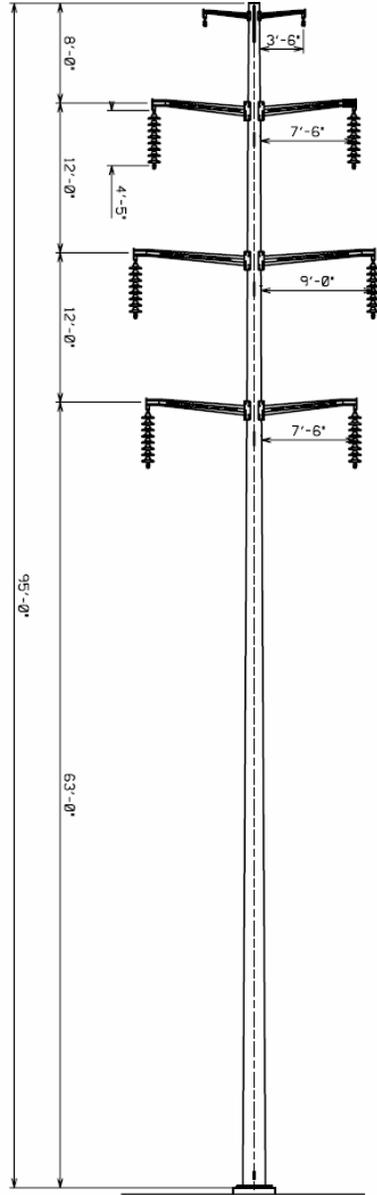


FIGURE 5 115 kV/115 kV DOUBLE-CIRCUIT STRUCTURE

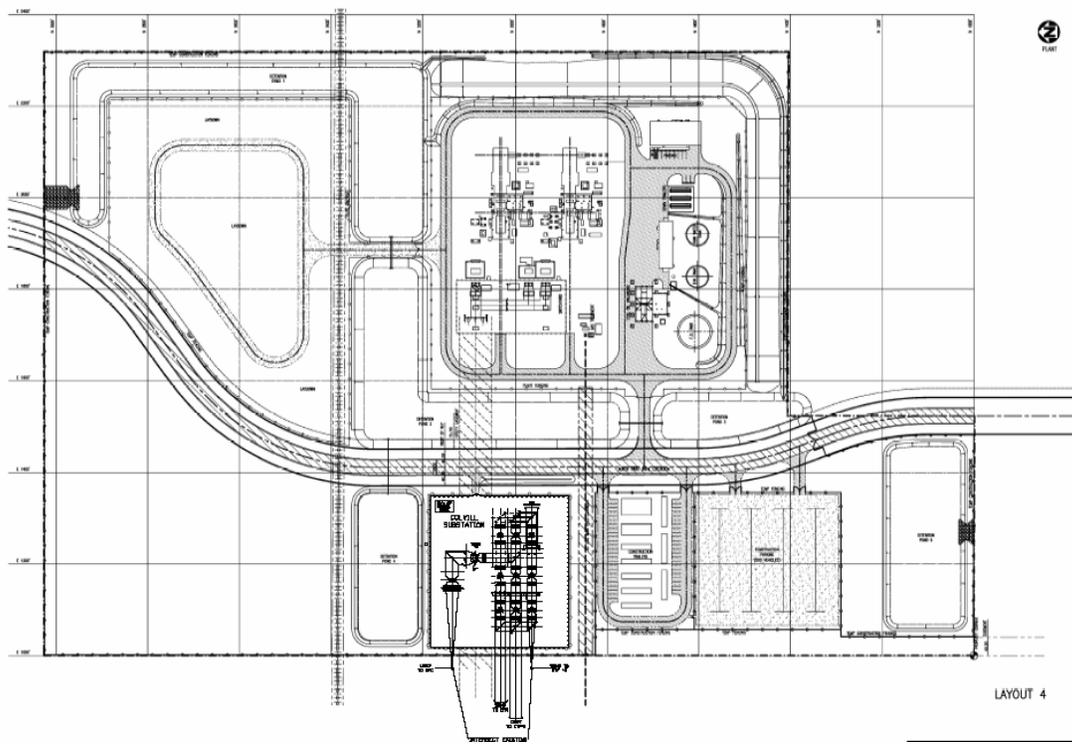


FIGURE 6 SUBSTATION LOCATION/LAYOUT

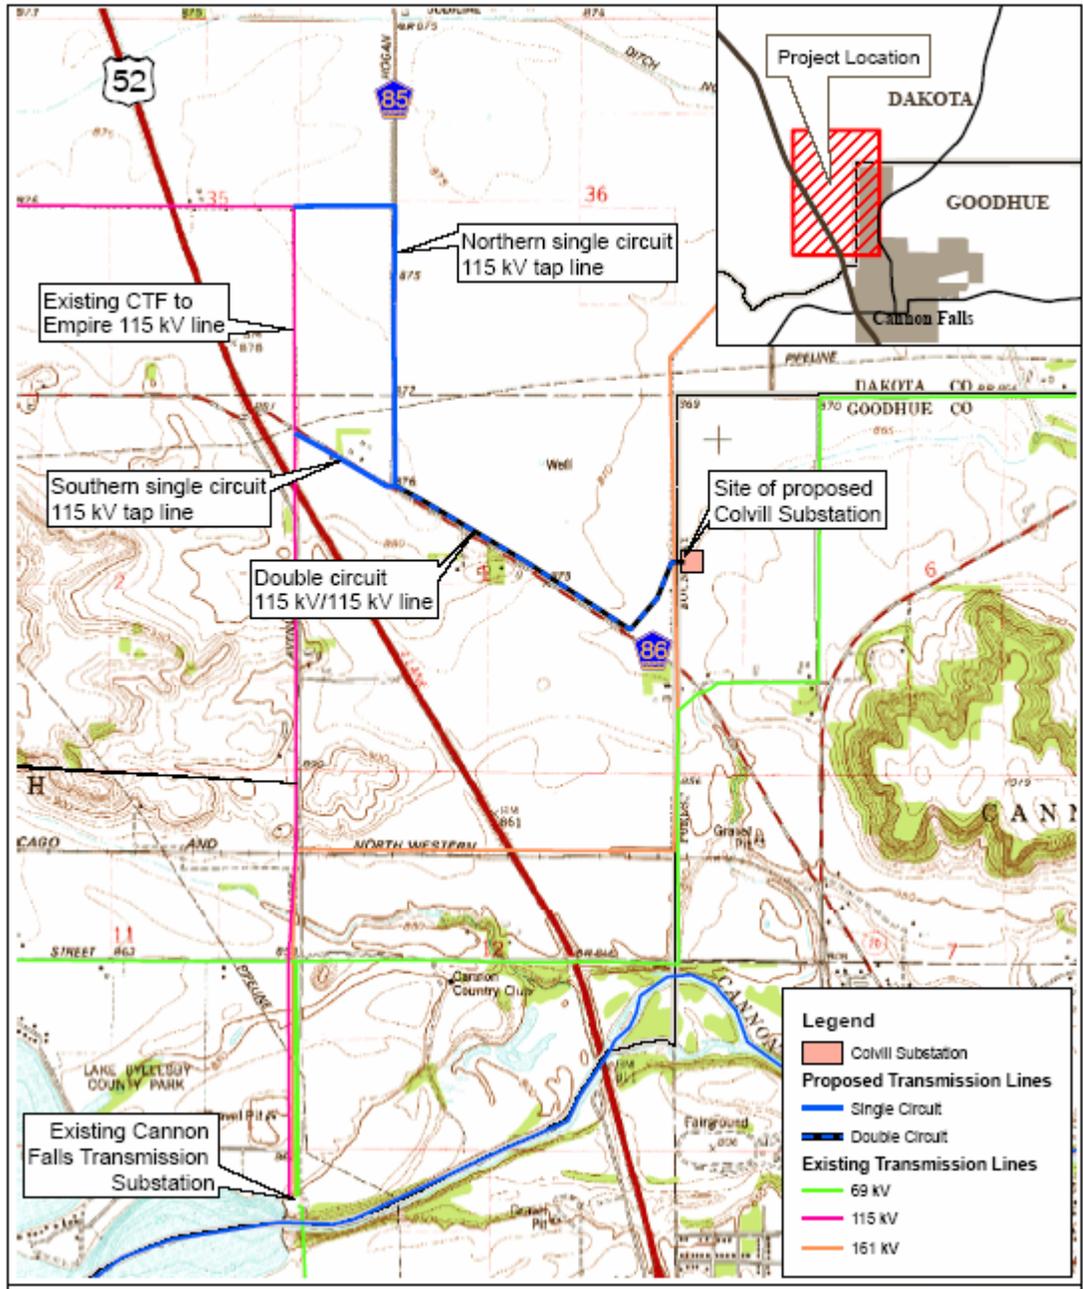


FIGURE 7 DETAILED SITE LOCATION MAP

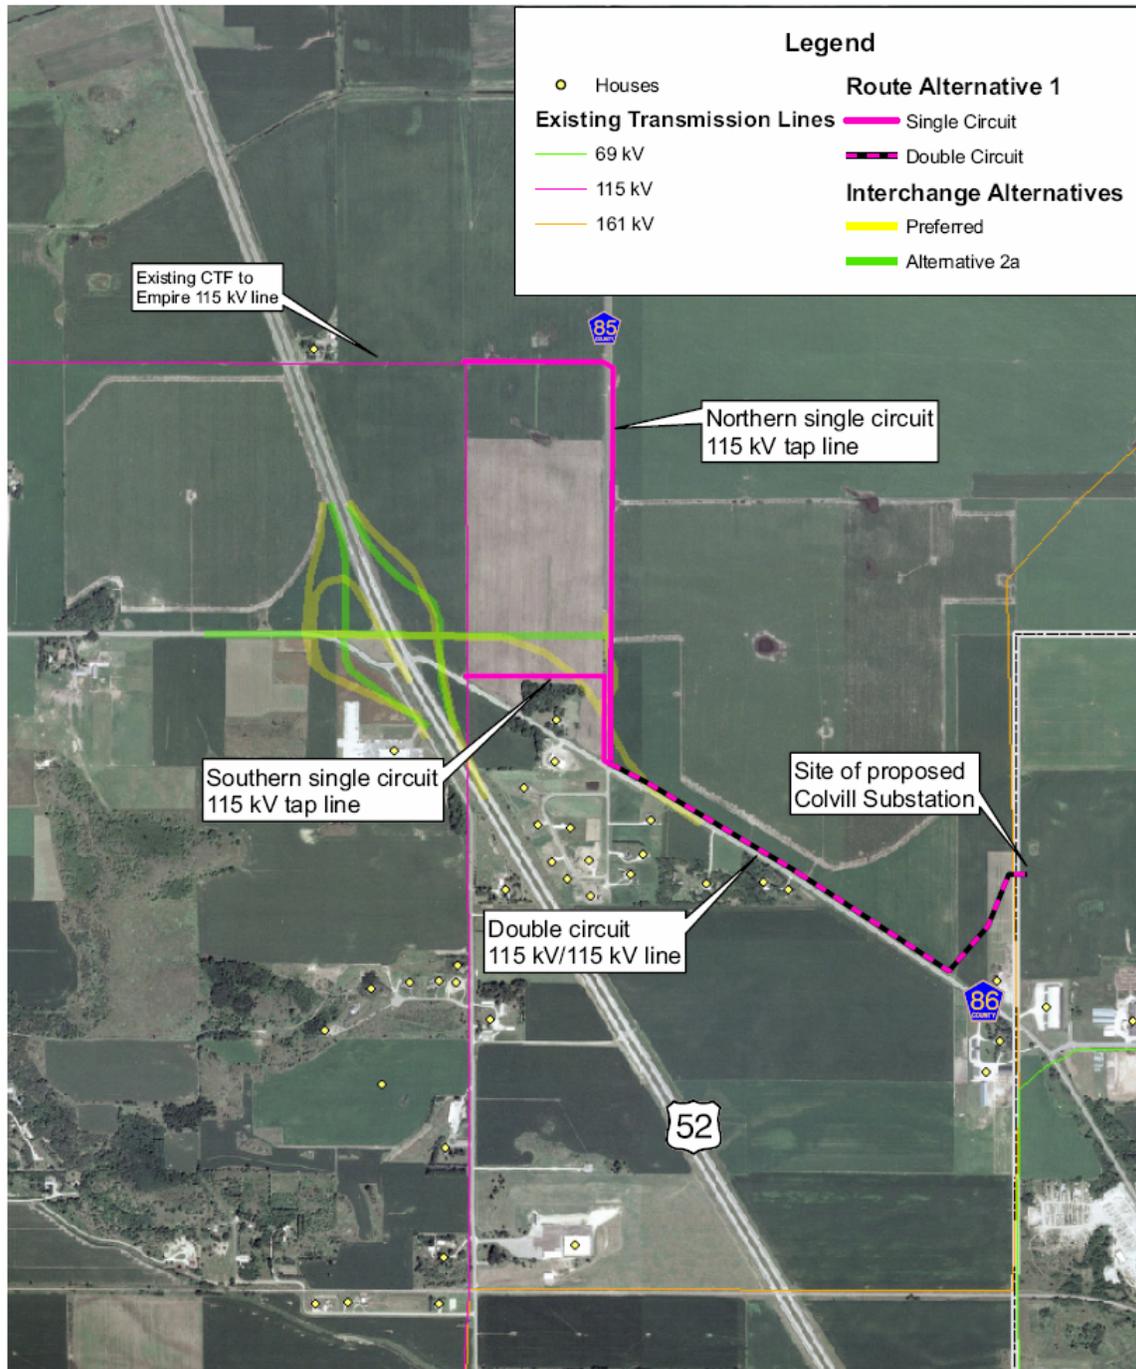


FIGURE 8 HVTL ALTERNATIVE 1

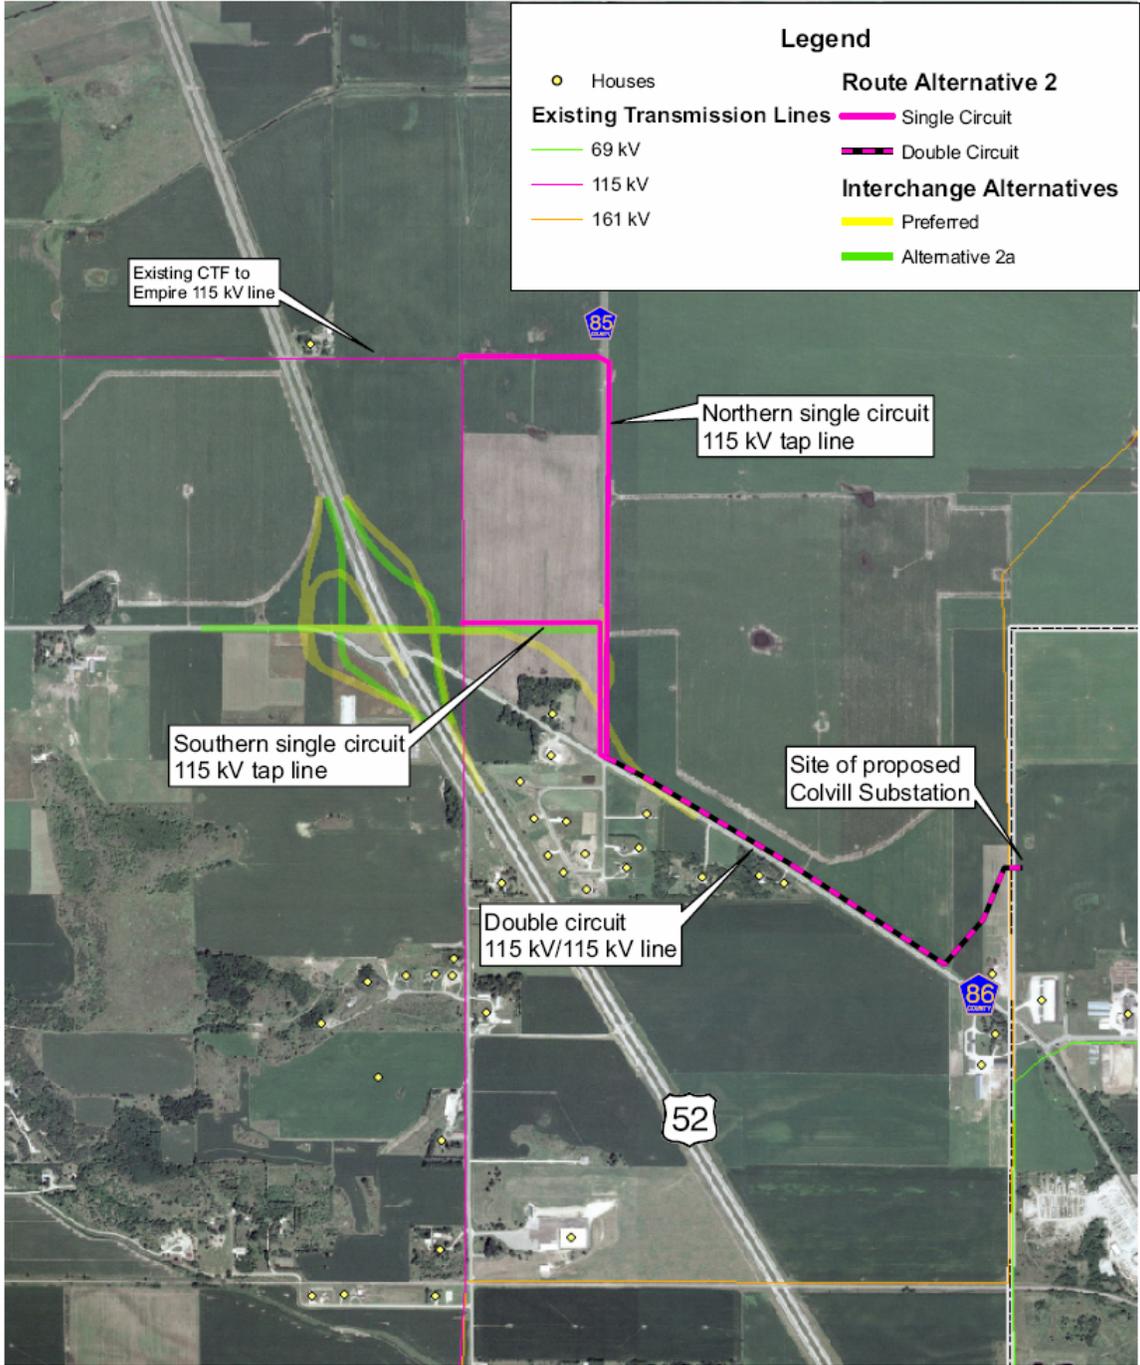


FIGURE 9 HVTL ALTERNATIVE 2