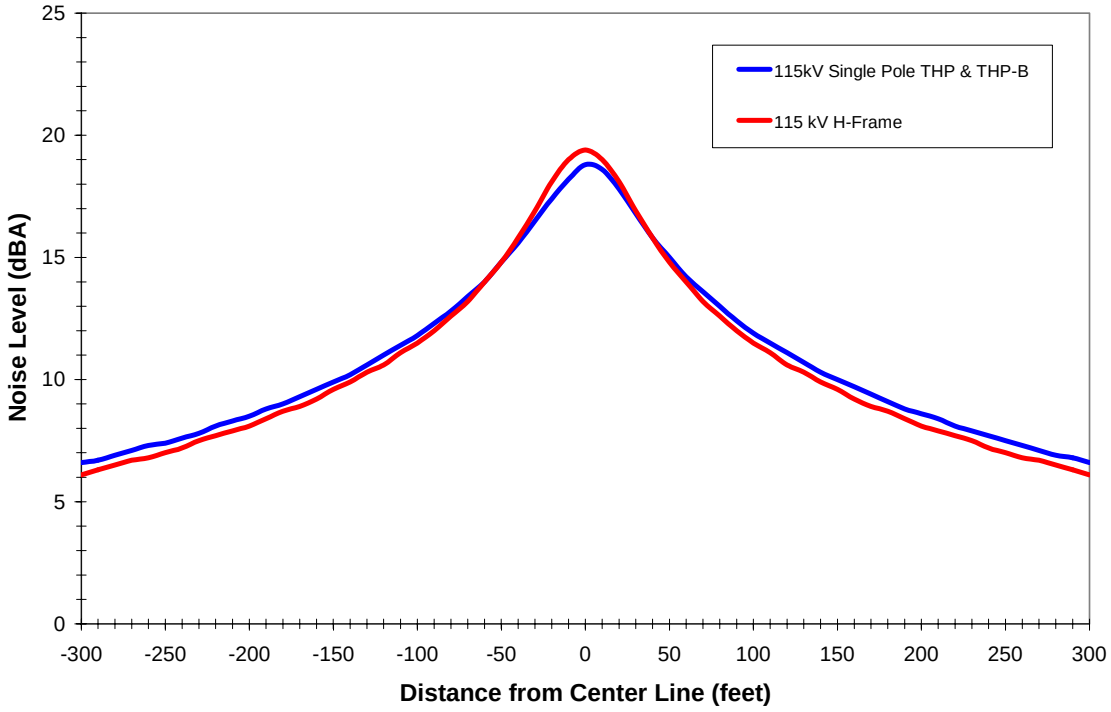

FIGURE 4-1 Expected Audible Noise: Tower 115 kV L_5 Wet Conductor

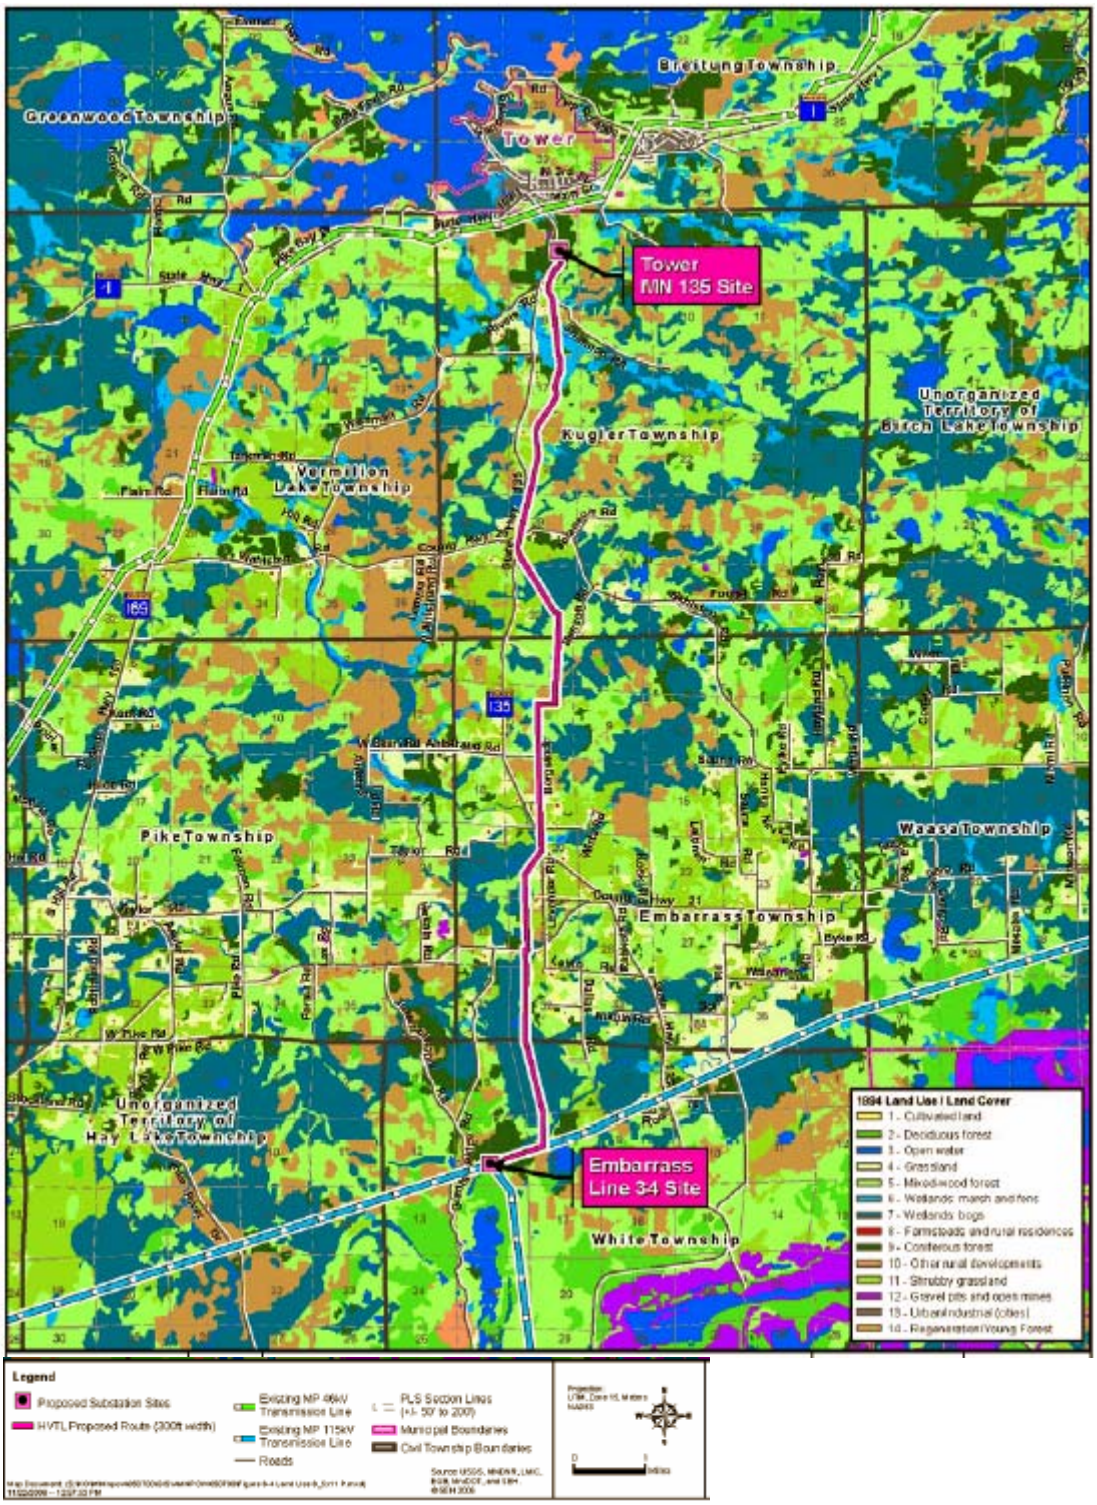

FIGURE 4-2 Land Use/Land Cover

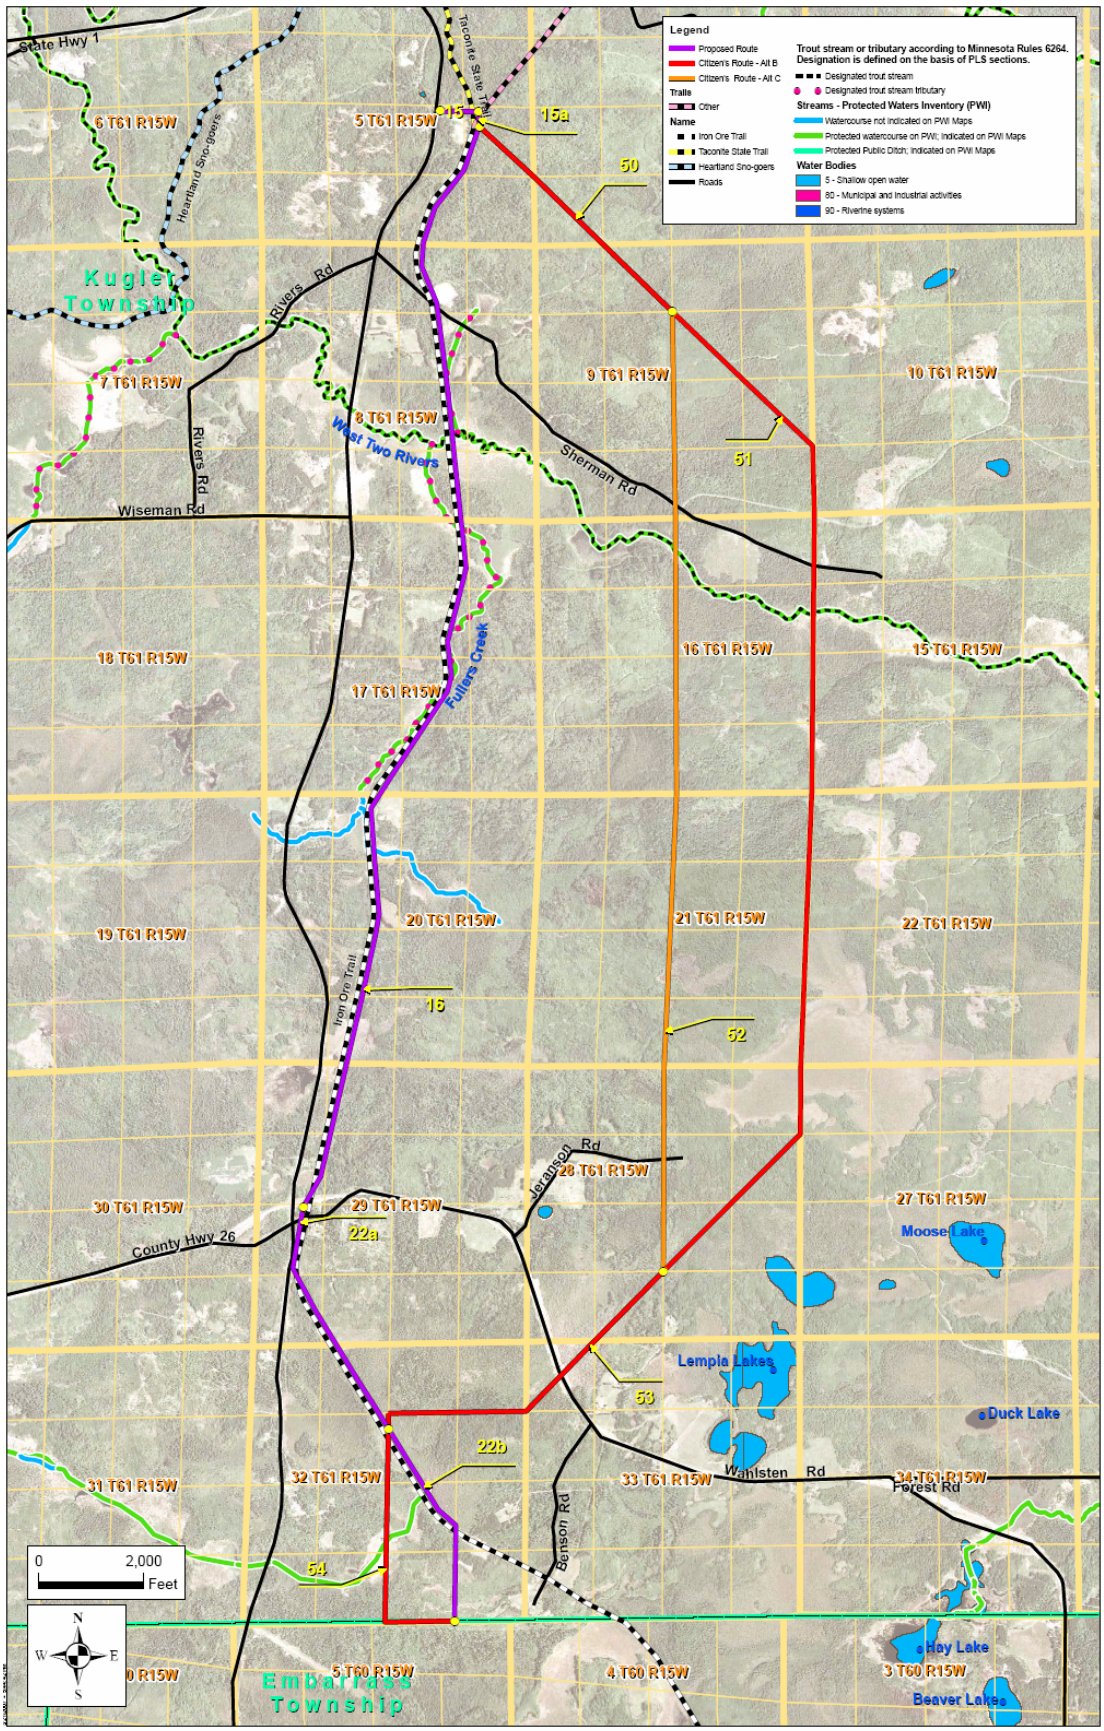

FIGURE 4-3 Fuller Creek & Two West Rivers

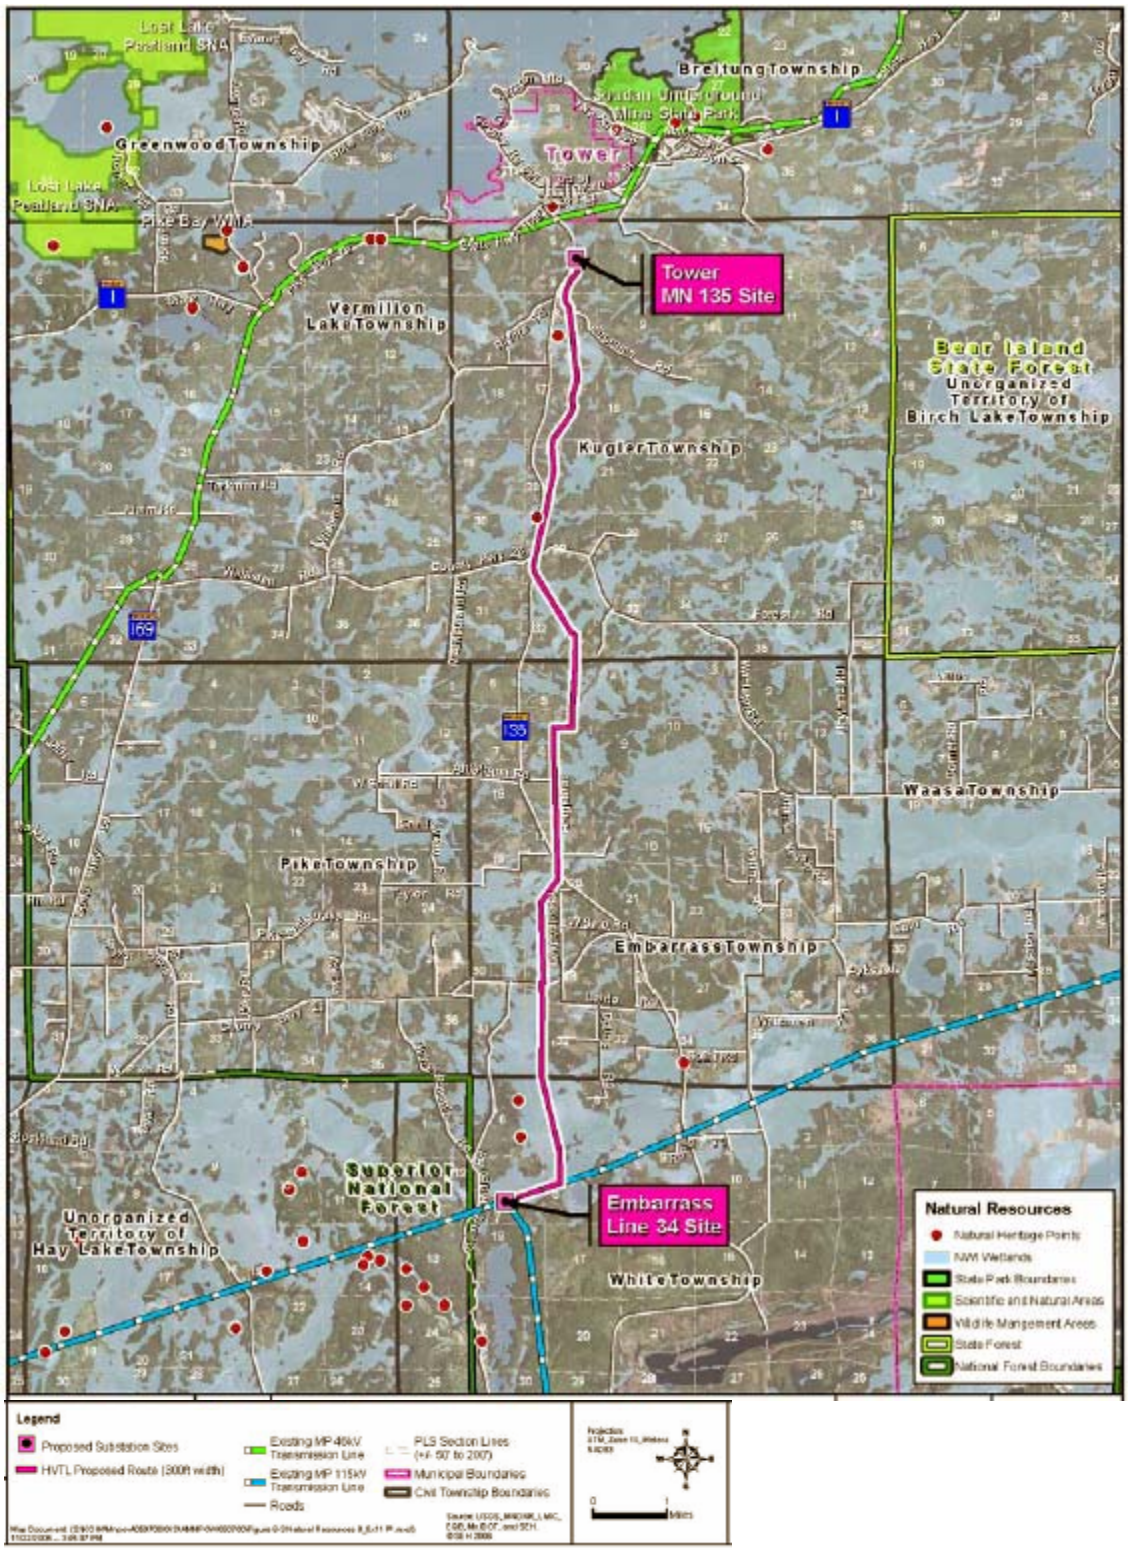

FIGURE 4-4 Sensitive Natural Resources

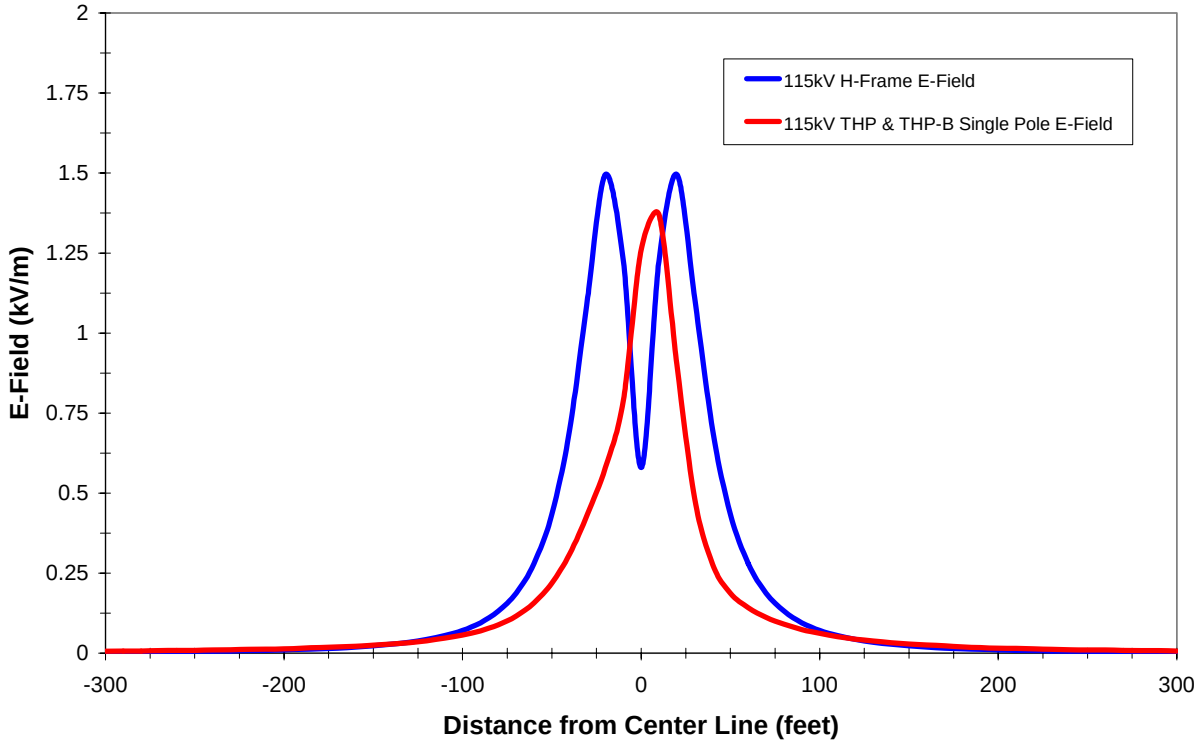

Figure 4-5 Electric Field – Proposed 115 kV Structures

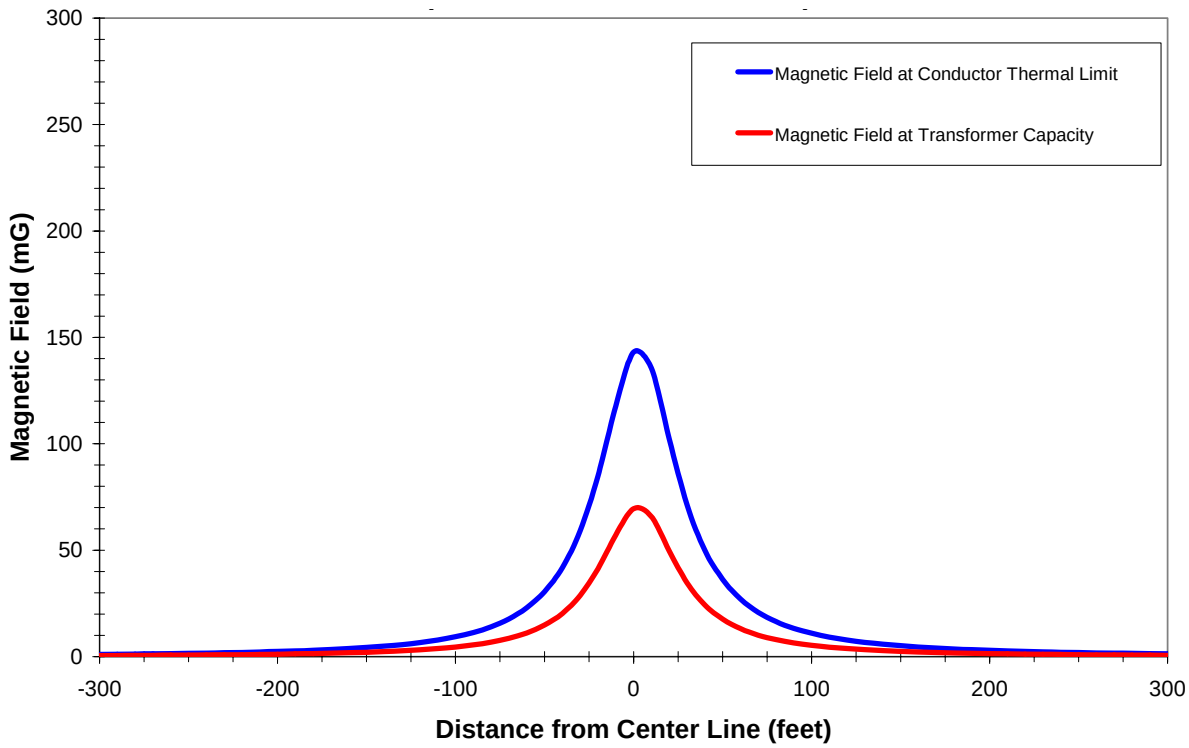

Figure 4-6 Magnetic Field – Proposed 115 kV Line with Single Pole THP and THP-B Structure

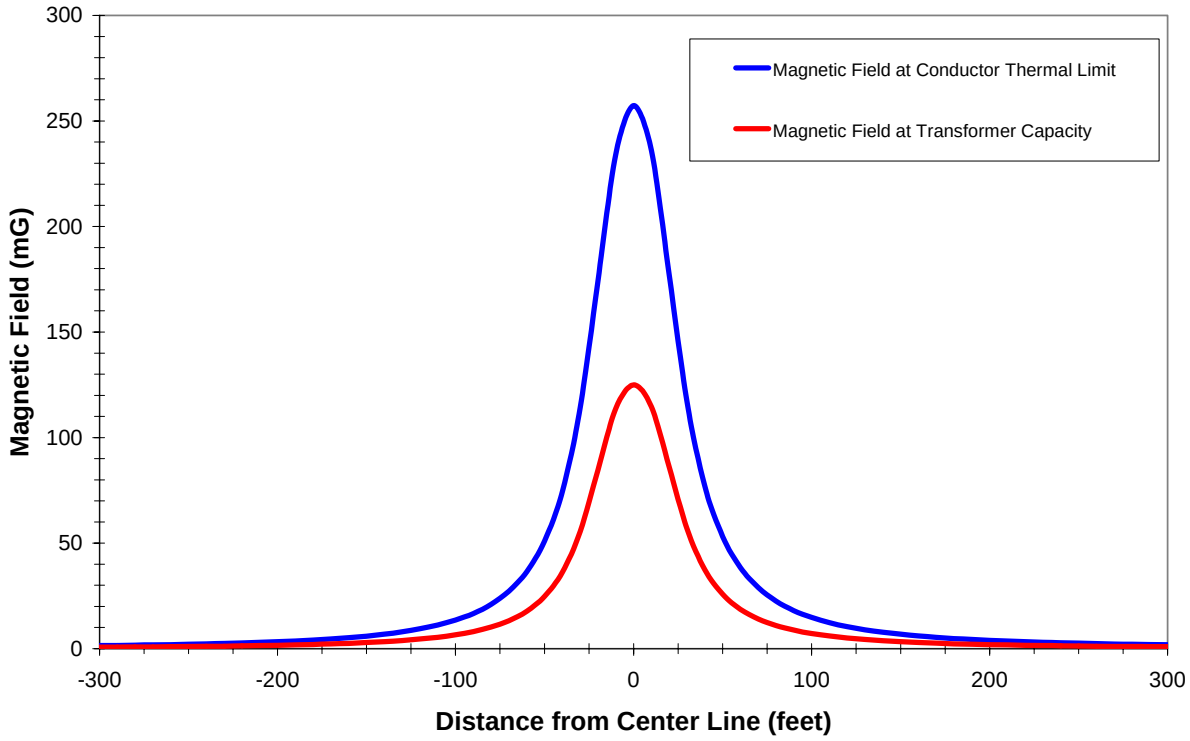

Figure 4-7 Magnetic Field – Proposed 115 kV Line with H-Frame Structure