Figure 4 Proposed Substation Layout

PROPOSED
ZEMPLE 230/115/23 kV
SUBSTATION

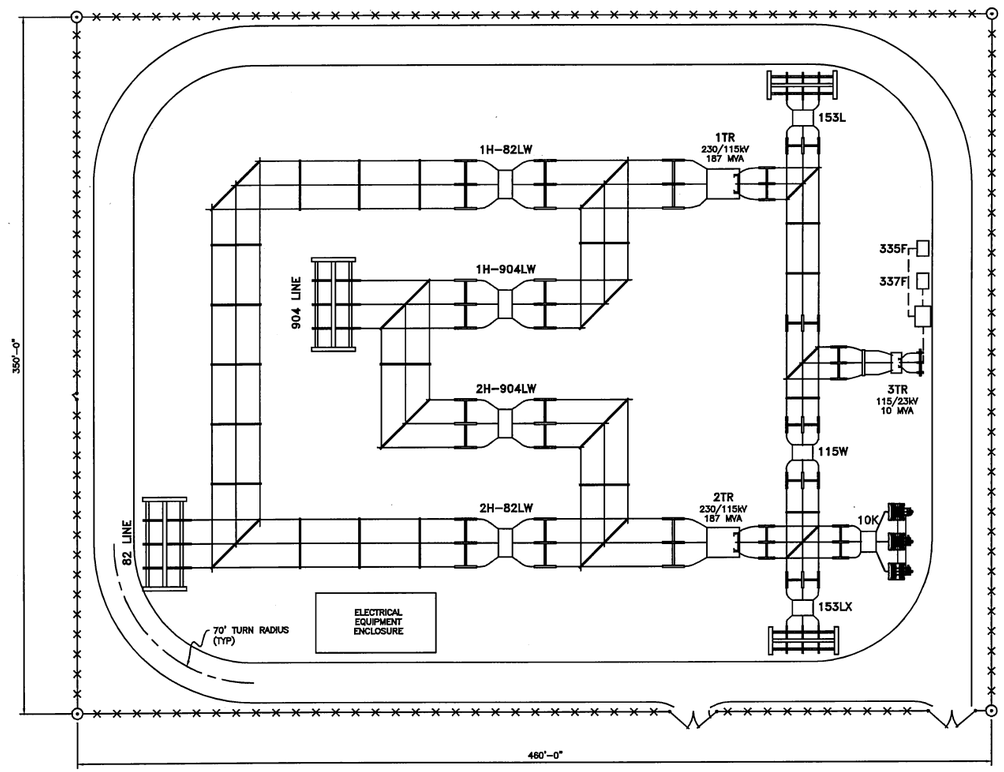

NO.	DATE	REVISION DESCRIPTION	BY	APPROVED	NO.	DATE	REVISION DESCRIPTION	BY	APPROVED
A	8-17-12	INITIAL DRAFT	LAG	.	D	11-13-12	MOVED SUBSTATION WEST AND NORTH	LAG	.
B	9-4-12	ROTATED SUB 90 DEGREES	LAG	.	E	3-28-13	ADDED 115kV TIE BREAKER AND 23kV FEEDER RECLOSERS	LAG	.
C	10-23-12	ROTATED SUB BACK 90 DEGREES, CHANGED 115kV TIE BREAKER TO TIE SW	LAG	.	F	4-2-13	ADDED SWITCH	AJW	.

DRAWN BY	LAG
APPROVED	.
DATE	8-14-12
SCALE	1" = 30'-0"

ZEMPLE 230/115/23kV SUBSTATION
PROPOSED
GENERAL ARRANGEMENT

SHEET 1 REV. F

ME-30201-04

CADD DRAWING - FOR REPRODUCTION ONLY

MICROFILMED / /

CODE . . .

ImageSite: .