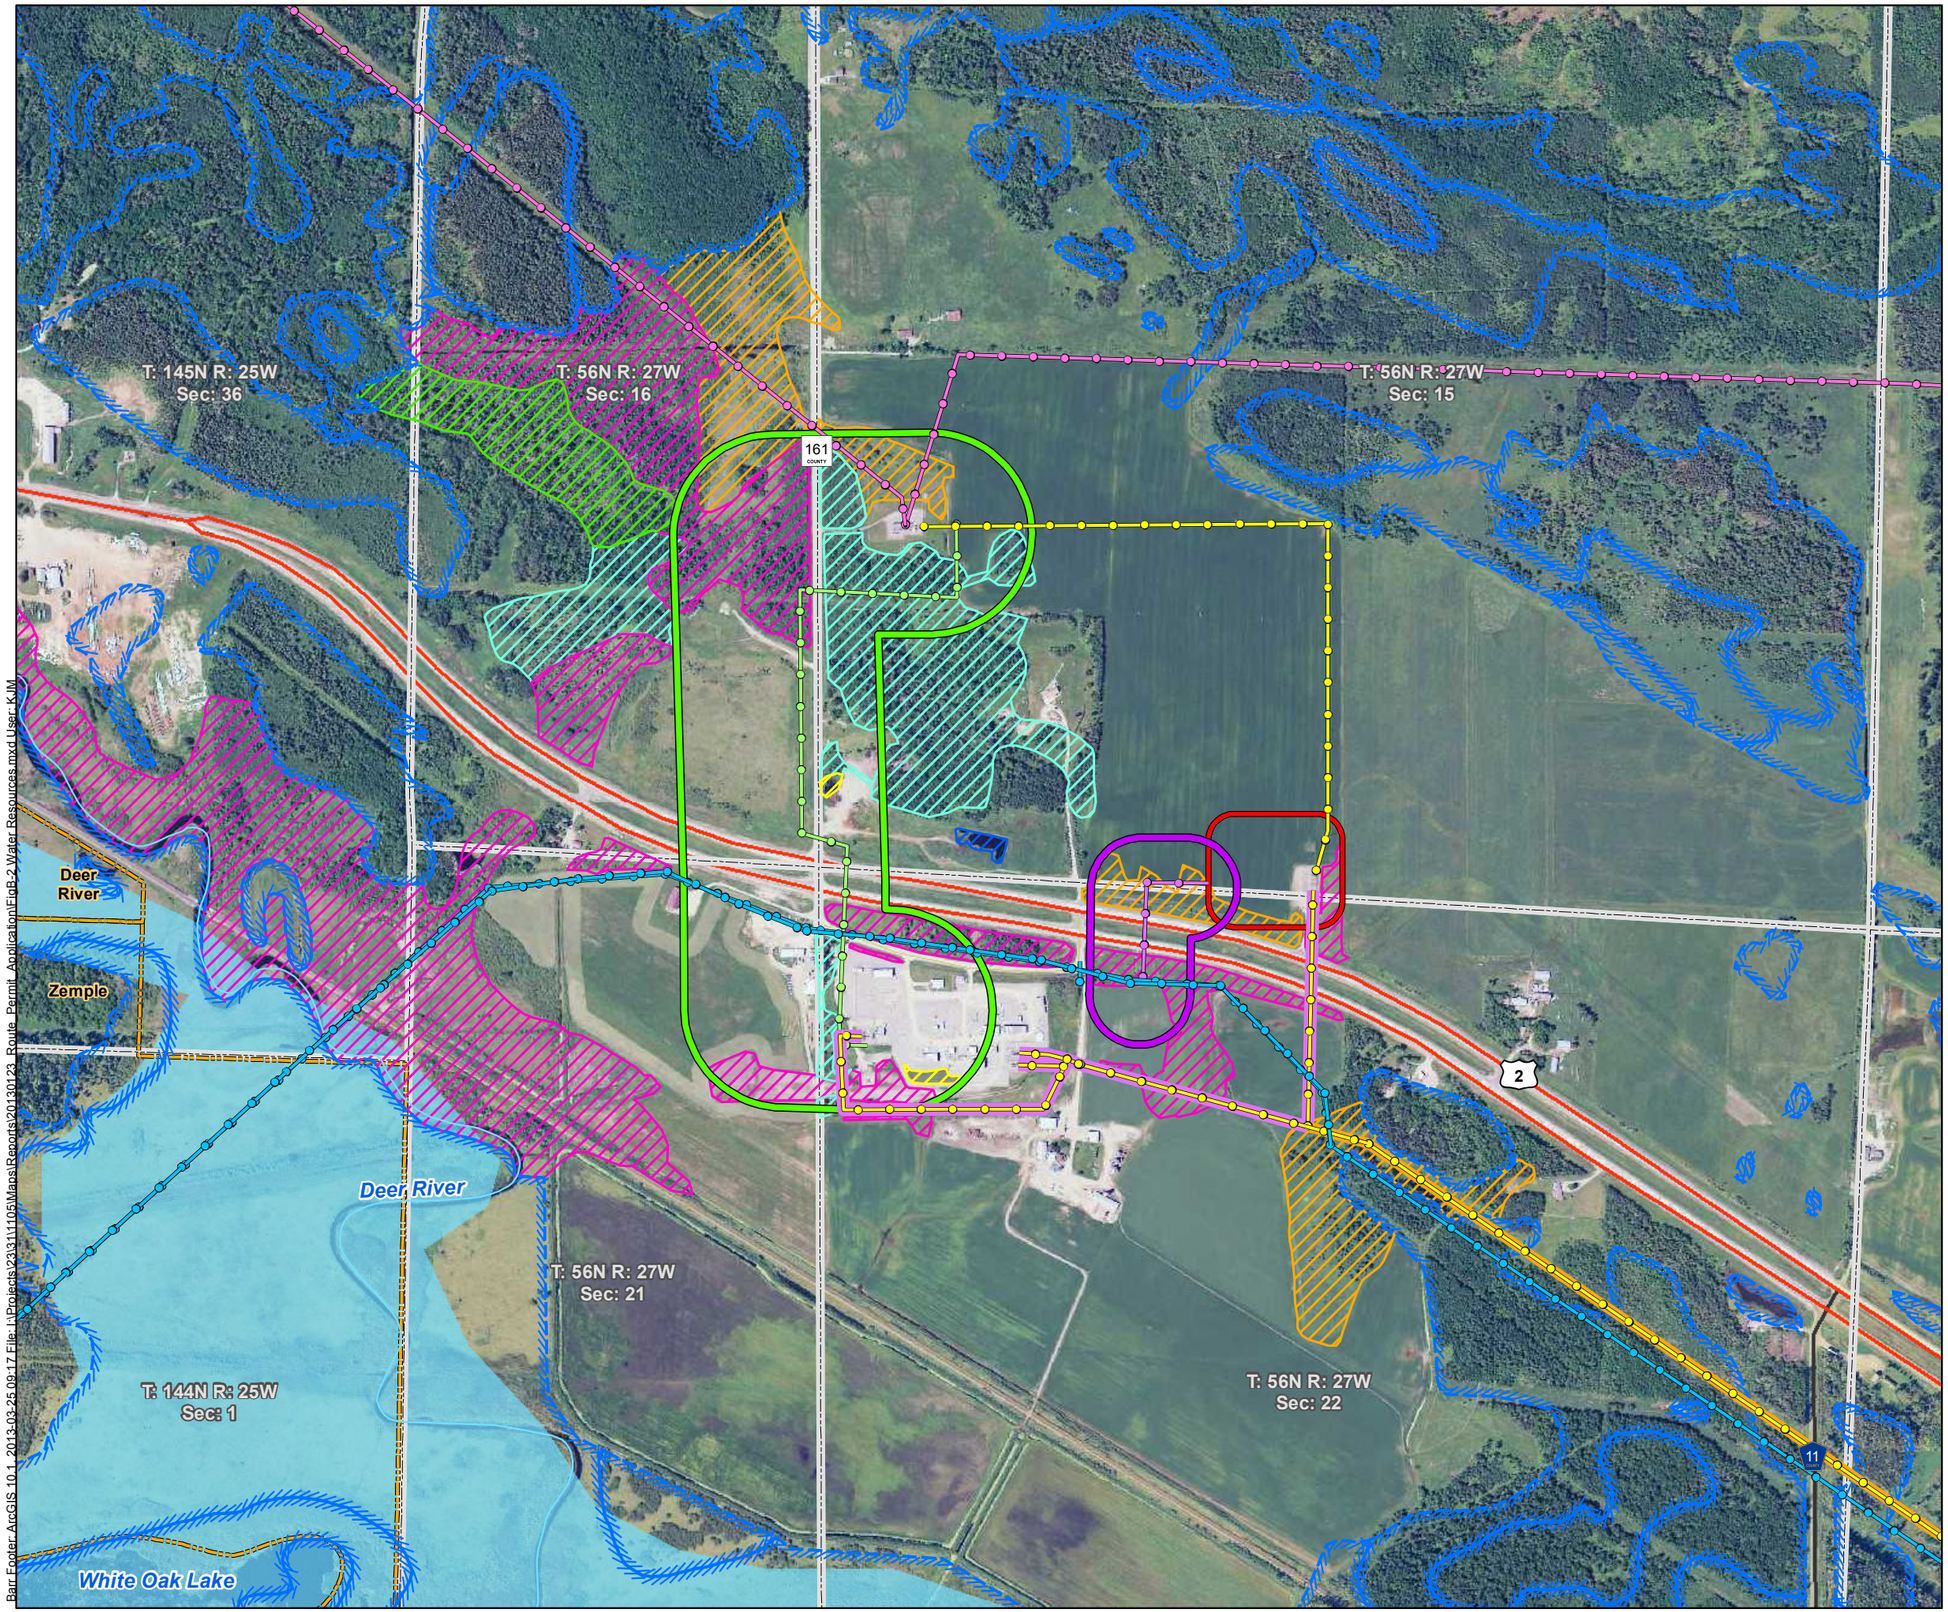

Existing 115kV Line

Existing 69kV Line

CapX2020 230kV Line

115 kV HVTL Proposed for Removal

Proposed 115 kV Rebuild

Proposed 115kV Alignment

Proposed 115 kV HVTL Route

Proposed 230kV Alignment

Proposed 230 kV HVTL Route

Proposed Substation Location

PWI Watercourse

PWI Basin

PLS Section

Municipal Boundary

NWI Wetland

Barr Wetland Determination

Eggers & Reed Wetland Types

Coniferous Swamp

Hardwood Swamp

Sedge/Wet Meadow

Shallow Marsh

Shallow, Open Water

Shrub Swamp

Image Source: 2010 Farm Service Agency

0 375 750 1,500 Feet

Figure 7 Proposed HVTL and Substation Map

WATER RESOURCES
Proposed 115 kV, 230 kV
HVTL and Substation
Minnesota Power
Itasca County, MN

Barr Footer: ArcGIS 10.1, 2013-03-25 09:17 File: I:\Projects\23\31\11105\Maps\Reports\20130123_Route_Permit_Application\FigB-2 Water Resources.mxd User: KJM