

## **Appendix B**

### **Route Permit Generic Template and Example**

# ***GENERIC ROUTE PERMIT TEMPLATE***

## **STATE OF MINNESOTA PUBLIC UTILITIES COMMISSION**

### **ROUTE PERMIT FOR CONSTRUCTION OF A HIGH-VOLTAGE TRANSMISSION LINE AND ASSOCIATED FACILITIES**

**IN**

**[COUNTY]**

**ISSUED TO**

**[PERMITTEE]**

**PUC DOCKET NO. [Docket Number]**

In accordance with the requirements of Minnesota Statutes Chapter 216E and Minnesota Rules Chapter 7850, this route permit is hereby issued to:

**[PERMITTEE]**

**[Permittee]** is authorized by this route permit to construct **[Provide a description of the project authorized by the Minnesota Public Utilities Commission]**.

The transmission line and associated facilities shall be built within the route identified in this permit and as portrayed on the official route maps, and in compliance with the conditions specified in this permit.

Approved and adopted this \_\_\_\_ day of **[Month, Year]**

BY ORDER OF THE COMMISSION

---

Burl W. Haar,  
Executive Secretary

## CONTENTS

1.0	ROUTE PERMIT.....	1
2.0	PROJECT DESCRIPTION.....	1
2.1	Project Location.....	1
2.2	Associated Facilities and Substations.....	1
2.3	Structures and Conductors.....	1
3.0	DESIGNATED ROUTE.....	2
3.1	Right-of-Way.....	2
4.0	GENERAL CONDITIONS.....	2
4.1	Plan and Profile.....	3
4.2	Construction Practices.....	3
4.2.1	Field Representative.....	3
4.2.2	Local Governments.....	3
4.2.3	Cleanup.....	4
4.2.4	Noise.....	4
4.2.5	Vegetation Removal.....	4
4.2.6	Aesthetics.....	4
4.2.7	Erosion Control.....	5
4.2.8	Wetlands and Water Resources.....	5
4.2.9	Temporary Work Space.....	6
4.2.10	Restoration.....	6
4.2.11	Notice of Permit.....	6
4.3	Periodic Status Reports.....	7
4.4	Complaint Procedures.....	7
4.5	Notification to Landowners.....	7
4.6	Completion of Construction.....	7
4.6.1	Notification to Commission.....	7
4.6.2	As-Builts.....	7
4.6.3	GPS Data.....	7
4.7	Electrical Performance Standards.....	8
4.7.1	Grounding.....	8
4.7.2	Electric Field.....	8
4.7.3	Interference with Communication Devices.....	8
4.8	Other Requirements.....	8
4.8.1	Applicable Codes.....	8
4.8.2	Other Permits.....	9

4.8.3	Pre-emption .....	9
4.8.4	Archaeological and Historic Resources .....	9
4.8.5	Avian Mitigation .....	9
4.9	Delay in Construction .....	9
4.10	Special Conditions .....	10
5.0	PERMIT AMENDMENT .....	10
6.0	TRANSFER OF PERMIT .....	10
7.0	REVOCATION OR SUSPENSION OF THE PERMIT .....	11

**FIGURES**

**ATTACHMENTS**

GENERIC TEMPLATE

## 1.0 ROUTE PERMIT

The Minnesota Public Utilities Commission (Commission) hereby issues this route permit to [Permittee Name] (Permittee) pursuant to Minnesota Statutes Chapter 216E and Minnesota Rules Chapter 7850. This permit authorizes the [Permittee Name] to construct [Provide a description of the project as authorized by the Minnesota Public Utilities Commission], and as identified in the attached route permit maps, hereby incorporated into this document.

## 2.0 PROJECT DESCRIPTION

[Provide a description of the project as authorized by the Minnesota Public Utilities Commission]

### 2.1 Project Location

[Describe the location of the project including details such as the county, state, city, and townships, as appropriate]

County	Township Name	Township	Range	Section

### 2.2 Associated Facilities and Substations

[Provide a detailed description of the associated facilities and substations as authorized by the Commission]

### 2.3 Structures and Conductors

[Provide a detailed description of the structures and conductors authorized by the Commission]

The table below details specifics on the various structure types as presented in the route permit application.

Line Type	Conductor	Structure		Foundation	Height	Span
		Type	Material			

The transmission line and associated facilities shall be designed to meet or exceed all relevant local and state codes, the National Electric Safety Code (NESC), and North American Electric Reliability Corporation (NERC) requirements. This includes standards relating to clearances to

ground, clearance to crossing utilities, clearance to buildings, strength of materials, clearances over roadways, right-of-way widths, and permit requirements.

### **3.0 DESIGNATED ROUTE**

The route designated by the Commission in this permit is the route described below and shown on the route maps attached to this permit. The route is generally described as follows:

*[Provide detailed description of the authorized route including the route widths and any other specifics relevant to each segment. Also include a reference to the relevant route map to be attached to the permit.]*

The identified route widths will provide the Permittee with flexibility for minor adjustments of the specific alignment or right-of-way to accommodate landowner requests and unforeseen conditions. The final alignment (i.e., permanent and maintained rights-of-way) will be located within this designated route unless otherwise authorized below.

#### **3.1 Right-of-Way**

The approved right-of-way width for the project is up to [number] feet. This permit anticipates that the right-of-way will generally conform to the anticipated alignment as noted on the attached route permit maps unless changes are requested by individual landowners or unforeseen conditions are encountered or are otherwise provided for by this permit. Any alignment modifications within the designated route shall be located so as to have comparable overall impacts relative to the factors in Minn. Rules, part 7850.4100, as does the alignment identified in this permit, and shall be specifically identified and documented in and approved as part of the plan and profile submitted pursuant to section 4.1 of this permit.

Where the transmission line route parallels existing highway and other road rights-of-way, the transmission line right-of-way shall occupy and utilize the existing right-of-way to the maximum extent possible, consistent with the criteria in Minn. Rules, part 7850.4100, the other requirements of this permit, and for highways under the jurisdiction of the Minnesota Department of Transportation (Mn/DOT) rules, policies, and procedures for accommodating utilities in trunk highway rights-of-way.

### **4.0 GENERAL CONDITIONS**

The Permittee shall comply with the following conditions during construction of the transmission line and associated facilities over the life of this permit.

## 4.1 Plan and Profile

At least 30 calendar days before right-of-way preparation for construction begins on any segment or portion of the project, the Permittee shall provide the Commission with a plan and profile of the right-of-way and the specifications and drawings for right-of-way preparation, construction, structure specifications and locations, cleanup, and restoration for the transmission line. The documentation shall include maps depicting the plan and profile including the right-of-way, alignment, and structures in relation to the route and alignment approved per this permit.

The Permittee may not commence construction until the 30 days has expired or until the Commission has advised the Permittee in writing that it has completed its review of the documents and determined that the planned construction is consistent with this permit. If the Permittee intends to make any significant changes in its plan and profile or the specifications and drawings after submission to the Commission, the Permittee shall notify the Commission at least five days before implementing the changes. No changes shall be made that would be in violation of any of the terms of this permit.

## 4.2 Construction Practices

The Permittee shall follow those specific construction practices and material specifications described in [Permittee Name] Application to the Commission for a route permit for the [Project Name], dated [Date], unless this permit establishes a different requirement in which case this permit shall prevail.

### 4.2.1 Field Representative

At least 14 days prior to commencing construction, the Permittee shall advise the Commission in writing of the person or persons designated to be the field representative for the Permittee with the responsibility to oversee compliance with the conditions of this permit during construction.

The field representative's address, phone number, emergency phone number, and email shall be provided to the Commission and shall be made available to affected landowners, residents, public officials and other interested persons. The Permittee may change the field representative at any time upon written notice to the Commission.

### 4.2.2 Local Governments

During construction, the Permittee shall minimize any disruption to public services or public utilities. To the extent disruptions to public services or public utilities occur these

would be temporary and the Permittee will restore service promptly. Where any impacts to utilities have the potential to occur the Permittee will work with both landowners and local agencies to determine the most appropriate transmission structure placement.

The Permittee shall cooperate with county and city road authorities to develop appropriate signage and traffic management during construction.

#### 4.2.3 Cleanup

All waste and scrap that is the product of construction shall be removed from the area and properly disposed of upon completion of each task. Personal litter, including bottles, cans, and paper from construction activities shall be removed on a daily basis.

#### 4.2.4 Noise

Construction and routine maintenance activities shall be limited to daytime working hours, as defined in Minn. Rules, part 7030.0200, to ensure nighttime noise level standards will not be exceeded.

#### 4.2.5 Vegetation Removal

The Permittee shall minimize the number of trees to be removed in selecting the right-of-way specifically preserving to the maximum extent practicable windbreaks, shelterbelts, living snow fences, and vegetation in areas such as trail and stream crossings where vegetative screening may minimize aesthetic impacts, to the extent that such actions do not violate sound engineering principles or system reliability criteria.

Tall tree species located within the transmission line right-of-way that endanger the safe and reliable operation of the transmission facility will be removed. Certain low growing species can be planted in the right-of-way to blend the difference between the right-of-way and adjacent wooded areas, to the extent that the low growing vegetation that will not pose a threat to the transmission facility or impede construction.

The Permittee shall avoid construction and maintenance practices, particularly the use of fertilizer, herbicides or other pesticides, that are inconsistent with the landowner's or tenant's use of the land.

#### 4.2.6 Aesthetics

The Permittee shall consider input pertaining to visual impacts from landowners or land management agencies prior to final location of structures, rights-of-way, and other areas with the potential for visual disturbance. Care shall be used to preserve the natural landscape, minimize tree removal and prevent any unnecessary destruction of the natural surroundings in the vicinity of the project during construction and maintenance. Structures shall be placed at a distance, consistent with sound engineering principles and system reliability criteria, from intersecting roads, highway, or trail crossings and could cross roads to minimize or avoid impacts.

#### 4.2.7 Erosion Control

The Permittee shall implement reasonable measures to minimize erosion and sedimentation during construction and shall employ perimeter sediment controls, protect exposed soil by promptly planting, seeding, using erosion control blankets and turf reinforcement mats, stabilizing slopes, protecting storm drain inlets, protecting soil stockpiles, and controlling vehicle tracking. Contours shall be graded as required so that all surfaces provide for proper drainage, blend with the natural terrain, and are left in a condition that will facilitate re-vegetation and prevent erosion. All areas disturbed during construction of the facilities shall be returned to pre-construction conditions.

When utilizing seed to establish temporary and permanent vegetative cover on exposed soil the Permittee shall select specific site characteristic seed certified to be free of noxious weeds.

Where larger areas of one acre or more are disturbed or other areas designated by the Minnesota Pollution Control Agency (MPCA), the Permittee shall obtain a National Pollutant Discharge Elimination System (NPDES)/State Disposal System (SDS) Construction Stormwater permit from the MPCA.

#### 4.2.8 Wetlands and Water Resources

Wetland impact avoidance measures that shall be implemented during design and construction of the transmission line will include spacing and placing the power poles at variable distances to span and avoid wetlands, watercourses, and floodplains.

Unavoidable wetland impacts as a result of the placement of poles shall be limited to the immediate area around the poles. To minimize impacts, construction in wetland areas shall occur during frozen ground conditions. When construction during winter is not possible, wooden or composite mats shall be used to protect wetland vegetation. Soil excavated from the wetlands and riparian areas shall be contained and not placed back into the wetland or riparian area.

Wetlands and riparian areas shall be accessed using the shortest route possible in order to minimize travel through wetland areas and prevent unnecessary impacts. No staging or stringing set up areas shall be placed within or adjacent to wetlands or water resources, as practicable. Power pole structures shall be assembled on upland areas before they are brought to the site for installation. Areas disturbed by construction activities shall be restored to pre-construction conditions.

All requirements of the U.S. Army Corps of Engineers (wetlands under federal jurisdiction), Minnesota Department of Natural Resources (Public Waters/Wetlands), and County (wetlands under the jurisdiction of the Minnesota Wetland Conservation Act) shall be met.

#### 4.2.9 Temporary Work Space

The Permittee shall limit temporary easements to special construction access needs and additional staging or lay-down areas required outside of the authorized right-of-way. Temporary space shall be selected to limit the removal and impacts to vegetation. Temporary easements outside of the authorized transmission line right-of-way will be obtained from affected landowners through rental agreements and are not provided for in this permit.

Temporary driveways may be constructed between the roadway and the structures to minimize impact using the shortest route possible. Construction mats should also be used to minimize impacts on access paths and construction areas.

#### 4.2.10 Restoration

The Permittee shall restore the right-of-way, temporary work spaces, access roads, abandoned right-of-way, and other public or private lands affected by construction of the transmission line. Restoration within the right-of-way must be compatible with the safe operation, maintenance, and inspection of the transmission line. Within 60 days after completion of all restoration activities, the Permittee shall advise the Commission in writing of the completion of such activities.

The Permittee shall fairly compensate landowners for damage to crops, fences, landscaping, drain tile, or other damages sustained during construction.

#### 4.2.11 Notice of Permit

The Permittee shall inform all employees, contractors, and other persons involved in the transmission line construction of the terms and conditions of this permit.

#### **4.3 Periodic Status Reports**

The Permittee shall report to the Commission on progress regarding finalization of the route, design of structures, and construction of the transmission line. The Permittee need not report more frequently than monthly.

#### **4.4 Complaint Procedures**

Prior to the start of construction, the Permittee shall submit to the Commission the procedures that will be used to receive and respond to complaints. The procedures shall be in accordance with the requirements set forth in the complaint procedures attached to this permit [Attachment].

#### **4.5 Notification to Landowners**

The Permittee shall provide all affected landowners with a copy of this permit and, as a separate information piece, the complaint procedures at the time of the first contact with the landowners after issuance of this permit. The Permittee shall contact landowners prior to entering the property or conducting maintenance along the route.

The Permittee shall work with landowners to locate the high-voltage transmission line to minimize the loss of agricultural land, forest, and wetlands, and to avoid homes and farmsteads.

#### **4.6 Completion of Construction**

##### **4.6.1 Notification to Commission**

At least three days before the line is to be placed into service, the Permittee shall notify the Commission of the date on which the line will be placed into service and the date on which construction was complete.

##### **4.6.2 As-Builts**

Within 60 days after completion of construction, the Permittee shall submit copies of all final as-built plans and specifications developed during the project.

##### **4.6.3 GPS Data**

Within 60 days after completion of construction, the Permittee shall submit to the Commission, in the format requested by the Commission, geo-spatial information (e.g., ArcGIS compatible map files, GPS coordinates, associated database of characteristics) for all structures associated with the transmission line and each substation connected.

## **4.7 Electrical Performance Standards**

### **4.7.1 Grounding**

The Permittee shall design, construct, and operate the transmission line in a manner so that the maximum induced steady-state short-circuit current shall be limited to five milliamperes root mean square (rms) alternating current between the ground and any non-stationary object within the right-of-way, including but not limited to large motor vehicles and agricultural equipment. All fixed metallic objects on or off the right-of-way, except electric fences that parallel or cross the right-of-way, shall be grounded to the extent necessary to limit the induced short-circuit current between ground and the object so as not to exceed one milliamperes rms under steady state conditions of the transmission line and to comply with the ground fault conditions specified in the NESC. The Permittee shall address and rectify any induced current problems that arise during transmission line operation.

### **4.7.2 Electric Field**

The transmission line shall be designed, constructed, and operated in such a manner that the electric field measured one meter above ground level immediately below the transmission line shall not exceed 8.0 kV/m rms.

### **4.7.3 Interference with Communication Devices**

If interference with radio or television, satellite, wireless internet, GPS-based agriculture navigation systems or other communication devices is caused by the presence or operation of the transmission line, the Permittee shall take whatever action is feasible to restore or provide reception equivalent to reception levels in the immediate area just prior to the construction of the line.

## **4.8 Other Requirements**

### **4.8.1 Applicable Codes**

The Permittee shall comply with applicable NERC planning standards and requirements of the NESC including clearances to ground, clearance to crossing utilities, clearance to buildings, right-of way widths, erecting power poles, and stringing of transmission line conductors.

#### 4.8.2 Other Permits

The Permittee shall comply with all applicable state rules and statutes. The Permittee shall obtain all required permits for the project and comply with the conditions of these permits. A list of the required permits is included in the permit application. The Permittee shall submit a copy of such permits to the Commission upon request.

#### 4.8.3 Pre-emption

Pursuant to Minn. Stat. § 216E.10, this route permit shall be the sole approval required to be obtained by the Permittee for construction of the transmission facilities and this permit shall supersede and preempt all zoning, building, or land use rules, regulations, or ordinances promulgated by regional, county, local and special purpose government.

#### 4.8.4 Archaeological and Historic Resources

The Permittee shall make every effort to avoid impacts to identified archaeological and historic resources when installing the high-voltage transmission line on the approved route. In the event that a resource is encountered, the State Historic Preservation Office should be contacted and consulted; the nature of the resource should be identified; and a determination should be made on the eligibility for listing in the National Register of Historic Places. Where feasible, avoidance of the resource is required.

#### 4.8.5 Avian Mitigation

The Permittee's standard transmission design shall incorporate adequate spacing of conductors and grounding devices in accordance with Avian Power Line Interaction Committee standards to eliminate the risk of electrocution to raptors with larger wingspans that may simultaneously come in contact with a conductor and grounding devices.

### 4.9 Delay in Construction

If the Permittee has not commenced construction or improvement of the route within four years after the date of issuance of this permit the Permittee shall file a report on the failure to construct

and the Commission shall consider suspension of the permit in accordance with Minn. Rules, part 7850.4700.

#### **4.10 Special Conditions**

The Permittee shall provide a report to the Commission as part of the plan and profile submission that describes the actions taken and mitigative measures developed regarding the project and the following special conditions.

*[Describe any special conditions]*

*Examples of special conditions included in permits:*

- *Avian Mitigation Plan*
- *Environmental Control Plan*
- *Agriculture Mitigation Plan*
- *Vegetation Management Plan*
- *Property Restrictions*
- *Minnesota Department of Natural Resources Requirements*
- *Minnesota Pollution Control Requirements*
- *Minnesota State Historical Preservation Office Requirements*
- *Minnesota Department of Transportation Requirements*

#### **5.0 PERMIT AMENDMENT**

This permit may be amended at any time by the Commission. Any person may request an amendment of the conditions of this permit by submitting a request to the Commission in writing describing the amendment sought and the reasons for the amendment. The Commission will mail notice of receipt of the request to the Permittee. The Commission may amend the conditions after affording the Permittee and interested persons such process as is required.

#### **6.0 TRANSFER OF PERMIT**

The Permittee may request at any time that the Commission transfer this permit to another person or entity. The Permittee shall provide the name and description of the person or entity to whom the permit is requested to be transferred, the reasons for the transfer, a description of the facilities affected, and the proposed effective date of the transfer.

The person to whom the permit is to be transferred shall provide the Commission with such information as the Commission shall require to determine whether the new Permittee can comply

with the conditions of the permit. The Commission may authorize transfer of the permit after affording the Permittee, the new Permittee, and interested persons such process as is required.

## **7.0 REVOCATION OR SUSPENSION OF THE PERMIT**

The Commission may initiate action to revoke or suspend this permit at any time. The Commission shall act in accordance with the requirements of Minn. Rules, part 7850.5100, to revoke or suspend the permit.

GENERIC TEMPLATE

**MINNESOTA PUBLIC UTILITIES COMMISSION  
COMPLAINT HANDLING PROCEDURES FOR  
HIGH-VOLTAGE TRANSMISSION LINES**

**A. Purpose**

To establish a uniform and timely method of reporting complaints received by the permittee concerning permit conditions for site preparation, construction, cleanup and restoration, operation, and resolution of such complaints.

**B. Scope**

This document describes complaint reporting procedures and frequency.

**C. Applicability**

The procedures shall be used for all complaints received by the permittee and all complaints received by the Minnesota Public Utilities Commission (Commission) under Minn. Rules, parts 7829.1500 or 7829.1700 relevant to this permit.

**D. Definitions**

***Complaint:*** A verbal or written statement presented to the permittees by a person expressing dissatisfaction or concern regarding site preparation, cleanup or restoration or other route and associated facilities permit conditions. Complaints do not include requests, inquiries, questions or general comments.

***Substantial Complaint:*** A written complaint alleging a violation of a specific permit condition that, if substantiated, could result in permit modification or suspension pursuant to the applicable regulations.

***Unresolved Complaint:*** A complaint which, despite the good faith efforts of the permittee and a person, remains to both or one of the parties unresolved or unsatisfactorily resolved.

***Person:*** An individual, partnership, joint venture, private or public corporation, association, firm, public service company, cooperative, political subdivision, municipal corporation, government agency, public utility district, or any other entity, public or private, however organized.

**E. Complaint Documentation and Processing**

1. The permittee shall designate an individual to summarize complaints for the Commission. This person's name, phone number and email address shall accompany all complaint submittals.

2. A person presenting the complaint should to the extent possible, include the following information in their communications:
  - a. name, address, phone number, and email address;
  - b. date of complaint;
  - c. tract or parcel number; and
  - d. whether the complaint relates to a permit matter or a compliance issue.
  
3. The permittee shall document all complaints by maintaining a record of all applicable information concerning the complaint, including the following:
  - a. docket number and project name;
  - b. name of complainant, address, phone number and email address;
  - c. precise description of property or parcel number;
  - d. name of permittee representative receiving complaint and date of receipt;
  - e. nature of complaint and the applicable permit condition(s);
  - f. activities undertaken to resolve the complaint; and
  - g. final disposition of the complaint.

#### **F. Reporting Requirements**

The permittee shall commence complaint reporting at the beginning of project construction and continue through the term of the permit. The permittee shall report all complaints to the Commission according to the following schedule:

**Immediate Reports:** All substantial complaints shall be reported to the Commission the same day received, or on the following working day for complaints received after working hours. Such reports are to be directed to the Commission's Consumer Affairs Office at 1-800-657-3782 (voice messages are acceptable) or *consumer.puc@state.mn.us*. For e-mail reporting, the email subject line should read "EFP Complaint" and include the appropriate project docket number.

**Monthly Reports:** By the 15th of each month, a summary of all complaints, including substantial complaints received or resolved during the preceding month, shall be filed to Dr. Burl W. Haar, Executive Secretary, Public Utilities Commission, using the eDockets system. The eDockets system is located at:

<https://www.edockets.state.mn.us/EFiling/home.jsp>

If no complaints were received during the preceding month, the permittee shall submit (eFile) a summary indicating that no complaints were received.

#### **G. Complaints Received by the Commission**

Complaints received directly by the Commission from aggrieved persons regarding site preparation, construction, cleanup, restoration, operation and maintenance shall be promptly sent to the permittee.

**H. Commission Process for Unresolved Complaints**

Commission staff shall perform an initial evaluation of unresolved complaints submitted to the Commission. Complaints raising substantial permit issues shall be processed and resolved by the Commission. Staff shall notify the permittee and appropriate persons if it determines that the complaint is a substantial complaint. With respect to such complaints, each party shall submit a written summary of its position to the Commission no later than ten (10) days after receipt of the staff notification. The complaint will be presented to the Commission for a decision as soon as practicable.

**I. Permittee Contacts for Complaints and Complaint Reporting**

Complaints may be filed by mail or email to:

[Permittee Name]

[Permittee Complaint Contact]

[Permittee Address]

[Permittee Telephone Number]

[Permittee Email]

This information shall be maintained current by informing the Commission of any changes by eFiling, as they become effective.

**MINNESOTA PUBLIC UTILITIES COMMISSION  
COMPLIANCE FILING PROCEDURE FOR  
PERMITTED ENERGY FACILITIES**

**A. Purpose**

To establish a uniform and timely method of submitting information required by the Commission energy facility permits.

**B. Scope and Applicability**

This procedure encompasses all compliance filings required by permit.

**C. Definitions**

***Compliance Filing:*** A filing of information to the Commission, where the information is required by a Commission site or route permit.

**D. Responsibilities**

1. The permittee shall eFile all compliance filings with Dr. Burl W. Haar, Executive Secretary, Public Utilities Commission, through the eDockets system. The eDockets system is located at: <https://www.edockets.state.mn.us/EFiling/home.jsp>

General instructions are provided on the eDockets website. Permittees must register on the website to eFile documents.

2. All filings must have a cover sheet that includes:

- a. Date
- b. Name of submitter/permittee
- c. Type of permit (site or route)
- d. Project location
- e. Project docket number
- f. Permit section under which the filing is made
- g. Short description of the filing

3. Filings that are graphic intensive (e.g., maps, engineered drawings) must, in addition to being eFiled, be submitted as paper copies and on CD. Paper copies and CDs should be sent to: 1) Dr. Burl W. Haar, Executive Secretary, Minnesota Public Utilities Commission, 121 7th Place East, Suite 350, St. Paul, MN 55101-2147, and 2) Department of Commerce, Energy Facility Permitting, 85 7th Place East, Suite 500, St. Paul, MN 55101-2198.

The Commission may request a paper copy of any eFiled document.



# ***GENERIC ROUTE PERMIT TEMPLATE***

## **STATE OF MINNESOTA PUBLIC UTILITIES COMMISSION**

### **ROUTE PERMIT FOR CONSTRUCTION OF A HIGH-VOLTAGE TRANSMISSION LINE AND ASSOCIATED FACILITIES**

**IN**

**[COUNTY]**

**ISSUED TO**

**[PERMITTEE]**

**PUC DOCKET NO. [Docket Number]**

In accordance with the requirements of Minnesota Statutes Chapter 216E and Minnesota Rules Chapter 7850, this route permit is hereby issued to:

**[PERMITTEE]**

**[Permittee]** is authorized by this route permit to construct **[Provide a description of the project authorized by the Minnesota Public Utilities Commission]**.

The transmission line and associated facilities shall be built within the route identified in this permit and as portrayed on the official route maps, and in compliance with the conditions specified in this permit.

Approved and adopted this \_\_\_\_ day of **[Month, Year]**

BY ORDER OF THE COMMISSION

---

Burl W. Haar,  
Executive Secretary

## CONTENTS

1.0	ROUTE PERMIT.....	1
2.0	PROJECT DESCRIPTION.....	1
2.1	Project Location.....	1
2.2	Associated Facilities and Substations.....	1
2.3	Structures and Conductors.....	1
3.0	DESIGNATED ROUTE.....	2
3.1	Right-of-Way.....	2
4.0	GENERAL CONDITIONS.....	2
4.1	Plan and Profile.....	3
4.2	Construction Practices.....	3
4.2.1	Field Representative.....	3
4.2.2	Local Governments.....	3
4.2.3	Cleanup.....	4
4.2.4	Noise.....	4
4.2.5	Vegetation Removal.....	4
4.2.6	Aesthetics.....	4
4.2.7	Erosion Control.....	5
4.2.8	Wetlands and Water Resources.....	5
4.2.9	Temporary Work Space.....	6
4.2.10	Restoration.....	6
4.2.11	Notice of Permit.....	6
4.3	Periodic Status Reports.....	7
4.4	Complaint Procedures.....	7
4.5	Notification to Landowners.....	7
4.6	Completion of Construction.....	7
4.6.1	Notification to Commission.....	7
4.6.2	As-Builts.....	7
4.6.3	GPS Data.....	7
4.7	Electrical Performance Standards.....	8
4.7.1	Grounding.....	8
4.7.2	Electric Field.....	8
4.7.3	Interference with Communication Devices.....	8
4.8	Other Requirements.....	8
4.8.1	Applicable Codes.....	8
4.8.2	Other Permits.....	9

4.8.3	Pre-emption .....	9
4.8.4	Archaeological and Historic Resources .....	9
4.8.5	Avian Mitigation .....	9
4.9	Delay in Construction .....	9
4.10	Special Conditions .....	10
5.0	PERMIT AMENDMENT .....	10
6.0	TRANSFER OF PERMIT .....	10
7.0	REVOCATION OR SUSPENSION OF THE PERMIT .....	11

**FIGURES**

**ATTACHMENTS**

GENERIC TEMPLATE

## 1.0 ROUTE PERMIT

The Minnesota Public Utilities Commission (Commission) hereby issues this route permit to [Permittee Name] (Permittee) pursuant to Minnesota Statutes Chapter 216E and Minnesota Rules Chapter 7850. This permit authorizes the [Permittee Name] to construct [Provide a description of the project as authorized by the Minnesota Public Utilities Commission], and as identified in the attached route permit maps, hereby incorporated into this document.

## 2.0 PROJECT DESCRIPTION

[Provide a description of the project as authorized by the Minnesota Public Utilities Commission]

### 2.1 Project Location

[Describe the location of the project including details such as the county, state, city, and townships, as appropriate]

County	Township Name	Township	Range	Section

### 2.2 Associated Facilities and Substations

[Provide a detailed description of the associated facilities and substations as authorized by the Commission]

### 2.3 Structures and Conductors

[Provide a detailed description of the structures and conductors authorized by the Commission]

The table below details specifics on the various structure types as presented in the route permit application.

Line Type	Conductor	Structure		Foundation	Height	Span
		Type	Material			

The transmission line and associated facilities shall be designed to meet or exceed all relevant local and state codes, the National Electric Safety Code (NESC), and North American Electric Reliability Corporation (NERC) requirements. This includes standards relating to clearances to

ground, clearance to crossing utilities, clearance to buildings, strength of materials, clearances over roadways, right-of-way widths, and permit requirements.

### **3.0 DESIGNATED ROUTE**

The route designated by the Commission in this permit is the route described below and shown on the route maps attached to this permit. The route is generally described as follows:

*[Provide detailed description of the authorized route including the route widths and any other specifics relevant to each segment. Also include a reference to the relevant route map to be attached to the permit.]*

The identified route widths will provide the Permittee with flexibility for minor adjustments of the specific alignment or right-of-way to accommodate landowner requests and unforeseen conditions. The final alignment (i.e., permanent and maintained rights-of-way) will be located within this designated route unless otherwise authorized below.

#### **3.1 Right-of-Way**

The approved right-of-way width for the project is up to *[number]* feet. This permit anticipates that the right-of-way will generally conform to the anticipated alignment as noted on the attached route permit maps unless changes are requested by individual landowners or unforeseen conditions are encountered or are otherwise provided for by this permit. Any alignment modifications within the designated route shall be located so as to have comparable overall impacts relative to the factors in Minn. Rules, part 7850.4100, as does the alignment identified in this permit, and shall be specifically identified and documented in and approved as part of the plan and profile submitted pursuant to section 4.1 of this permit.

Where the transmission line route parallels existing highway and other road rights-of-way, the transmission line right-of-way shall occupy and utilize the existing right-of-way to the maximum extent possible, consistent with the criteria in Minn. Rules, part 7850.4100, the other requirements of this permit, and for highways under the jurisdiction of the Minnesota Department of Transportation (Mn/DOT) rules, policies, and procedures for accommodating utilities in trunk highway rights-of-way.

### **4.0 GENERAL CONDITIONS**

The Permittee shall comply with the following conditions during construction of the transmission line and associated facilities over the life of this permit.

## 4.1 Plan and Profile

At least 30 calendar days before right-of-way preparation for construction begins on any segment or portion of the project, the Permittee shall provide the Commission with a plan and profile of the right-of-way and the specifications and drawings for right-of-way preparation, construction, structure specifications and locations, cleanup, and restoration for the transmission line. The documentation shall include maps depicting the plan and profile including the right-of-way, alignment, and structures in relation to the route and alignment approved per this permit.

The Permittee may not commence construction until the 30 days has expired or until the Commission has advised the Permittee in writing that it has completed its review of the documents and determined that the planned construction is consistent with this permit. If the Permittee intends to make any significant changes in its plan and profile or the specifications and drawings after submission to the Commission, the Permittee shall notify the Commission at least five days before implementing the changes. No changes shall be made that would be in violation of any of the terms of this permit.

## 4.2 Construction Practices

The Permittee shall follow those specific construction practices and material specifications described in [Permittee Name] Application to the Commission for a route permit for the [Project Name], dated [Date], unless this permit establishes a different requirement in which case this permit shall prevail.

### 4.2.1 Field Representative

At least 14 days prior to commencing construction, the Permittee shall advise the Commission in writing of the person or persons designated to be the field representative for the Permittee with the responsibility to oversee compliance with the conditions of this permit during construction.

The field representative's address, phone number, emergency phone number, and email shall be provided to the Commission and shall be made available to affected landowners, residents, public officials and other interested persons. The Permittee may change the field representative at any time upon written notice to the Commission.

### 4.2.2 Local Governments

During construction, the Permittee shall minimize any disruption to public services or public utilities. To the extent disruptions to public services or public utilities occur these

would be temporary and the Permittee will restore service promptly. Where any impacts to utilities have the potential to occur the Permittee will work with both landowners and local agencies to determine the most appropriate transmission structure placement.

The Permittee shall cooperate with county and city road authorities to develop appropriate signage and traffic management during construction.

#### 4.2.3 Cleanup

All waste and scrap that is the product of construction shall be removed from the area and properly disposed of upon completion of each task. Personal litter, including bottles, cans, and paper from construction activities shall be removed on a daily basis.

#### 4.2.4 Noise

Construction and routine maintenance activities shall be limited to daytime working hours, as defined in Minn. Rules, part 7030.0200, to ensure nighttime noise level standards will not be exceeded.

#### 4.2.5 Vegetation Removal

The Permittee shall minimize the number of trees to be removed in selecting the right-of-way specifically preserving to the maximum extent practicable windbreaks, shelterbelts, living snow fences, and vegetation in areas such as trail and stream crossings where vegetative screening may minimize aesthetic impacts, to the extent that such actions do not violate sound engineering principles or system reliability criteria.

Tall tree species located within the transmission line right-of-way that endanger the safe and reliable operation of the transmission facility will be removed. Certain low growing species can be planted in the right-of-way to blend the difference between the right-of-way and adjacent wooded areas, to the extent that the low growing vegetation that will not pose a threat to the transmission facility or impede construction.

The Permittee shall avoid construction and maintenance practices, particularly the use of fertilizer, herbicides or other pesticides, that are inconsistent with the landowner's or tenant's use of the land.

#### 4.2.6 Aesthetics

The Permittee shall consider input pertaining to visual impacts from landowners or land management agencies prior to final location of structures, rights-of-way, and other areas with the potential for visual disturbance. Care shall be used to preserve the natural landscape, minimize tree removal and prevent any unnecessary destruction of the natural surroundings in the vicinity of the project during construction and maintenance. Structures shall be placed at a distance, consistent with sound engineering principles and system reliability criteria, from intersecting roads, highway, or trail crossings and could cross roads to minimize or avoid impacts.

#### 4.2.7 Erosion Control

The Permittee shall implement reasonable measures to minimize erosion and sedimentation during construction and shall employ perimeter sediment controls, protect exposed soil by promptly planting, seeding, using erosion control blankets and turf reinforcement mats, stabilizing slopes, protecting storm drain inlets, protecting soil stockpiles, and controlling vehicle tracking. Contours shall be graded as required so that all surfaces provide for proper drainage, blend with the natural terrain, and are left in a condition that will facilitate re-vegetation and prevent erosion. All areas disturbed during construction of the facilities shall be returned to pre-construction conditions.

When utilizing seed to establish temporary and permanent vegetative cover on exposed soil the Permittee shall select specific site characteristic seed certified to be free of noxious weeds.

Where larger areas of one acre or more are disturbed or other areas designated by the Minnesota Pollution Control Agency (MPCA), the Permittee shall obtain a National Pollutant Discharge Elimination System (NPDES)/State Disposal System (SDS) Construction Stormwater permit from the MPCA.

#### 4.2.8 Wetlands and Water Resources

Wetland impact avoidance measures that shall be implemented during design and construction of the transmission line will include spacing and placing the power poles at variable distances to span and avoid wetlands, watercourses, and floodplains.

Unavoidable wetland impacts as a result of the placement of poles shall be limited to the immediate area around the poles. To minimize impacts, construction in wetland areas shall occur during frozen ground conditions. When construction during winter is not possible, wooden or composite mats shall be used to protect wetland vegetation. Soil excavated from the wetlands and riparian areas shall be contained and not placed back into the wetland or riparian area.

Wetlands and riparian areas shall be accessed using the shortest route possible in order to minimize travel through wetland areas and prevent unnecessary impacts. No staging or stringing set up areas shall be placed within or adjacent to wetlands or water resources, as practicable. Power pole structures shall be assembled on upland areas before they are brought to the site for installation. Areas disturbed by construction activities shall be restored to pre-construction conditions.

All requirements of the U.S. Army Corps of Engineers (wetlands under federal jurisdiction), Minnesota Department of Natural Resources (Public Waters/Wetlands), and County (wetlands under the jurisdiction of the Minnesota Wetland Conservation Act) shall be met.

#### 4.2.9 Temporary Work Space

The Permittee shall limit temporary easements to special construction access needs and additional staging or lay-down areas required outside of the authorized right-of-way. Temporary space shall be selected to limit the removal and impacts to vegetation. Temporary easements outside of the authorized transmission line right-of-way will be obtained from affected landowners through rental agreements and are not provided for in this permit.

Temporary driveways may be constructed between the roadway and the structures to minimize impact using the shortest route possible. Construction mats should also be used to minimize impacts on access paths and construction areas.

#### 4.2.10 Restoration

The Permittee shall restore the right-of-way, temporary work spaces, access roads, abandoned right-of-way, and other public or private lands affected by construction of the transmission line. Restoration within the right-of-way must be compatible with the safe operation, maintenance, and inspection of the transmission line. Within 60 days after completion of all restoration activities, the Permittee shall advise the Commission in writing of the completion of such activities.

The Permittee shall fairly compensate landowners for damage to crops, fences, landscaping, drain tile, or other damages sustained during construction.

#### 4.2.11 Notice of Permit

The Permittee shall inform all employees, contractors, and other persons involved in the transmission line construction of the terms and conditions of this permit.

#### **4.3 Periodic Status Reports**

The Permittee shall report to the Commission on progress regarding finalization of the route, design of structures, and construction of the transmission line. The Permittee need not report more frequently than monthly.

#### **4.4 Complaint Procedures**

Prior to the start of construction, the Permittee shall submit to the Commission the procedures that will be used to receive and respond to complaints. The procedures shall be in accordance with the requirements set forth in the complaint procedures attached to this permit [Attachment].

#### **4.5 Notification to Landowners**

The Permittee shall provide all affected landowners with a copy of this permit and, as a separate information piece, the complaint procedures at the time of the first contact with the landowners after issuance of this permit. The Permittee shall contact landowners prior to entering the property or conducting maintenance along the route.

The Permittee shall work with landowners to locate the high-voltage transmission line to minimize the loss of agricultural land, forest, and wetlands, and to avoid homes and farmsteads.

#### **4.6 Completion of Construction**

##### **4.6.1 Notification to Commission**

At least three days before the line is to be placed into service, the Permittee shall notify the Commission of the date on which the line will be placed into service and the date on which construction was complete.

##### **4.6.2 As-Builts**

Within 60 days after completion of construction, the Permittee shall submit copies of all final as-built plans and specifications developed during the project.

##### **4.6.3 GPS Data**

Within 60 days after completion of construction, the Permittee shall submit to the Commission, in the format requested by the Commission, geo-spatial information (e.g., ArcGIS compatible map files, GPS coordinates, associated database of characteristics) for all structures associated with the transmission line and each substation connected.

## **4.7 Electrical Performance Standards**

### **4.7.1 Grounding**

The Permittee shall design, construct, and operate the transmission line in a manner so that the maximum induced steady-state short-circuit current shall be limited to five milliamperes root mean square (rms) alternating current between the ground and any non-stationary object within the right-of-way, including but not limited to large motor vehicles and agricultural equipment. All fixed metallic objects on or off the right-of-way, except electric fences that parallel or cross the right-of-way, shall be grounded to the extent necessary to limit the induced short-circuit current between ground and the object so as not to exceed one milliamperes rms under steady state conditions of the transmission line and to comply with the ground fault conditions specified in the NESC. The Permittee shall address and rectify any induced current problems that arise during transmission line operation.

### **4.7.2 Electric Field**

The transmission line shall be designed, constructed, and operated in such a manner that the electric field measured one meter above ground level immediately below the transmission line shall not exceed 8.0 kV/m rms.

### **4.7.3 Interference with Communication Devices**

If interference with radio or television, satellite, wireless internet, GPS-based agriculture navigation systems or other communication devices is caused by the presence or operation of the transmission line, the Permittee shall take whatever action is feasible to restore or provide reception equivalent to reception levels in the immediate area just prior to the construction of the line.

## **4.8 Other Requirements**

### **4.8.1 Applicable Codes**

The Permittee shall comply with applicable NERC planning standards and requirements of the NESC including clearances to ground, clearance to crossing utilities, clearance to buildings, right-of way widths, erecting power poles, and stringing of transmission line conductors.

#### 4.8.2 Other Permits

The Permittee shall comply with all applicable state rules and statutes. The Permittee shall obtain all required permits for the project and comply with the conditions of these permits. A list of the required permits is included in the permit application. The Permittee shall submit a copy of such permits to the Commission upon request.

#### 4.8.3 Pre-emption

Pursuant to Minn. Stat. § 216E.10, this route permit shall be the sole approval required to be obtained by the Permittee for construction of the transmission facilities and this permit shall supersede and preempt all zoning, building, or land use rules, regulations, or ordinances promulgated by regional, county, local and special purpose government.

#### 4.8.4 Archaeological and Historic Resources

The Permittee shall make every effort to avoid impacts to identified archaeological and historic resources when installing the high-voltage transmission line on the approved route. In the event that a resource is encountered, the State Historic Preservation Office should be contacted and consulted; the nature of the resource should be identified; and a determination should be made on the eligibility for listing in the National Register of Historic Places. Where feasible, avoidance of the resource is required.

#### 4.8.5 Avian Mitigation

The Permittee's standard transmission design shall incorporate adequate spacing of conductors and grounding devices in accordance with Avian Power Line Interaction Committee standards to eliminate the risk of electrocution to raptors with larger wingspans that may simultaneously come in contact with a conductor and grounding devices.

### 4.9 Delay in Construction

If the Permittee has not commenced construction or improvement of the route within four years after the date of issuance of this permit the Permittee shall file a report on the failure to construct

and the Commission shall consider suspension of the permit in accordance with Minn. Rules, part 7850.4700.

#### **4.10 Special Conditions**

The Permittee shall provide a report to the Commission as part of the plan and profile submission that describes the actions taken and mitigative measures developed regarding the project and the following special conditions.

*[Describe any special conditions]*

*Examples of special conditions included in permits:*

- *Avian Mitigation Plan*
- *Environmental Control Plan*
- *Agriculture Mitigation Plan*
- *Vegetation Management Plan*
- *Property Restrictions*
- *Minnesota Department of Natural Resources Requirements*
- *Minnesota Pollution Control Requirements*
- *Minnesota State Historical Preservation Office Requirements*
- *Minnesota Department of Transportation Requirements*

#### **5.0 PERMIT AMENDMENT**

This permit may be amended at any time by the Commission. Any person may request an amendment of the conditions of this permit by submitting a request to the Commission in writing describing the amendment sought and the reasons for the amendment. The Commission will mail notice of receipt of the request to the Permittee. The Commission may amend the conditions after affording the Permittee and interested persons such process as is required.

#### **6.0 TRANSFER OF PERMIT**

The Permittee may request at any time that the Commission transfer this permit to another person or entity. The Permittee shall provide the name and description of the person or entity to whom the permit is requested to be transferred, the reasons for the transfer, a description of the facilities affected, and the proposed effective date of the transfer.

The person to whom the permit is to be transferred shall provide the Commission with such information as the Commission shall require to determine whether the new Permittee can comply

with the conditions of the permit. The Commission may authorize transfer of the permit after affording the Permittee, the new Permittee, and interested persons such process as is required.

#### **7.0 REVOCATION OR SUSPENSION OF THE PERMIT**

The Commission may initiate action to revoke or suspend this permit at any time. The Commission shall act in accordance with the requirements of Minn. Rules, part 7850.5100, to revoke or suspend the permit.

GENERIC TEMPLATE

**MINNESOTA PUBLIC UTILITIES COMMISSION  
COMPLAINT HANDLING PROCEDURES FOR  
HIGH-VOLTAGE TRANSMISSION LINES**

**A. Purpose**

To establish a uniform and timely method of reporting complaints received by the permittee concerning permit conditions for site preparation, construction, cleanup and restoration, operation, and resolution of such complaints.

**B. Scope**

This document describes complaint reporting procedures and frequency.

**C. Applicability**

The procedures shall be used for all complaints received by the permittee and all complaints received by the Minnesota Public Utilities Commission (Commission) under Minn. Rules, parts 7829.1500 or 7829.1700 relevant to this permit.

**D. Definitions**

***Complaint:*** A verbal or written statement presented to the permittees by a person expressing dissatisfaction or concern regarding site preparation, cleanup or restoration or other route and associated facilities permit conditions. Complaints do not include requests, inquiries, questions or general comments.

***Substantial Complaint:*** A written complaint alleging a violation of a specific permit condition that, if substantiated, could result in permit modification or suspension pursuant to the applicable regulations.

***Unresolved Complaint:*** A complaint which, despite the good faith efforts of the permittee and a person, remains to both or one of the parties unresolved or unsatisfactorily resolved.

***Person:*** An individual, partnership, joint venture, private or public corporation, association, firm, public service company, cooperative, political subdivision, municipal corporation, government agency, public utility district, or any other entity, public or private, however organized.

**E. Complaint Documentation and Processing**

1. The permittee shall designate an individual to summarize complaints for the Commission. This person's name, phone number and email address shall accompany all complaint submittals.

2. A person presenting the complaint should to the extent possible, include the following information in their communications:
  - a. name, address, phone number, and email address;
  - b. date of complaint;
  - c. tract or parcel number; and
  - d. whether the complaint relates to a permit matter or a compliance issue.
  
3. The permittee shall document all complaints by maintaining a record of all applicable information concerning the complaint, including the following:
  - a. docket number and project name;
  - b. name of complainant, address, phone number and email address;
  - c. precise description of property or parcel number;
  - d. name of permittee representative receiving complaint and date of receipt;
  - e. nature of complaint and the applicable permit condition(s);
  - f. activities undertaken to resolve the complaint; and
  - g. final disposition of the complaint.

#### **F. Reporting Requirements**

The permittee shall commence complaint reporting at the beginning of project construction and continue through the term of the permit. The permittee shall report all complaints to the Commission according to the following schedule:

**Immediate Reports:** All substantial complaints shall be reported to the Commission the same day received, or on the following working day for complaints received after working hours. Such reports are to be directed to the Commission's Consumer Affairs Office at 1-800-657-3782 (voice messages are acceptable) or *consumer.puc@state.mn.us*. For e-mail reporting, the email subject line should read "EFP Complaint" and include the appropriate project docket number.

**Monthly Reports:** By the 15th of each month, a summary of all complaints, including substantial complaints received or resolved during the preceding month, shall be filed to Dr. Burl W. Haar, Executive Secretary, Public Utilities Commission, using the eDockets system. The eDockets system is located at:

<https://www.edockets.state.mn.us/EFiling/home.jsp>

If no complaints were received during the preceding month, the permittee shall submit (eFile) a summary indicating that no complaints were received.

#### **G. Complaints Received by the Commission**

Complaints received directly by the Commission from aggrieved persons regarding site preparation, construction, cleanup, restoration, operation and maintenance shall be promptly sent to the permittee.

**H. Commission Process for Unresolved Complaints**

Commission staff shall perform an initial evaluation of unresolved complaints submitted to the Commission. Complaints raising substantial permit issues shall be processed and resolved by the Commission. Staff shall notify the permittee and appropriate persons if it determines that the complaint is a substantial complaint. With respect to such complaints, each party shall submit a written summary of its position to the Commission no later than ten (10) days after receipt of the staff notification. The complaint will be presented to the Commission for a decision as soon as practicable.

**I. Permittee Contacts for Complaints and Complaint Reporting**

Complaints may be filed by mail or email to:

[Permittee Name]

[Permittee Complaint Contact]

[Permittee Address]

[Permittee Telephone Number]

[Permittee Email]

This information shall be maintained current by informing the Commission of any changes by eFiling, as they become effective.

**MINNESOTA PUBLIC UTILITIES COMMISSION  
COMPLIANCE FILING PROCEDURE FOR  
PERMITTED ENERGY FACILITIES**

**A. Purpose**

To establish a uniform and timely method of submitting information required by the Commission energy facility permits.

**B. Scope and Applicability**

This procedure encompasses all compliance filings required by permit.

**C. Definitions**

***Compliance Filing:*** A filing of information to the Commission, where the information is required by a Commission site or route permit.

**D. Responsibilities**

1. The permittee shall eFile all compliance filings with Dr. Burl W. Haar, Executive Secretary, Public Utilities Commission, through the eDockets system. The eDockets system is located at: <https://www.edockets.state.mn.us/EFiling/home.jsp>

General instructions are provided on the eDockets website. Permittees must register on the website to eFile documents.

2. All filings must have a cover sheet that includes:

- a. Date
- b. Name of submitter/permittee
- c. Type of permit (site or route)
- d. Project location
- e. Project docket number
- f. Permit section under which the filing is made
- g. Short description of the filing

3. Filings that are graphic intensive (e.g., maps, engineered drawings) must, in addition to being eFiled, be submitted as paper copies and on CD. Paper copies and CDs should be sent to: 1) Dr. Burl W. Haar, Executive Secretary, Minnesota Public Utilities Commission, 121 7th Place East, Suite 350, St. Paul, MN 55101-2147, and 2) Department of Commerce, Energy Facility Permitting, 85 7th Place East, Suite 500, St. Paul, MN 55101-2198.

The Commission may request a paper copy of any eFiled document.



**STATE OF MINNESOTA PUBLIC UTILITIES COMMISSION**

**ROUTE PERMIT FOR CONSTRUCTION OF A HIGH-VOLTAGE TRANSMISSION  
LINE AND ASSOCIATED FACILITIES**

**IN  
JACKSON, MARTIN, AND FARIBAULT COUNTIES**

**ISSUED TO  
ITC MIDWEST LLC**

**PUC DOCKET NO. ET-6675/TL-12-1337**

In accordance with the requirements of Minnesota Statutes Chapter 216E and Minnesota Rules Chapter 7850 this route permit is hereby issued to:

**ITC MIDWEST LLC**

ITC Midwest LLC is authorized by this route permit to construct and operate approximately 75 miles of new 345 kilovolt transmission line in Jackson, Martin, and Faribault counties, Minnesota.

The transmission line and associated facilities shall be built within the route identified in this permit and as portrayed on the official route maps, and in compliance with the conditions specified in this permit.

Approved and adopted this 25<sup>th</sup> day of November, 2014

BY ORDER OF THE COMMISSION



---

Burl W. Haar,  
Executive Secretary



This document can be made available in alternative formats (e.g., large print or audio) by calling 651.296.0406 (voice). Persons with hearing loss or speech disabilities may call us through their preferred Telecommunications Relay Service.

# CONTENTS

1.0	ROUTE PERMIT.....	1
1.1	Pre-emption.....	1
2.0	PROJECT DESCRIPTION.....	1
2.1	Project Location.....	1
2.2	Associated Facilities and Substations.....	2
2.2.1	Lakefield Junction Substation.....	2
2.2.2	Winnebago Junction Substation.....	2
2.2.3	Huntley Substation.....	3
2.2.4	Transmission Line Reconfiguration.....	3
2.3	Structures.....	4
2.4	Conductors.....	5
2.5	Safety Codes and Design Requirements.....	6
3.0	DESIGNATED ROUTE.....	6
3.1	Lakefield Junction to Huntley – Jackson County.....	6
3.2	Lakefield Junction to Huntley – Martin County.....	7
3.3	Lakefield Junction to Huntley – Faribault County.....	9
3.4	Huntley to Iowa Border – Faribault County.....	9
3.5	Transmission Line Reconfiguration between Winnebago Junction and Huntley Substations.....	10
4.0	RIGHT-OF-WAY.....	11
5.0	GENERAL CONDITIONS.....	12
5.1	Notification to Landowners.....	12
5.2	Construction Practices.....	12
5.2.1	Field Representative.....	12
5.2.2	Employee Training and Education of Permit Terms and Conditions.....	13
5.2.3	Public Services, Public Utilities, and Existing Easements.....	13
5.2.4	Temporary Work Space.....	13
5.2.5	Noise.....	14
5.2.6	Site Sediment and Erosion Control.....	14
5.2.7	Aesthetics.....	14
5.2.8	Vegetation Removal and Protection.....	15
5.2.9	Application of Herbicides.....	15
5.2.10	Noxious Weeds.....	15
5.2.11	Restoration.....	15
5.2.12	Wetlands and Water Resources.....	16

5.2.13	Archaeological and Historic Resources .....	16
5.2.14	Avian Mitigation .....	17
5.2.15	Cleanup.....	17
5.2.16	Pollution and Hazardous Wastes.....	17
5.2.17	Damages .....	17
5.3	Electrical Performance Standards .....	18
5.3.1	Grounding.....	18
5.3.2	Electric Field .....	18
5.3.3	Interference with Communication Devices.....	18
5.4	Other Requirements .....	18
5.4.1	Applicable Codes .....	18
5.4.2	Other Permits and Regulations.....	19
6.0	SPECIAL CONDITIONS.....	19
6.1	Construction Environmental Control Plan.....	19
6.2	Agriculture Mitigation Plan .....	20
6.3	Vegetation Management Plan.....	20
6.4	Avian Mitigation Plan.....	21
6.5	Des Moines River Crossing .....	21
7.0	DELAY IN CONSTRUCTION.....	21
8.0	COMPLAINT PROCEDURES .....	21
9.0	COMPLIANCE REQUIREMENTS.....	22
9.1	Plan and Profile.....	22
9.2	Periodic Status Reports.....	22
9.3	Notification to Commission.....	22
9.4	As-Builts .....	22
9.5	GPS Data.....	23
10.0	PERMIT AMENDMENT.....	23
11.0	TRANSFER OF PERMIT .....	23
12.0	REVOCATION OR SUSPENSION OF THE PERMIT .....	23

**FIGURES**

Official Route Maps

**ATTACHMENTS**

Attachment A – Complaint Procedures for High-Voltage Transmission Lines

Attachment B – Compliance Filing Procedures for Permitted Energy Facilities

## 1.0 ROUTE PERMIT

The Minnesota Public Utilities Commission (Commission) hereby issues this route permit to ITC Midwest LLC pursuant to Minnesota Statutes Chapter 216E and Minnesota Rules Chapter 7850. This permit authorizes ITC Midwest LLC (Permittee) to construct and operate approximately 75 miles of new 345 kilovolt (kV) transmission line in Jackson, Martin, and Faribault counties, Minnesota, and as identified in the attached route permit maps, hereby incorporated into this document.

### 1.1 Pre-emption

Pursuant to Minn. Stat. § 216E.10, this route permit shall be the sole approval required to be obtained by the Permittee for construction of the transmission facilities and this permit shall supersede and preempt all zoning, building, or land use rules, regulations, or ordinances promulgated by regional, county, local and special purpose government.

## 2.0 PROJECT DESCRIPTION

The Project includes the construction and operation of approximately 75 miles of new 345 kV transmission line in Jackson, Martin, and Faribault counties. The 345 kV transmission line would run east from the existing Lakefield Junction substation near the city of Lakefield in Jackson County, crossing Martin County to a new Huntley substation near the city of Winnebago in Faribault County. From the new Huntley substation, the transmission line would proceed south crossing the Minnesota-Iowa border near the city of Elmore, Minnesota. The Project also includes expanding the existing Lakefield Junction substation, constructing a new Huntley substation, reconfiguring several existing 69 kV and 161 kV transmission lines, and decommissioning the Winnebago substation.

### 2.1 Project Location

The Project is located in southern Minnesota in Jackson, Martin, and Faribault counties, specifically within the townships of Hunter, Des Moines, Belmont, Wisconsin, Jay, Manyaska, Fox Lake, Fraser, Rutland, Center Creek, Verona, Jo Daviess, and Pilot Grove.

County	Township Name	Township	Range	Section
Jackson	Hunter	T102N	R36W	1, 2, 3
	Des Moines	T102N	R35W	1, 2, 3, 4, 5, 6
	Belmont	T103N	R35W	34, 35, 36
	Wisconsin	T012N	R34W	1, 2, 3, 4, 5, 6

County	Township Name	Township	Range	Section
Martin	Jay	T102N	R33W	1, 2, 3, 4, 5, 6
	Manyaska	T102N	R32W	2, 3, 4, 5, 6
	Fox Lake	T103N	R32W	13, 24, 25, 26, 35, 36
	Fraser	T103N	R31W	13, 14, 15, 16, 17, 18, 19, 30
	Rutland	T103N	R30W	13, 14, 15, 16, 17, 18, 19, 20, 21
	Center Creek	T103N	R29W	13, 14, 15, 16, 17, 18
Faribault	Verona	T103N	R28W	9, 10, 11, 14, 15, 16, 17, 18, 22, 23, 26, 35
	Jo Daviess	T102N	R28W	2, 11, 14, 23, 26, 35
	Pilot Grove	T101N	R28W	2, 11, 14, 23, 26, 35, 36

**2.2 Associated Facilities and Substations**

The associated facilities for the Project include expansion of the existing Lakefield Junction substation, removal of the existing Winnebago Junction substation, construction of the new Huntley substation, reconfiguration of four 161 kV transmission lines, and reconfiguration of three 69 kV transmission lines to be constructed to 161 kV standards.

**2.2.1 Lakefield Junction Substation**

The Lakefield Junction substation is located in the southwest quarter of the northeast quarter of Section 3 in Hunter Township. The substation will be expanded east approximately three acres to house additional equipment as part of the Project. Grading will be required over the full three acres. The fenced area will only be expanded by approximately 2.2 acres. New equipment will include one 345 kV bay using one position and a future bay position to allow for three future connections.

**2.2.2 Winnebago Junction Substation**

The Winnebago Junction substation is located in the northwest quarter of the southeast quarter of Section of Section 11 in Verona Township. The substation will be decommissioned as part of the Project. Decommissioning will entail the removal of all substation infrastructure at the site including electrical equipment, foundations, gravel, and fencing. One 161 kV transmission line and two 69 kV transmission lines will remain on the property after the substation infrastructure is removed.

The site will be allowed to return to its natural state by reestablishing vegetation in areas not crossed by the remaining transmission line rights-of-way. ITC Midwest will continue to own and operate transmission lines across the parcel.

### 2.2.3 Huntley Substation

The new Huntley substation will be constructed on a 32-acre parcel located in the southwest quarter of the southeast quarter of Section 14 in Verona Township. The substation fenced area will be approximately 12 acres and will include a control building. The remainder of the 32-acre parcel will be graded to allow for property setbacks, line clearances, retention pond, and road access requirements. Equipment to be installed within the fenced area includes a 40 MVAR bank of reactors, one 345 kV/161 kV transformer, two 161 kV/69 kV transformers, two 345 kV breaker-and-a-half bays with three 345 kV breakers, four 161 kV breaker-and-a-half bays with eleven 161 kV breakers, three 69 kV breakers, associated switches, steel, foundations, and dead end structures. The substation will be designed to allow for future installation of two 345 kV breaker-and-a-half bays and one additional 161 kV breaker-and-a-half bay.

### 2.2.4 Transmission Line Reconfiguration

The Project will include the reconfiguration of four existing 161 kV transmission lines and three existing 69 kV transmission that currently terminate at the Winnebago Junction substation that will be decommissioned. The seven transmission lines will be reconfigured and rerouted from the Winnebago Junction substation to the Huntley substation as follows:

- The existing 161 kV Rutland – Winnebago Junction will be constructed on single pole double-circuit structures with the new 345 kV transmission line and operated at 345 kV/161 kV.
- The existing 161 kV N.B.E.I – Winnebago Junction and the 69 kV Winnebago Local – Winnebago Junction transmission lines will be constructed on single pole double-circuit structures to 161 kV/161 kV standards but operated at 161 kV/69 kV (Local/N.B.E.I – Huntley).
- The existing 161 kV Freeborn – Winnebago Junction and the 69 kV Blue Earth – Winnebago Junction transmission lines will be constructed on single pole double-circuit structures to 161 kV/161 kV standards but operated at 161 kV/69 kV (Blue Earth/Freeborn – Huntley).

- The existing 69 kV Walters – Winnebago Junction transmission will not be co-located with another line but will instead be constructed on single pole structures to 161 kV standards but operated at 69 kV (Walters – Huntley).

The portions of rights-of-way currently occupied by the existing 161 kV Rutland – Winnebago Junction and the 69 kV Blue Earth – Winnebago Junction transmission lines will no longer be needed after the Project is constructed and will be abandoned.

### 2.3 Structures

The primary tangent structures authorized for the Project be will single pole galvanized or self-weathering steel davit arm structures capable of supporting one 345 kV circuit and one 161 kV circuit. The structures will be 130 to 190 feet in height with an average span of 700 to 1,000 feet between structures and will be supported by an approximately 8-foot diameter 25-foot deep drilled pier concrete foundation.

Specialty structures authorized for the Project may include angle, dead-end, H-frame, multiple pole, and low profile. The table below details specifics on the various structure types as presented in the route permit application.

Line Type	Initial Operation	Structure Type	Right-of-way (feet)	Height (feet)	Structure Base	Foundation	Span (feet)
					Diameter (feet)		
345 kV/161 kV	345 kV/161 kV or 345 kV/None	Single Pole Davit Arm	150	130-190	5-9	8-12	700-1,000
		Single Pole Davit Arm Low Profile	150	100-160	5-9	8-12	500-1,000
		Two Pole	150	130-190	9	12	700-1,000
		Three Pole Low Profile	150	100-160	9	12	500-1,000
345 kV/161 kV/69 kV	345 kV/161 kV/69 kV	Single Pole Davit Arm	150	175-195	9	12	600-800
345 kV/161 kV/69 kV	345 kV/161 kV/69 kV	2 Pole Deadend	150	175-195	11	14	600-800
345 kV/161 kV/69 kV	345/69 kV	Single pole davit arm with Underbuild	150	130-190	7	10	600-800

345 kV/161 kV/69 kV	345/69 kV	1 Pole Deadend	150	130-190	11	14	600-800
345 kV/161 kV	345 kV/69 kV	Single Pole Davit Arm	150	130-190	5-9	8-12	700-1,000
		Two Pole	150	130-190	9	12	700-1000
161 kV/161 kV	161 kV/161 kV or 161 kV/69 kV	Single Pole Braced Post	100	80-120	3.5-7	10 (Angle)	600-800
		Single Pole Davit Arm	100	80-120	7	10	600-800
161 kV	69 kV	Single Pole Braced Post	100	70-110	3-5	8 (Angle)	600-800
		Single Pole Davit Arm	100	70-110	5	8	600-800

Note: All structures will be comprised of galvanized or self-weathering steel.

## 2.4 Conductors

Each 345 kV phase wire for the Project will consist of two twisted pair Drake 795-circular mil 26/7 aluminum conductor steel reinforced (ACSR) conductors, or equivalent 3,000 amp conductor. Each ACSR cable consists of a core of seven steel conductors surrounded by 26 aluminum strands. The 345 kV twisted pair conductors (two sets for each of the three phases) will have a capacity equivalent to 3,000 amps. The same conductor and bundled configuration will be used for all the 345 kV sections of the transmission line in Minnesota. The minimum conductor clearance for the 345 kV transmission line between the ground and lowest point of the conductor will measure 35 feet.

Each 161 kV phase wire for the Project will consist of twisted pair Drake 795-circular mil 26/7 (ACSR) conductors, or equivalent 1,600 ampere conductor. The 161 kV line from N.B.E.I. to Huntley will consist of aluminum conductor steel supported 565-circular mil Calumet, or equivalent 1,400 amp conductor. The minimum conductor clearance for the 161 kV transmission line between the ground and lowest point of the conductor will measure 25 feet.

The 69 kV transmission lines to be relocated from the Winnebago Junction substation to the Huntley substation will consist of twisted pair Drake 795-circular mil 26/7 ACSR conductors, or comparable conductor. Other 69 kV conductors for the Project will consist of 600 amp conductor, or equivalent conductor. The minimum conductor clearance for the 69 kV transmission line between the ground and lowest point of the conductor will measure 21 feet.

An approximately 1-inch diameter shield wire will be installed above the conductors for lightning protection. The shield wire may include a fiber optic cable that allows for substation protection equipment to communicate with other terminals on the line.

## **2.5 Safety Codes and Design Requirements**

The transmission line and associated facilities shall be designed to meet or exceed all relevant local and state codes, the National Electric Safety Code (NESC), and North American Electric Reliability Corporation (NERC) requirements. This includes standards relating to clearances to ground, clearance to crossing utilities, clearance to buildings, strength of materials, clearances over roadways, right-of-way widths, and permit requirements. The transmission line shall be equipped with protective devices to safeguard the public if an accident occurs.

## **3.0 DESIGNATED ROUTE**

The route for the Project will vary in width from 1,000 feet and 2,200 feet. The widths greater than 1,000 feet are as follows: Des Moines River (1,400 feet); south of Lake Charlotte (1,200 feet); east of Lake Charlotte near State Highway 15 (1,400 feet); south of and adjacent to the Proposed Huntley substation (2,200 feet); and along the Blue Earth River south of the Proposed Huntley Substation (1,700 feet).

### **3.1 Lakefield Junction to Huntley – Jackson County**

In Jackson County, the route originates at ITC Midwest's existing Lakefield Junction substation, located in Section 3 in Hunter Township. The route extends southeast from the Lakefield Junction Substation approximately 0.5 mile (north of 810th Street) and joins the existing Lakefield to Border 161 kV transmission line. It continues east approximately 0.5 mile until crossing 470th Street. From here, the route continues east through the middle of Sections 2 and 1 in Hunter Township for approximately two miles until reaching 490th Avenue. Before reaching 490th Avenue and for a short distance after crossing 490th Avenue, the route deviates slightly from the existing Lakefield to Border 161 kV transmission line. The existing 161 kV line will be removed from its current location and co-located with the new 345 kV line for approximately 1,900 feet as it crosses 490th Avenue. The route continues east through the middle of Sections 6 and 5 in Des Moines Township for approximately 1.8 miles. The route then turns to the southeast then east for approximately 1.6 miles crossing through the southern half of Section 4 in Des Moines Township to the middle of Section 3 where the route reaches the western bank of the Des Moines River. From this location, there are two options for crossing the Des Moines River in Section 3 of Des Moines Township. Both options would remove the existing Lakefield to Border 161 kV transmission line for 1.5 mile through Section 2 and the western half of Section 1 of Des Moines Township. In this area, the route width expands to a maximum of 1,400 feet for approximately 0.5 mile:

### Alignment Option 1

The first option for crossing the Des Moines River is to follow the alignment, which deviates from the existing Lakefield to Border 161 kV transmission line to cross the Des Moines River perpendicularly for approximately 2,700 feet in a northeast direction. From this point, the alignment turns north before reaching Section 2 of Des Moines Township. Use of route alignment across the Des Moines River would remove the existing Lakefield to Border 161 kV transmission line from its current crossing of the Des Moines River.

### Alignment Option 2

The second option for crossing the Des Moines River is to follow an alignment, which crosses the Des Moines River along the existing Lakefield to Border 161 kV transmission line centerline for approximately 3,100 feet in a northeast, then east direction. From this point, the alignment turns north before reaching Section 2 of Des Moines Township.

After the crossing of the Des Moines River, the route continues north for another 0.5 mile to 820th Street, where it turns east. The route extends along 820th Street for 0.6 mile, continuing east for an additional mile and across U.S. Highway 71 between Sections 3, 2, and 1 of Des Moines Township and 34, 35, and 36 of Belmont Township, respectively. The route then turns south, 0.5 mile east of U.S. Highway 71 in Section 1 of Des Moines Township. The route extends south for 0.5 mile and rejoins the alignment of the existing Lakefield to Border 161 kV transmission line. It turns east in the middle of Section 1 of Des Moines Township, and extends another 0.5 mile to 550th Avenue/County Road 23 and Wisconsin Township. From here, the route continues through the middle of Sections 6, 5, 4, 3, 2, and 1 of Wisconsin Township along field lines for approximately 6 miles until reaching 10th Avenue and the Martin County line. In Section 5, the route deviates from the existing Lakefield to Border 161 kV transmission line for 1,300 feet and the 161 kV and 345 kV transmission lines would be co-located along the new alignment.

## **3.2 Lakefield Junction to Huntley – Martin County**

In Martin County, the route continues eastward in Jay Township from the Jackson County border. Between Section 6 and 5 at 20th Street, the existing 161 kV line will be relocated, and co-located with the 345 kV line for approximately 2,000 feet. The route continues through the middle of Sections 6, 5, 4, 3, 2 and 1 for six miles until just west of Fox Lake. The route continues east through the middle of Section 6 of Manyaska Township in Section 6 for one mile. The route then deviates from the existing Lakefield to Border 161 kV transmission line, continues east into Section 5 for approximately 0.3 mile and continues east before turning south across Interstate 90 and then east along the south side of the Interstate for 1.7 miles through Sections 5 and 4 of Manyaska Township.

The existing ITC Midwest 69 kV Fox Lake to Fairmont transmission line currently located north of 125th Street would be removed from this location and would be co-located with the new 345 kV transmission line along the new route south of Interstate 90. At the border between Sections 4 and 3 of Manyaska Township, the route crosses to the north side of Interstate 90 and 125th Street, before turning east for approximately 0.8 mile. The route continues east, north, and northeast along the existing ITC Midwest 69 kV Fox Lake to Fairmont transmission line for approximately 1.3 miles through Sections 3 and 2 of Manyaska Township and Section 35 of Fox Lake Township, crossing over an existing Union Pacific Railroad line and 110th and 120th Avenues. In Section 35 of Fox Lake Township, the route A continues north and separates from the existing 69 kV transmission line where it turns east. The route continues north in Section 35 of Fox Lake Township for approximately 0.5 mile crosses into Section 26 at 140th Street where it turns east. The route continues east along the border of Sections 26/35 and 25/36 along 140th Street for 1.5 miles where it reaches 130th Avenue, and turns to the north. The route continues north along 130th Avenue for approximately 2.5 miles through Sections 30, 19, and 18 of Frasier Township where it rejoins the existing Lakefield to Border 161 kV transmission line.

The route turns east along field lines through the center of Sections 18, 17, 16, 15, 14, and 13 of Frasier Township for approximately 5.5 miles. In Section 17, the existing 161 kV line is proposed to be relocated with the new 345 kV for approximately 1,000 feet; and in 1,500 feet in Section 15. In the middle of Section 13 of Frasier Township, the route turns south, deviating from the existing Lakefield to Border 161 kV transmission line that extends across Lake Charlotte. The route continues south along a field line for 0.5 mile where it turns east along 160th Street. The route continues east along of 160th Street for approximately 0.5 mile until crossing 190th Avenue and into Rutland Township.

In Rutland Township, the route continues along 160th Street and along the existing Great River Energy FE-RU 69 kV transmission line as it continues east for approximately 2.2 miles between Sections 18 and 19, and 17 and 20 of Rutland Township. Along this section, the route width is expanded to approximately 1,200 feet and the existing line is proposed to be relocated slightly for approximately 1,100 feet along 160th Street. As the route crosses between Sections 16 and 21 of Rutland Township, it is no longer co-located with the existing 69 kV transmission line. The route continues east along 160th Street for 0.5 mile where it turns north along a field line for approximately 0.5 mile before turning east and rejoining with the existing Lakefield to Border 161 kV transmission line in Section 16 of Rutland Township. From Section 16 into Section 15 of Rutland Township, the route width is expanded to approximately 1,400 feet and the existing 161 kV line is proposed to be relocated slightly for approximately 1,600 feet just west of 220th Avenue/State Highway 15.

The route crosses State Highway 15 and continues east along field lines for 3.5 miles through Sections 16, 15, 14, and 13 of Rutland Township before entering Center Creek Township, crossing 230th and 240th Avenues and Judicial Ditch Number Three. The route continues east for approximately one mile, crossing 255th Avenue and County Highway 53 (260th Avenue) in Section 18 of Center Creek Township. It continues east for an additional five miles along field lines through Sections 17, 16, 15, 14, and 13, of Center Creek Township, crossing 265th, 280th, 288th, 290th (County Road 159), 293rd (County Highway 59), and 298th Avenues before reaching the Faribault County line. In this area, the route also crosses Judicial Ditches One, Twenty-Eight, and Forty. The route also crosses a Canadian Pacific rail line in the middle of Section 13 of Center Creek Township.

### **3.3 Lakefield Junction to Huntley – Faribault County**

From the Martin/Faribault County border, the route extends northeast into Verona Township through Sections 18, 17, 9/16, and 10/15 for approximately 3.2 miles, still co-located with the existing Lakefield to Border 161 kV transmission line. The route then turns south along a field line in Section 15 of Verona Township to 160th Street. At this point the existing 161 kV line that continues east to the existing Huntley substation site would be removed and collocated with the new 345 kV line. At 160th Street, Modified Route A turns east and continues along the north side of the road between Sections 15/22 and 14/23 of Verona Township for approximately 1.3 miles to the new Huntley substation site.

### **3.4 Huntley to Iowa Border – Faribault County**

Just south of the Huntley Substation in Section 23 of Verona Township, the route includes a wider triangular-shaped area measuring 2,200 feet at its widest along the southern boundary of the new Huntley substation to accommodate positioning of the circuits into the substation. From the new Huntley substation, the route extends south along the existing Lakefield to Border 161 kV transmission line for approximately 0.3 mile where it turns southwest along the west bank of the Blue Earth River in Section 23 of Verona Township. The route then continues south and then southeast, reconnecting with the existing Lakefield to Border 161 kV transmission line approximately 0.4 mile (approximately 400 feet) before 150th Street. This area is approximately 0.9 mile long through Section 23 in Verona Township and has an expanded route width of approximately 2,200 feet. The existing Lakefield to Border 161 kV transmission line will be moved from its current alignment in Section 23 to follow the new route in this area. The route then continues south along the existing line for approximately two miles in Verona Township, Sections 23, 26, and 35. It crosses 160th, 150th, 140th, and 130th (County Highway 8) Streets, as well as South Creek in several locations.

The route continues south approximately two miles along field lines into Jo Daviess Township through Sections 2 and 11, crossing Interstate 90, 120th Street, County Ditch Number Sixty, and 115th Street. After crossing 115th Street, the route follows 355th Avenue for 0.5 mile, crossing a rail line and extending to 110th Street (County Highway 16). The route then continues south from 110th Street along the existing 161 kV line for two miles, through Sections 14 and 23 Jo Daviess Township, crossing 100th Street and Little Badger Creek. The route deviates from the existing 161 kV Lakefield to Border transmission line and turns southeast as it crosses 90th Street (County Highway 6). The route continues south and then back west to join with the existing 161 kV line. A portion of the existing 161 kV line would be relocated in Section 26 of Jo Daviess Township to move it farther from a home for approximately 1,000 feet where the new route crosses 85th Street. The route continues south along the existing Lakefield to Border 161 kV Transmission Line and field lines for approximately 1.3 miles through Sections 26 and 35 of Jo Daviess Township, crossing 80th and 70th Streets.

The route enters Pilot Grove Township in Section 2, and extends south, continuing along field lines and co-locating with the existing Lakefield to Border 161 kV transmission line, through the Pilot Grove Lake WPA and Sections 11, 14 and 23. The route crosses 60th, 50th, 40th, and 30th Streets, and follows Judicial Ditch Number Seven for 0.3 mile before crossing it in Section 23. The route turns east along 30th Street between Sections 23 and 26 of Pilot Grove Township, continuing to follow the existing Lakefield to Border 161 kV transmission line for approximately 0.5 mile before turning south along 360th Avenue and the existing line. The route continues south to the Iowa border along the existing Lakefield to Border 161 kV transmission line through Sections 26, 25, 35 and 36 of Pilot Grove Township crossing the West Branch of the Blue Earth River (Section 36) before reaching the Minnesota/Iowa border at the intersection of 510th Street (Minnesota) and 160th Avenue (Iowa). Between Section 35 and 36, the existing Lakefield to Border 161 kV transmission line is proposed to be relocated slightly for approximately 1,400 feet.

### **3.5 Transmission Line Reconfiguration between Winnebago Junction and Huntley Substations**

The proposed construction configuration of the associated facilities will occur within a 500-foot route width between the Winnebago Junction substation and the Huntley substation and a 500-foot route width approximately 0.4 mile long along 170th Street. The existing Rutland—Winnebago Junction transmission line will be removed from Sections 11 and 10 of Verona Township. The existing Blue Earth—Winnebago Junction transmission line will be removed in Section 11 of Verona Township between 170th Street and the Winnebago Junction substation (See route maps 2 and 2A).

#### 4.0 RIGHT-OF-WAY

The approved rights-of-way for the Project are as follows:

- 345 kV single-circuit structures, 161/345 kV double-circuit structures, and 69/161/345 kV triple-circuit structures shall be constructed and maintained within a 150-foot right-of-way. The Permittee will have vegetation management rights and will prohibit placement of other structures within the 150-foot right-of-way. The Permittee may trim or remove trees that pose a threat to the transmission facility within the 25-foot area adjacent to and on either side of the 150-foot right-of-way in accordance with the Vegetation Management Plan.
- 345 kV/161 kV double-circuit structures that cross through the Pilot Grove Lake Waterfowl Production Area shall be constructed and maintained within the existing 100-foot right-of-way.
- 161 kV/161 kV double-circuit capable and 161 kV single-circuit structures shall be constructed and maintained within a 100-foot right-of-way. The Permittee will have vegetation management rights and will prohibit placement of other structures within the 100-foot right-of-way. The Permittee may trim or remove trees that pose a threat to the transmission facility within the 25-foot area adjacent to and on either side of the 100-foot right-of-way in accordance with the Vegetation Management Plan.
- The Permittee shall utilize its existing rights-of-way associated with the existing single circuit 161 kV transmission line being replaced to the greatest extent possible.

This permit anticipates that the right-of-way will generally conform to the alignment identified on the attached route permit maps unless changes are requested by individual landowners and agreed to by the Permittee or for unforeseen conditions that are encountered or are otherwise provided for by this permit.

Any alignment modifications within the designated route shall be located so as to have comparable overall impacts relative to the factors in Minn. R. 7850.4100, as does the alignment identified in this permit, and shall be specifically identified and documented in and approved as part of the plan and profile submitted pursuant to Section 9.1 of this permit.

Where the transmission line route parallels existing highway and other road rights-of-way, the transmission line right-of-way shall occupy and utilize the existing right-of-way to the maximum extent possible, consistent with the criteria in Minn. R. 7850.4100, the other requirements of this permit, and for highways under the jurisdiction of the Minnesota Department of Transportation (Mn/DOT) rules, policies, and procedures for accommodating utilities in trunk highway rights-of-way.

## **5.0 GENERAL CONDITIONS**

The Permittee shall comply with the following conditions during construction of the transmission line and associated facilities over the life of this permit.

### **5.1 Notification to Landowners**

The Permittee shall provide all affected landowners with a copy of this permit and, as a separate information piece, the complaint procedures at the time of the first contact with the landowners after issuance of this permit. The Permittee shall contact landowners prior to entering the property or conducting maintenance along the route. The Permittee shall work with landowners to locate the high-voltage transmission line to minimize the loss of agricultural land, forest, and wetlands, and to avoid homes and farmsteads.

At the time of first contact, the Permittee shall also provide all affected landowners with a copy of the Department of Commerce's Rights-of-Way and Easements for Energy Facility Construction and Operation fact sheet.<sup>1</sup>

### **5.2 Construction Practices**

The Permittee shall follow those specific construction practices and material specifications described in ITC Midwest's Application to the Commission for a Route Permit for the Minnesota – Iowa 345 kV Transmission Project and Associated Facilities in Jackson, Martin, and Faribault Counties, dated March 28, 2013, unless this permit establishes a different requirement in which case this permit shall prevail.

#### **5.2.1 Field Representative**

At least 14 days prior to commencing construction, the Permittee shall advise the Commission in writing of the person or persons designated to be the field representative for the Permittee with the responsibility to oversee compliance with the conditions of this permit during construction.

---

<sup>1</sup> [http://mn.gov/commerce/energyfacilities/documents/Easements%20Fact%20Sheet\\_08.05.14.pdf](http://mn.gov/commerce/energyfacilities/documents/Easements%20Fact%20Sheet_08.05.14.pdf)

This person shall be accessible by telephone during normal business hours throughout right-of-way preparation, construction, cleanup, and restoration.

The field representative's address, phone number, emergency phone number, and email shall be provided to the Commission and shall be made available to affected landowners, residents, public officials and other interested persons. The Permittee may change the field representative at any time upon notice to landowners and the Commission.

#### 5.2.2 Employee Training and Education of Permit Terms and Conditions

The Permittee shall inform all employees, contractors, and other persons involved in the transmission line construction of the terms and conditions of this permit.

#### 5.2.3 Public Services, Public Utilities, and Existing Easements

During construction, the Permittee shall minimize any disruption to public services or public utilities. To the extent disruptions to public services or public utilities occur these would be temporary and the Permittee will restore service promptly. Where any impacts to utilities have the potential to occur the Permittee will work with both landowners and local agencies to determine the most appropriate transmission structure placement.

The Permittee shall work with the landowners, townships, cities, and counties along the route to accommodate concerns regarding tree clearing, distance from existing structures, drain tiles, pole depth and placement in relationship to existing roads and road expansion plans.

The Permittee shall cooperate with county and city road authorities to develop appropriate signage and traffic management during construction.

#### 5.2.4 Temporary Work Space

The Permittee shall limit temporary easements to special construction access needs and additional staging or lay-down areas required outside of the authorized right-of-way. Temporary space shall be selected to limit the removal and impacts to vegetation. Temporary easements outside of the authorized transmission line right-of-way will be obtained from affected landowners through rental agreements and are not provided for in this permit.

Temporary driveways may be constructed between the roadway and the structures to minimize impact using the shortest route possible. Construction mats should also be used to minimize impacts on access paths and construction areas.

#### 5.2.5 Noise

Construction and routine maintenance activities shall be limited to daytime working hours, as defined in Minn. R. 7030.0200, to ensure nighttime noise level standards will not be exceeded.

#### 5.2.6 Site Sediment and Erosion Control

The Permittee shall implement those erosion prevention and sediment control practices recommended by the Minnesota Pollution Control Agency (MPCA) Construction Stormwater Program.

The Permittee shall implement reasonable measures to minimize erosion and sedimentation during construction and shall employ perimeter sediment controls, protect exposed soil by promptly planting, seeding, using erosion control blankets and turf reinforcement mats, stabilizing slopes, protecting storm drain inlets, protecting soil stockpiles, and controlling vehicle tracking. Contours shall be graded as required so that all surfaces provide for proper drainage, blend with the natural terrain, and are left in a condition that will facilitate re-vegetation and prevent erosion. All areas disturbed during construction of the facilities shall be returned to pre-construction conditions.

Where larger areas of one acre or more are disturbed or other areas designated by the MPCA, the Permittee shall obtain a National Pollutant Discharge Elimination System (NPDES)/State Disposal System (SDS) Construction Stormwater permit from the MPCA.

#### 5.2.7 Aesthetics

The Permittee shall consider input pertaining to visual impacts from landowners or land management agencies prior to final location of structures, rights-of-way, and other areas with the potential for visual disturbance. Care shall be used to preserve the natural landscape, minimize tree removal and prevent any unnecessary destruction of the natural surroundings in the vicinity of the Project during construction and maintenance.

Structures shall be placed at a distance, consistent with sound engineering principles and system reliability criteria, from intersecting roads, highway, or trail crossings and could cross roads to minimize or avoid impacts.

### 5.2.8 Vegetation Removal and Protection

The Permittee shall minimize the number of trees to be removed in selecting the right-of-way specifically preserving to the maximum extent practicable windbreaks, shelterbelts, living snow fences, and vegetation in areas such as trail and stream crossings where vegetative screening may minimize aesthetic impacts, to the extent that such actions do not violate sound engineering principles or system reliability criteria.

Tall growing species located within the transmission line right-of-way that endanger the safe and reliable operation of the transmission facility will be removed by the Permittee. The Permittee shall leave undisturbed, to the extent possible, existing low growing species in the right-of-way or replant such species in the right-of-way to blend the difference between the right-of-way and adjacent areas, to the extent that the low growing vegetation that will not pose a threat to the transmission facility or impede construction.

### 5.2.9 Application of Herbicides

The Permittee shall restrict herbicide use to those herbicides and methods of application approved by the Minnesota Department of Agriculture and the U.S. Environmental Protection Agency. Selective foliage or basal application shall be used when practicable. The Permittee shall contact the landowner or his designee to obtain approval for the use of herbicide prior to any application on their property. The landowner may request that there be no application of herbicides on any part of the right-of-way within the landowner's property. All herbicides shall be applied in a safe and cautious manner so as not to damage crops, orchards, tree farms, or gardens.

### 5.2.10 Noxious Weeds

The Permittee shall take all reasonable precautions against the spread of noxious weeds during all phases of construction. When utilizing seed to establish temporary and permanent vegetative cover on exposed soil the Permittee shall select site appropriate seed certified to be free of noxious weeds. To the extent possible, the Permittee shall use native seed mixes. The Permittee shall consult with landowners on the selection and use of seed for replanting.

### 5.2.11 Restoration

The Permittee shall restore the right-of-way, temporary work spaces, access roads, abandoned right-of-way, and other public or private lands affected by construction of the transmission line.

Restoration within the right-of-way must be compatible with the safe operation, maintenance, and inspection of the transmission line. Within 60 days after completion of all restoration activities, the Permittee shall advise the Commission in writing of the completion of such activities.

#### 5.2.12 Wetlands and Water Resources

Wetland impact avoidance measures that shall be implemented during design and construction of the transmission line will include spacing and placing the power poles at variable distances to span and avoid wetlands, watercourses, and floodplains.

Unavoidable wetland impacts as a result of the placement of poles shall be limited to the immediate area around the poles. To minimize impacts, construction in wetland areas shall occur during frozen ground conditions. When construction during winter is not possible, wooden or composite mats shall be used to protect wetland vegetation. Soil excavated from the wetlands and riparian areas shall be contained and not placed back into the wetland or riparian area.

Wetlands and riparian areas shall be accessed using the shortest route possible in order to minimize travel through wetland areas and prevent unnecessary impacts. No staging or stringing set up areas shall be placed within or adjacent to wetlands or water resources, as practicable. Power pole structures shall be assembled on upland areas before they are brought to the site for installation.

Areas disturbed by construction activities shall be restored to pre-construction conditions. Restoration of the wetlands will be performed by Permittee in accordance with the requirements of applicable state and federal permits or laws and landowner agreements.

All requirements of the U.S. Army Corps of Engineers (wetlands under federal jurisdiction), Minnesota Department of Natural Resources (Public Waters/Wetlands), and County (wetlands under the jurisdiction of the Minnesota Wetland Conservation Act) shall be met.

#### 5.2.13 Archaeological and Historic Resources

The Permittee shall consult with the State Historic Preservation Office (SHPO) concerning the extent of a Phase I archaeological survey and appropriate mitigation measures for the Project. Permittee shall document and submit to the Commission the results of the consultation, including those portions of the Project that will be surveyed and the extent of the survey with the Construction Environmental Control Plan for the Project.

For those portions of the Project that are surveyed, Permittee shall submit, with the plan and profile for these portions, the results of the survey and all applicable avoidance and mitigation measures employed or to be employed.

Permittee shall inform construction personnel of known archaeological resources along the permitted route for the Project and of archaeological survey results. Permittee shall employ a monitor that reports to and communicates with the Environmental Monitor to identify and report archaeological resources encountered during construction of the Project and to coordinate with SHPO on appropriate mitigation measures.

#### 5.2.14 Avian Mitigation

The Permittee's standard transmission design shall incorporate adequate spacing of conductors and grounding devices in accordance with Avian Power Line Interaction Committee standards to eliminate the risk of electrocution to raptors with larger wingspans that may simultaneously come in contact with a conductor and grounding devices.

The Permittee will consult with the Minnesota Department of Natural Resources regarding type and placement of bird diverters.

#### 5.2.15 Cleanup

All waste and scrap that is the product of construction shall be removed from the right-of-way and all premises on which construction activities were conducted and properly disposed of upon completion of each task. Personal litter, including bottles, cans, and paper from construction activities shall be removed on a daily basis.

#### 5.2.16 Pollution and Hazardous Wastes

All appropriate precautions to protect against pollution of the environment must be taken by the Permittee. The Permittee shall be responsible for compliance with all laws applicable to the generation, storage, transportation, clean up and disposal of all wastes generated during construction and restoration of the right-of-way.

#### 5.2.17 Damages

The Permittee shall fairly compensate landowners for damage to crops, fences, private roads and lanes, landscaping, drain tile, or other damages sustained during construction.

## **5.3 Electrical Performance Standards**

### **5.3.1 Grounding**

The Permittee shall design, construct, and operate the transmission line in a manner so that the maximum induced steady-state short-circuit current shall be limited to five milliamperes root mean square (rms) alternating current between the ground and any non-stationary object within the right-of-way, including but not limited to large motor vehicles and agricultural equipment. All fixed metallic objects on or off the right-of-way, except electric fences that parallel or cross the right-of-way, shall be grounded to the extent necessary to limit the induced short-circuit current between ground and the object so as not to exceed one milliamperes rms under steady state conditions of the transmission line and to comply with the ground fault conditions specified in the NESC. The Permittee shall address and rectify any induced current problems that arise during transmission line operation.

### **5.3.2 Electric Field**

The transmission line shall be designed, constructed, and operated in such a manner that the electric field measured one meter above ground level immediately below the transmission line shall not exceed 8.0 kV/m rms.

### **5.3.3 Interference with Communication Devices**

If interference with radio or television, satellite, wireless internet, GPS-based agriculture navigation systems or other communication devices is caused by the presence or operation of the transmission line, the Permittee shall take whatever action is feasible to restore or provide reception equivalent to reception levels in the immediate area just prior to the construction of the line.

## **5.4 Other Requirements**

### **5.4.1 Applicable Codes**

The Permittee shall comply with applicable NERC planning standards and requirements of the NESC including clearances to ground, clearance to crossing utilities, clearance to buildings, right-of way widths, erecting power poles, and stringing of transmission line conductors.

#### 5.4.2 Other Permits and Regulations

The Permittee shall comply with all applicable state rules and statutes. The Permittee shall obtain all required permits for the Project and comply with the conditions of these permits. A list of the permits known to be required is included in the permit application. The Permittee shall submit a copy of such permits to the Commission upon request.

### 6.0 SPECIAL CONDITIONS

The Permittee shall provide a report to the Commission as part of the plan and profile submission that describes the actions taken and mitigative measures developed regarding the Project and the following special conditions. Special conditions shall take precedence over other conditions of this permit should there be a conflict.

#### 6.1 Construction Environmental Control Plan

The Permittee shall develop a Construction Environmental Control Plan (CECP) that shall include all environmental control plans and special conditions imposed by permits or licenses issued by state or federal agencies related to agency-managed resources. Plans within the CECP shall include the Agricultural Impact Mitigation Plan, the Avian Mitigation Plan, the Vegetation Management Plan, and a Stormwater Pollution Prevention Plan. The CECP shall be filed with the Commission 30 days prior to submitting the plan and profile for any segment of the Project. The CECP shall include the following:

1. Identification of and contact information for an Environmental Monitor to oversee the construction process and monitor compliance with the Construction Environmental Control Plan and all plans therein.
2. A process for regular reporting on construction status and the results of construction inspection and monitoring to the Commission.
3. A process for reporting the status of permits and licenses or other approvals from local units of government, state agencies, or federal agencies for the Project to the Commission.
4. A process for internal tracking of construction management, including required plan or permit inspection forms.

## **6.2 Agriculture Mitigation Plan**

The Permittee shall comply with the Agricultural Impact Mitigation Plan (AIMP) prepared for this Project and approved by the Minnesota Department of Agriculture. The Permittee shall distribute the AIMP with the route permit to all affected landowners in accordance with Section 5.1 of this permit.

## **6.3 Vegetation Management Plan**

The Permittee shall develop a Vegetation Management Plan (VMP). The Permittee shall submit the VMP with the CECP and monitor compliance with the VMP in accordance with the procedures set forth in the VMP. The purpose of the VMP shall be to identify measures to minimize the disturbance and removal of vegetation for the Project, prevent the introduction of noxious weeds and invasive species, and re-vegetate disturbed non-cropland areas with appropriate native species in cooperation with landowners and state, federal, and local resource agencies, in such a way that does not negatively impact the safe and reliable operation of the Project. The VMP shall include:

1. Measures that will be taken to minimize vegetation disturbance and removal during construction of the Project to the extent that such actions do not violate sound engineering principles or system reliability criteria.
2. Measures that will be taken to prevent the introduction of non-native and invasive species.
3. Measures that will be taken to re-vegetate disturbed non-cropland areas with appropriate native species to the extent that such actions do not violate sound engineering principles or system reliability criteria.
4. Processes by which Permittee will identify landowner and resource agency preferences or requirements regarding vegetation management (e.g. no herbicide application, etc.) and how these preferences or requirements will be addressed.
5. Measures that will be taken to manage vegetation during operation and maintenance of the Project, including tall tree species within and outside of the permitted right-of-way that endanger the safe and reliable operation of the transmission line, in accordance with this permit and any local, state, or federal permits, licenses, or approvals.

#### **6.4 Avian Mitigation Plan**

The Permittee shall develop an avian mitigation plan (AMP). The Permittee shall submit and implement the plan in accordance with the CECP for the Project. The Purpose of the AMP shall be to identify site-specific risks to avian species from the Project and to identify and implement strategies to avoid and mitigate potential impacts to these species, including but not limited to, the use of bird flight diverters. The AMP shall include and document Permittee's consultation with the DNR and the U.S. Fish and Wildlife Service (USFWS) in the development of the AMP.

#### **6.5 Des Moines River Crossing**

The Permittee shall consult with the DNR regarding the feasibility of mitigation measures for the crossing of the Des Moines River, and shall jointly determine with the DNR the alignment and mitigation measures that best mitigate avian impacts and impacts to the Oak- Basswood forest at the Des Moines River crossing. The Permittee shall document this consultation and the alignment and mitigation measures agreed upon by the Permittee and the DNR for the crossing. The Permittee shall submit this information with the plan and profile for this section of the Project.

#### **7.0 DELAY IN CONSTRUCTION**

If the Permittee has not commenced construction or improvement of the route within four years after the date of issuance of this permit the Permittee shall file a report on the failure to construct and the Commission shall consider suspension of the permit in accordance with Minn. R. 7850.4700.

#### **8.0 COMPLAINT PROCEDURES**

Prior to the start of construction, the Permittee shall submit to the Commission the procedures that will be used to receive and respond to complaints. The procedures shall be in accordance with the requirements of Minn. R. 7829.1500 or Minn. R. 7829.1700, and as set forth in the complaint procedures attached to this permit.

Upon request, the Permittee shall assist the Commission with the disposition of unresolved or longstanding complaints. This assistance shall include, but is not limited to, the submittal of complaint correspondence and complaint resolution efforts.

## **9.0 COMPLIANCE REQUIREMENTS**

Failure to timely and properly make compliance filings required by this permit is a failure to comply with the conditions of this permit. Compliance filings must be electronically filed with the Commission.

### **9.1 Plan and Profile**

At least 30 days before right-of-way preparation for construction begins on any segment or portion of the Project, the Permittee shall provide the Commission with a plan and profile of the right-of-way and the specifications and drawings for right-of-way preparation, construction, structure specifications and locations, cleanup, and restoration for the transmission line. The documentation shall include maps depicting the plan and profile including the right-of-way, alignment, and structures in relation to the route and alignment approved per this permit.

The Permittee may not commence construction until the 30 days has expired or until the Commission has advised the Permittee in writing that it has completed its review of the documents and determined that the planned construction is consistent with this permit. If the Permittee intends to make any significant changes in its plan and profile or the specifications and drawings after submission to the Commission, the Permittee shall notify the Commission at least five days before implementing the changes. No changes shall be made that would be in violation of any of the terms of this permit.

### **9.2 Periodic Status Reports**

The Permittee shall report to the Commission on progress regarding finalization of the route, design of structures, and construction of the transmission line. The Permittee need not report more frequently than monthly.

### **9.3 Notification to Commission**

At least three days before the line is to be placed into service, the Permittee shall notify the Commission of the date on which the line will be placed into service and the date on which construction was complete.

### **9.4 As-Builts**

Within 60 days after completion of construction, the Permittee shall submit copies of all final as-built plans and specifications developed during the Project.

## **9.5 GPS Data**

Within 60 days after completion of construction, the Permittee shall submit to the Commission, in the format requested by the Commission, geo-spatial information (e.g., ArcGIS compatible map files, GPS coordinates, associated database of characteristics) for all structures associated with the transmission line and each substation connected.

## **10.0 PERMIT AMENDMENT**

This permit may be amended at any time by the Commission. Any person may request an amendment of the conditions of this permit by submitting a request to the Commission in writing describing the amendment sought and the reasons for the amendment. The Commission will mail notice of receipt of the request to the Permittee. The Commission may amend the conditions after affording the Permittee and interested persons such process as is required.


## **11.0 TRANSFER OF PERMIT**

The Permittee may request at any time that the Commission transfer this permit to another person or entity. The Permittee shall provide the name and description of the person or entity to whom the permit is requested to be transferred, the reasons for the transfer, a description of the facilities affected, and the proposed effective date of the transfer.


The person to whom the permit is to be transferred shall provide the Commission with such information as the Commission shall require to determine whether the new Permittee can comply with the conditions of the permit. The Commission may authorize transfer of the permit after affording the Permittee, the new Permittee, and interested persons such process as is required.

## **12.0 REVOCATION OR SUSPENSION OF THE PERMIT**

The Commission may initiate action to revoke or suspend this permit at any time. The Commission shall act in accordance with the requirements of Minn. R. 7850.5100, to revoke or suspend the permit.

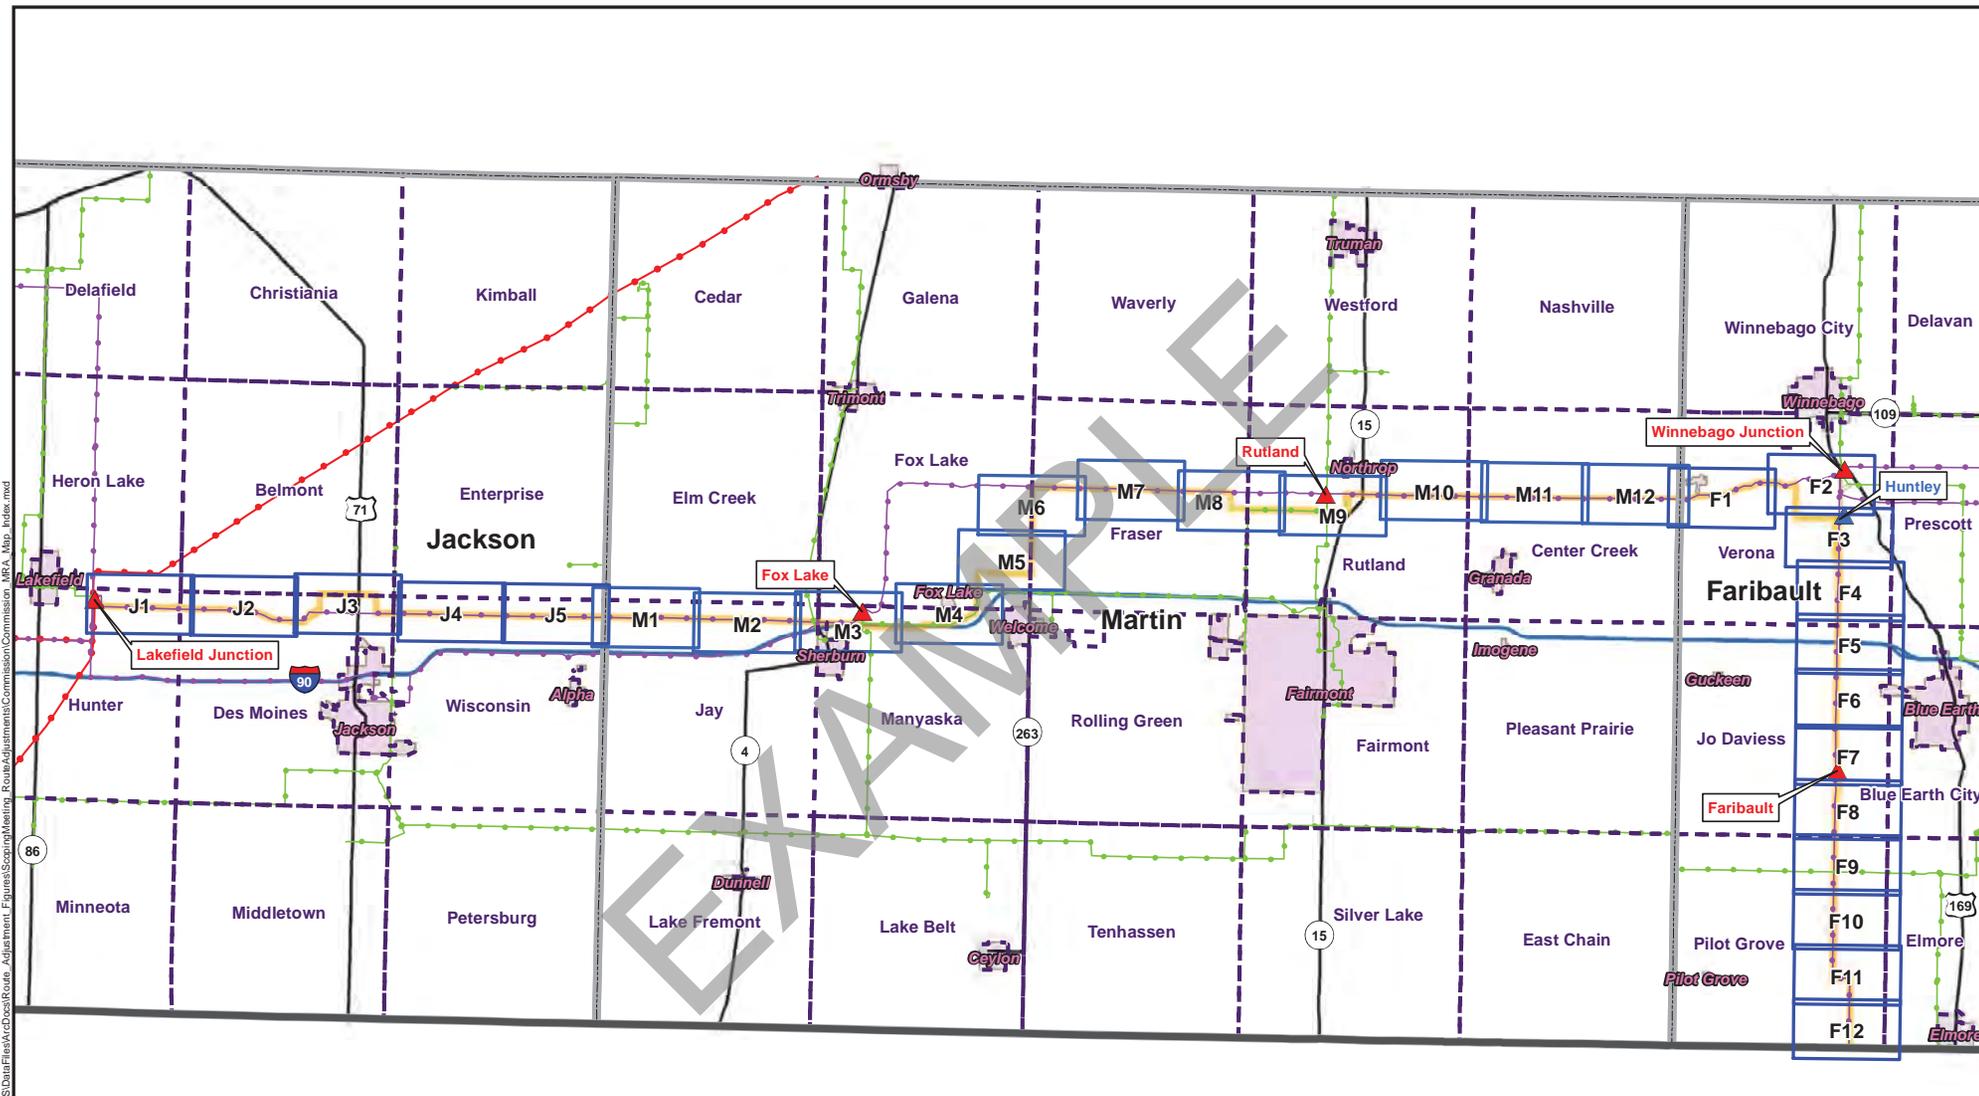

R:\ITC\6642\_HUNTLEY\_LAKEFIELD\GIS\MapIndex\MapIndex.mxd



- ▲ Existing Substation
- ▲ Proposed Substation
- Modified Route A
- Associated Facilities
- Existing 69 kV Lines
- Existing 161 kV Lines
- Existing 345 kV Lines
- Civil Township
- County Boundary
- State Boundary
- City


ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Map Index


Source: MN Geo 2011 Aerials; National Hydrography Dataset; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.



R:\ITC\6642\_HUNTLEY\_LAKEFIELD\GIS\MapData\Files\ArcDoc\Doc\Route\_Adjustment\_Figures\Scoping\Meeting\_RouteAdjustments\Commission\Mapbook\_JacksonCo\_MRA\_09Sept2014.mxd



Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
Modified Route A- Alignment		Line to be Removed	State Boundary	WRP



ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Jackson County  
Sheet 1 of 5

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

R:\ITC66742\_HUNTLEY\_LAKEFIELD\GIS\Data\Aerials\BootLake\Adjustment\_Figures\SpringMeeting\_RouteAdjustments\CommissionMapbook\_JacksonCo\_MRA\_09Sept2014.mxd



	Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
	Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
	Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
	Modified Route A- Alignment		Line to be Removed	State Boundary	WRP

Jackson County


Map Index

ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project


Modified Route A  
Jackson County  
Sheet 2 of 5

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

**Des Moines River Crossing  
Modified Route A**

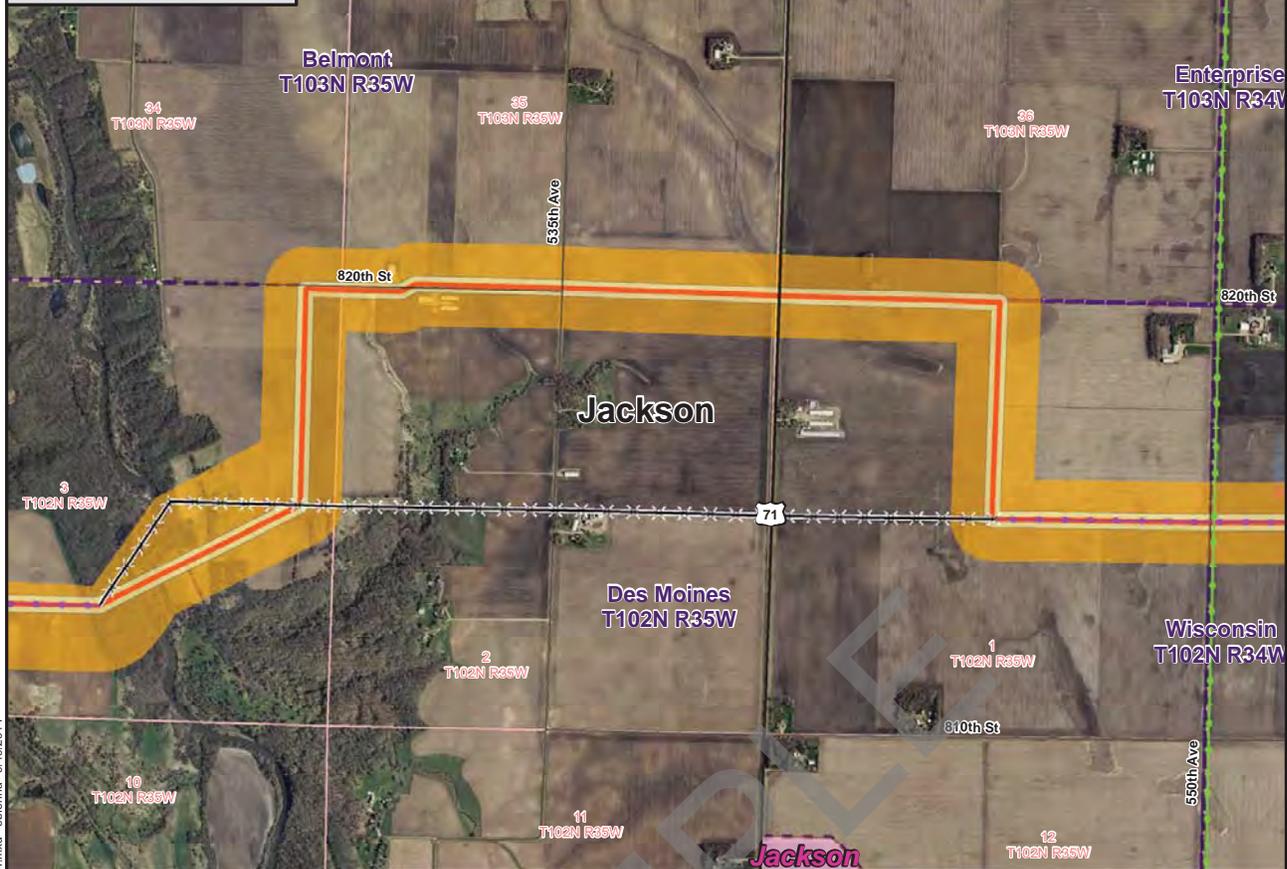

**Des Moines River Crossing  
JA- 2**

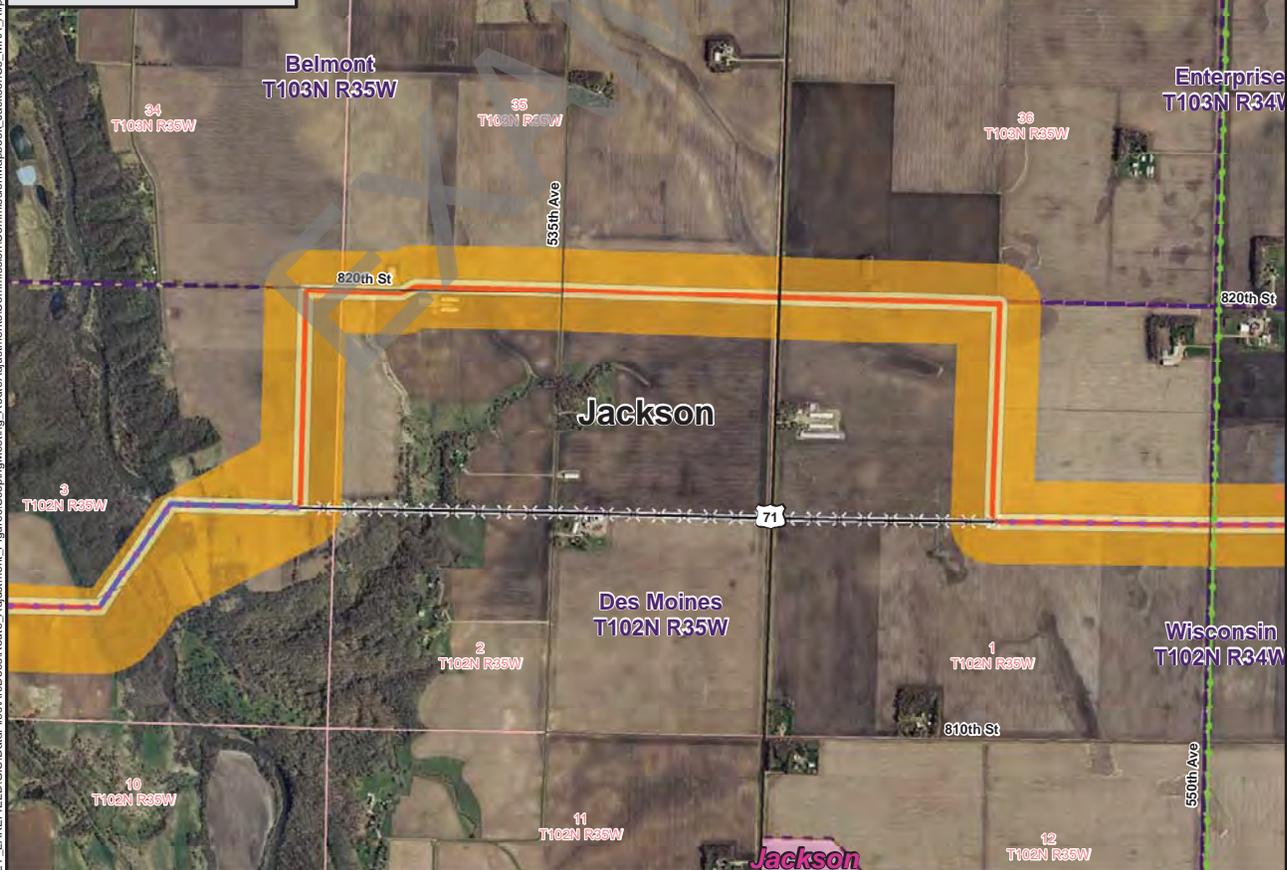

	Proposed Substation/Expansion Existing Substation Area Substation to be Removed Modified Route A - Alignment Modified Route A Project ROW	Associated Facilities JA-2 - Alignment Existing 69 kV Lines Existing 161 kV Lines Existing 345 kV Lines Line to be Removed	Civil Township Township Sections County Boundary State Boundary City	WMA WPA WRP	<p>Jackson County</p> <p>Map Index</p>	<p>ITC Midwest Minnesota to Iowa 345 kV Transmission Project</p> <p>Modified Route A with JA-2 Jackson County Sheet 3 of 5</p>
	<p>Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns &amp; McDonnell.</p>					

Path: R:\ITC\86742\_HUNTLEY\_LAKEFIELD\GIS\Map\Mapbook\_JacksonCo\_MRA\_Airport\_16Sep2014.mxd etb:ma 9/19/2014

R:\ITC6642\_HUNTLEY\_LAKEFIELD\GIS\Mapbook\Commission\CommissionMapbook\_JacksonCo\_MRA\_09Sept2014.mxd



	Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
	Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
	Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
	Modified Route A- Alignment		Line to be Removed	State Boundary	WRP

Jackson County

Map Index

ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Jackson County  
Sheet 4 of 5

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

September 19, 2014

R:\ITC66742\_HUNTLEY\_LAKEFIELD\GIS\Mapbook\Commission\CommissionMapbook\_JacksonCo\_MRA\_09Sept2014.mxd



	Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
	Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
	Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
	Modified Route A- Alignment		Line to be Removed	State Boundary	WRP

Jackson County


Map Index

ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Jackson County  
Sheet 5 of 5

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

R:\ITC\6642\_HUNTLEY\_LAKEFIELD\GIS\MapIndex\MapIndex.mxd

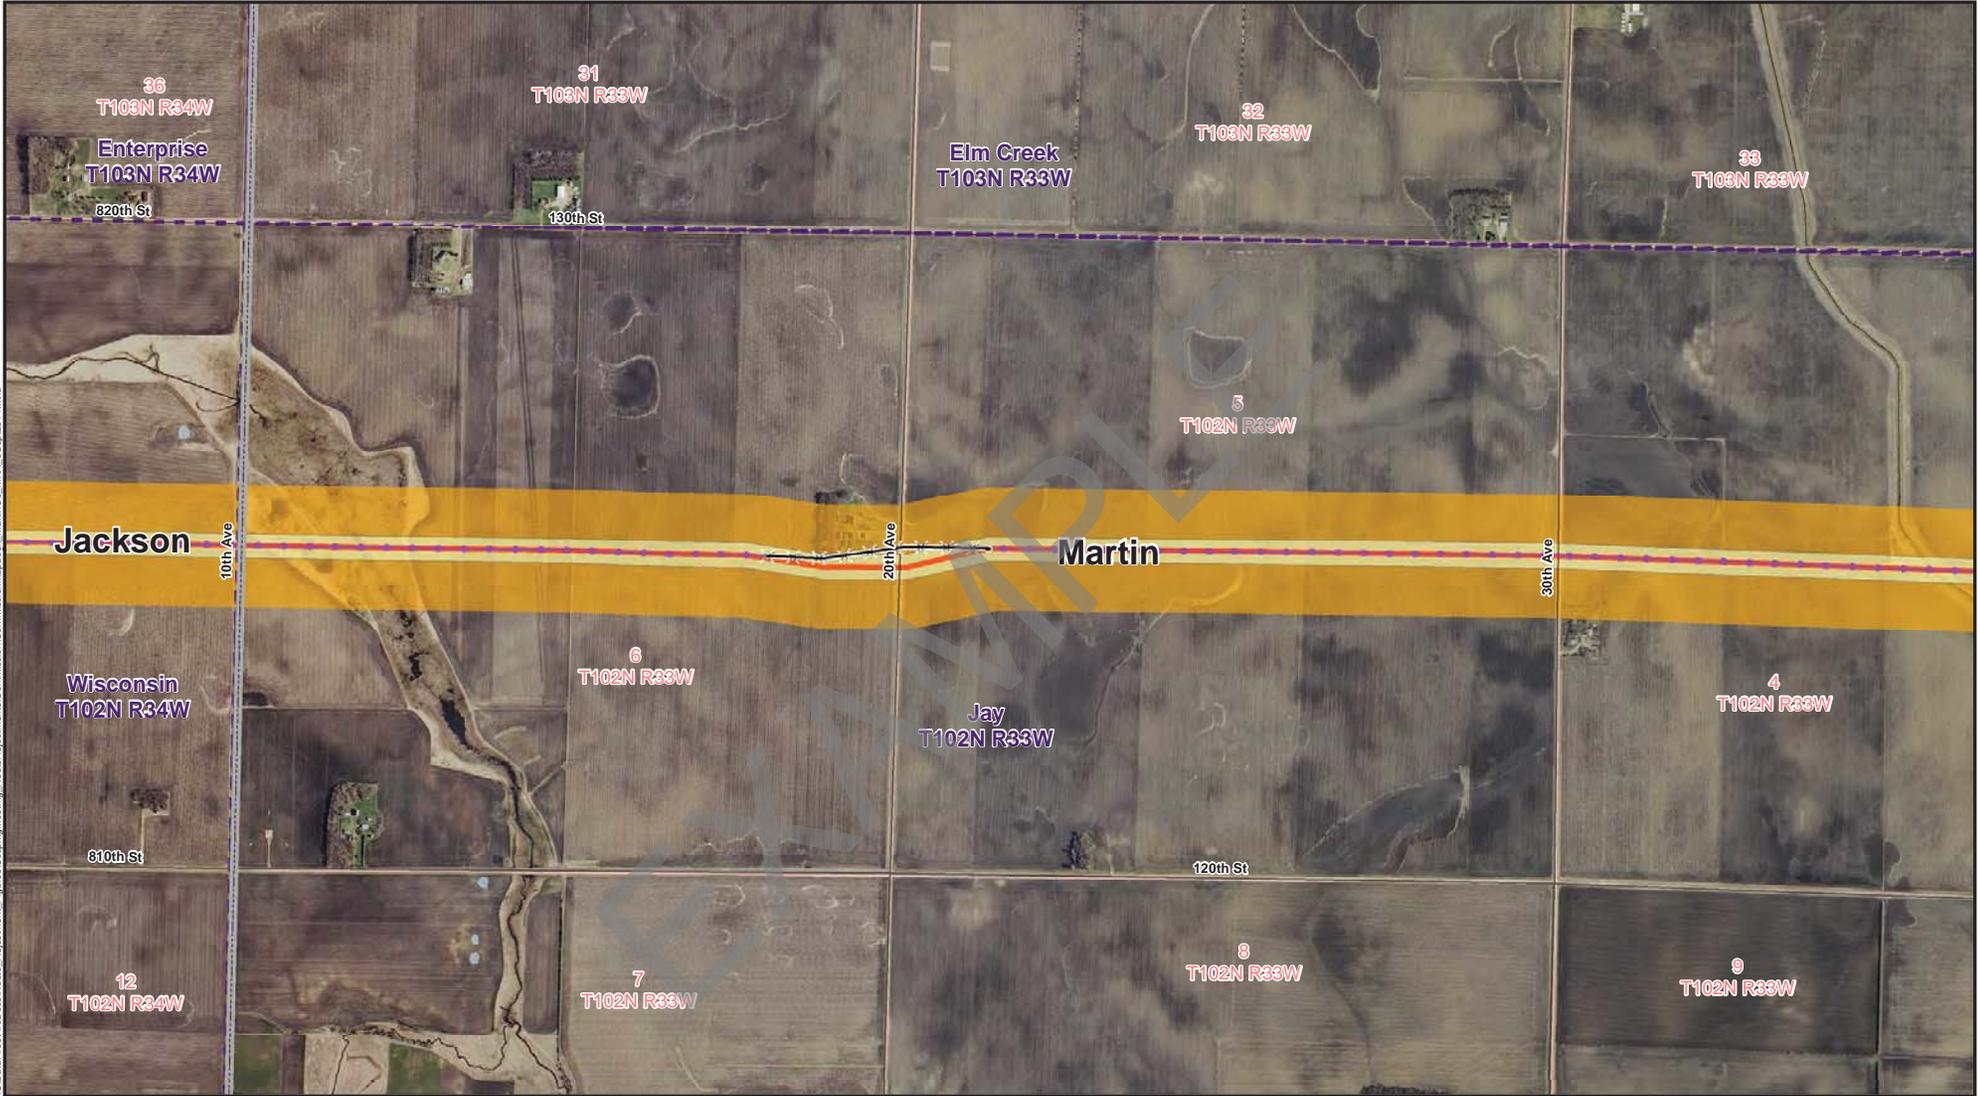

	Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
	Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
	Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
	Modified Route A- Alignment		Line to be Removed	State Boundary	WRP

Martin County

Map Index

ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Martin County  
Sheet 1 of 12

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

R:\ITC\6642\_HUNTLEY\_LAKEFIELD\GIS\MapIndex\MapIndex.mxd



	Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
	Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
	Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
	Modified Route A- Alignment		Line to be Removed	State Boundary	WRP


Map Index

ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project


Modified Route A  
Martin County  
Sheet 2 of 12

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.


September 19, 2014

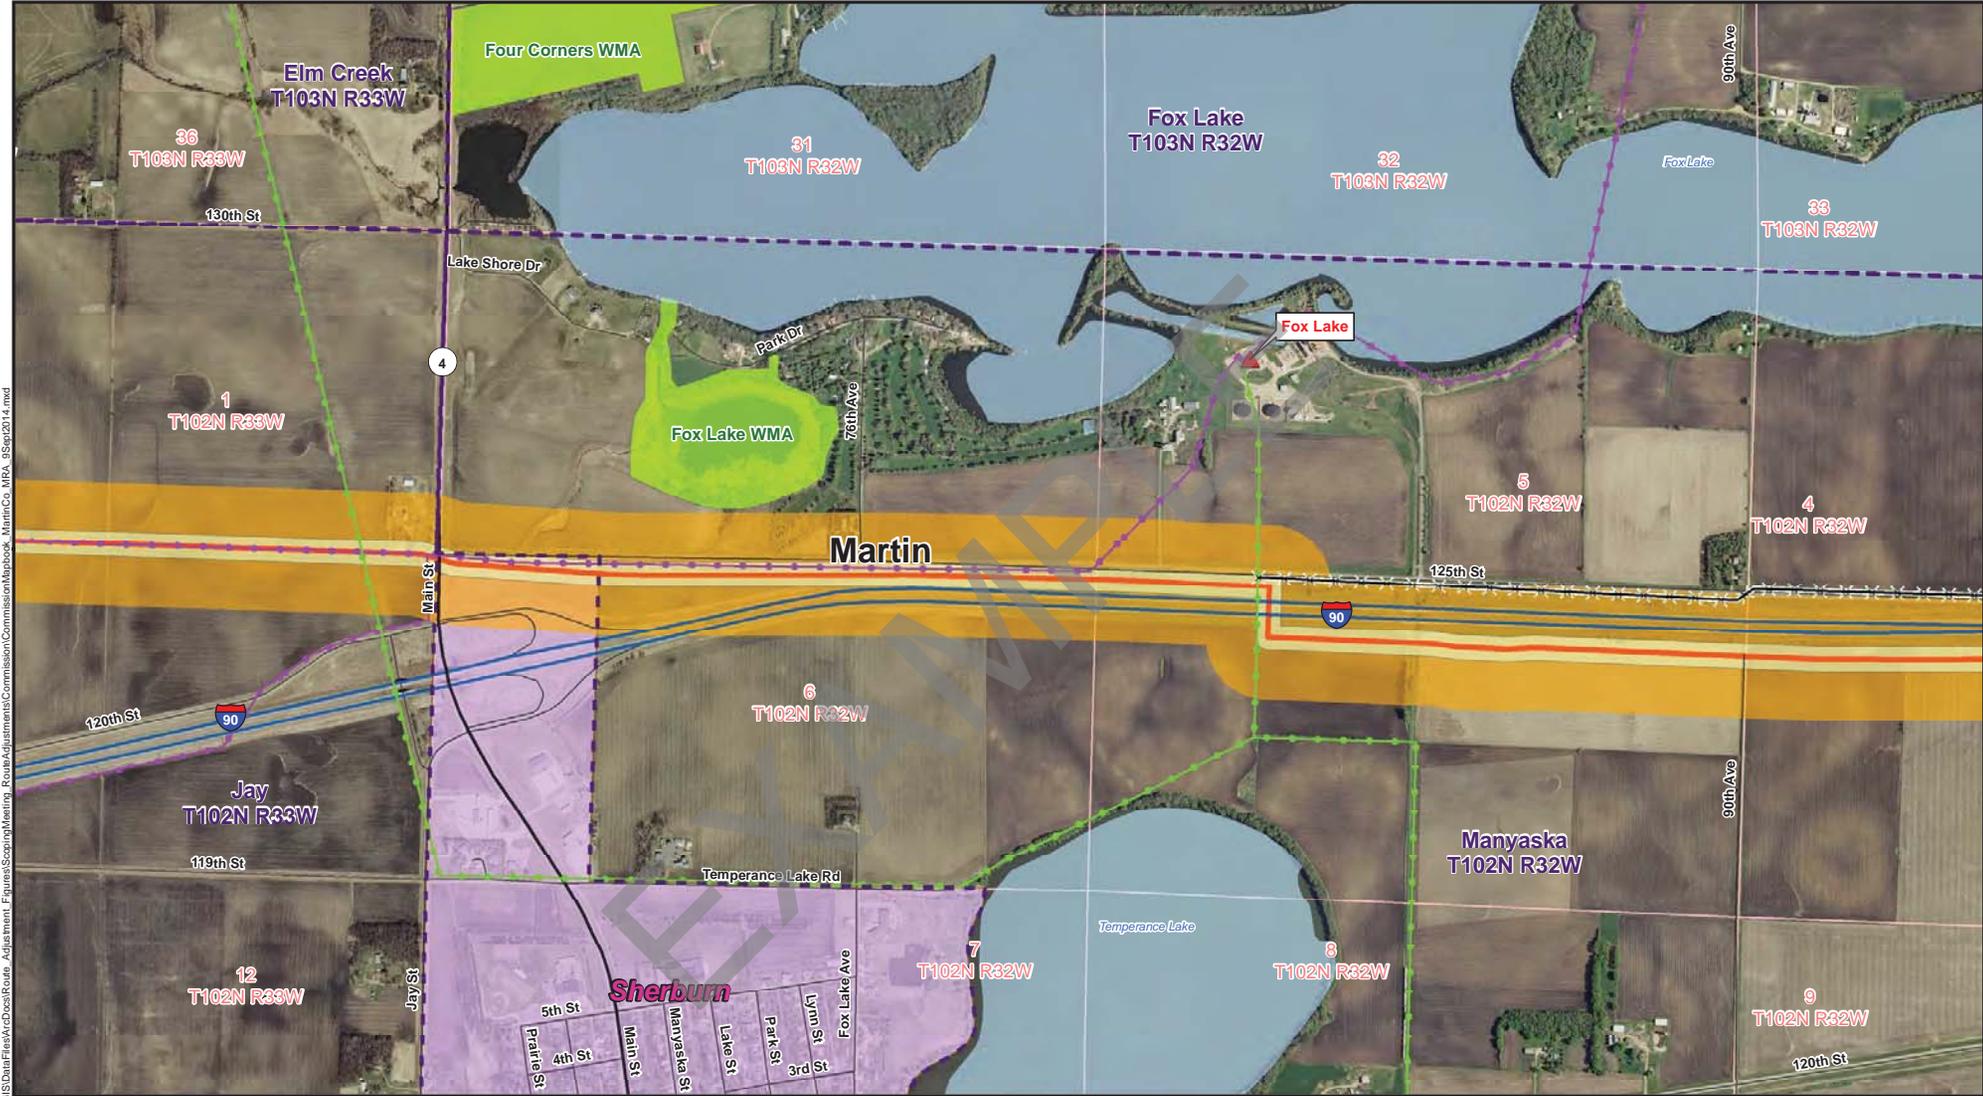

R:\ITC\6642\_HUNTLEY\_LAKEFIELD\GIS\Map\MapIndex.mxd




	Proposed Substation/Expansion		Modified Route A		Existing 69 kV Lines		Civil Township		City
	Existing Substation Area		Project ROW		Existing 161 kV Lines		Township Sections		WMA
	Substation to be Removed		Associated Facilities		Existing 345 kV Lines		County Boundary		WPA
	Modified Route A- Alignment				Line to be Removed		State Boundary		WRP




ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Martin County  
Sheet 3 of 12


Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

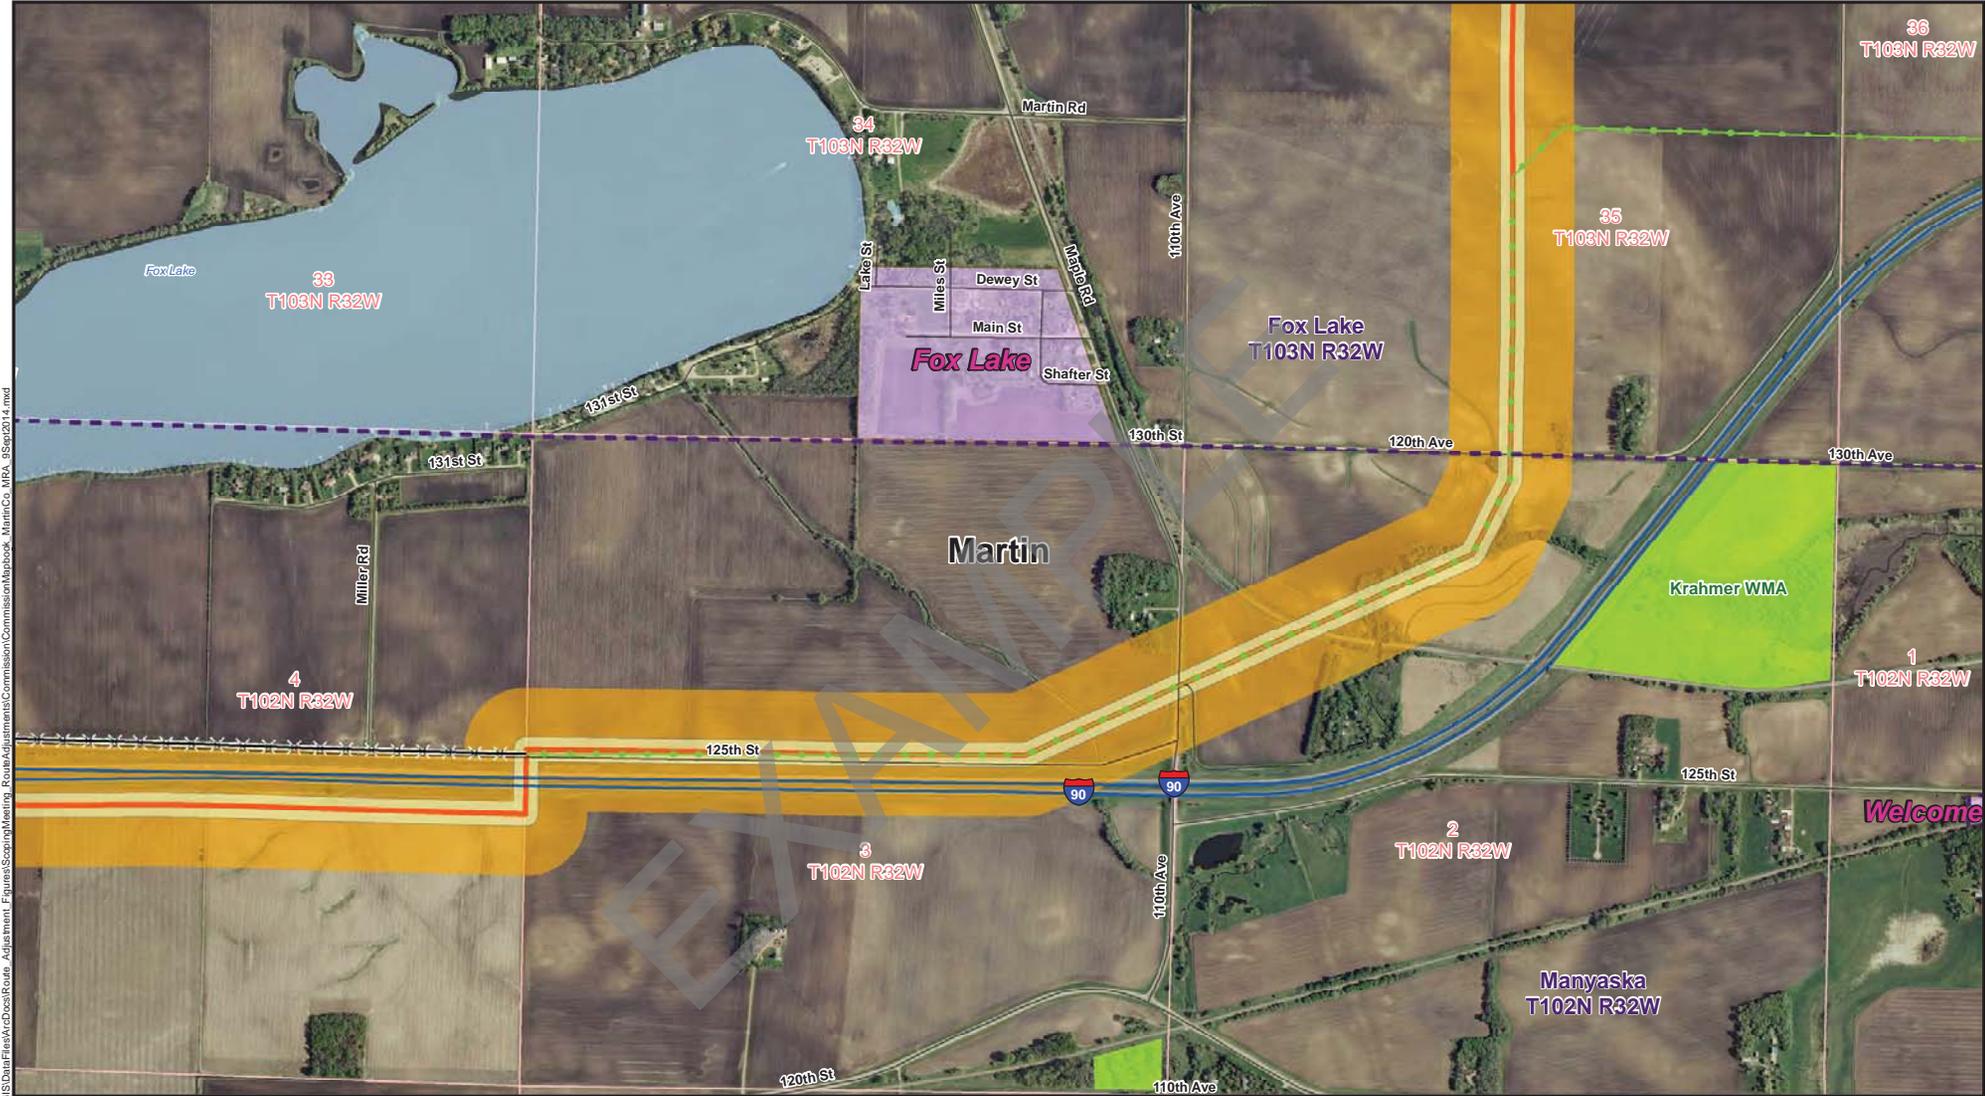

R:\ITC\6642\_HUNTLEY\_LAKEFIELD\GIS\MapIndex\MapIndex.mxd



Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
Modified Route A- Alignment		Line to be Removed	State Boundary	WRP



ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Martin County  
Sheet 4 of 12

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

R:\ITC\6642\_HUNTLEY\_LAKEFIELD\GIS\Map\Mapbook\_Adjustment\_Figures\Scrap\Meeting\_RouteAdjustments\Commission\Mapbook\_MartinCo\_MRA\_9Sept2014.mxd



	Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
	Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
Substation to be Removed	Associated Facilities	Existing 345 kV Lines	Line to be Removed	County Boundary	WPA
Modified Route A- Alignment				State Boundary	WRP

Martin County

Map Index

ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Martin County  
Sheet 5 of 12

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

September 19, 2014

R:\ITC\6642\_HUNTLEY\_LAKE\FIELD\GIS\MapIndex\MapIndex.mxd



	Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
	Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	State Boundary	WPA
Modified Route A-Alignment		Line to be Removed		WRP	

Map Index

ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Martin County  
Sheet 6 of 12

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

September 19, 2014

R:\ITC\6642\_HUNTLEY\_LAKE\FIELD\GIS\DATA\Files\Aerials\Source\_Adjustment\_Figures\Scoping\Meeting\_Route\_Adjustments\Commission\Commission\Mapbook\_MartinCo\_MRA\_9Sept2014.mxd



 	Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
	Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
Substation to be Removed	Associated Facilities	Existing 345 kV Lines	Line to be Removed	County Boundary	WPA
Modified Route A- Alignment				State Boundary	WRP

Martin County  
Map Index

ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project


Modified Route A  
Martin County  
Sheet 7 of 12

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.



R:\ITC\6642\_HUNTLEY\_LAKEFIELD\GIS\MapIndex\MapIndex.mxd


	Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
	Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
	Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
	Modified Route A- Alignment		Line to be Removed	State Boundary	WRP




ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Martin County  
Sheet 8 of 12


Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

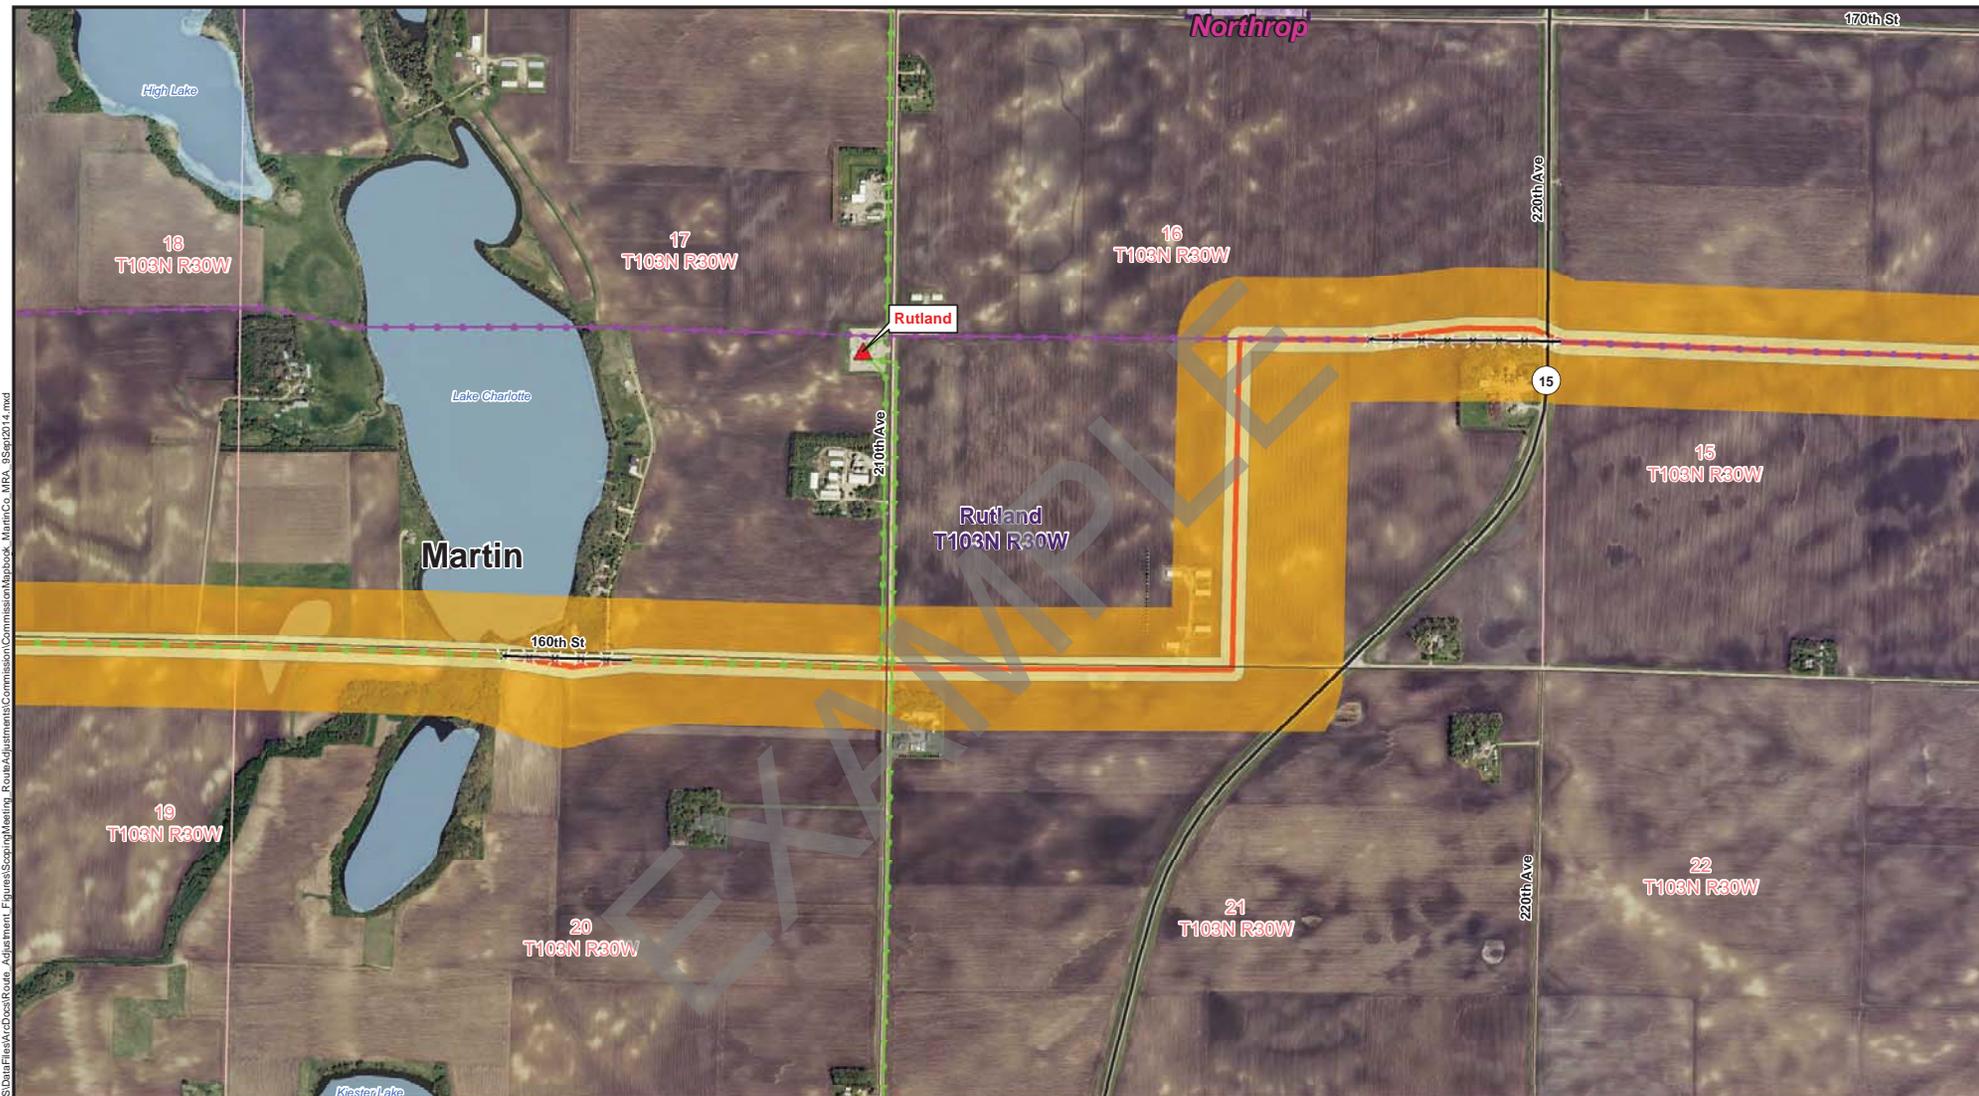

R:\ITC\6642\_HUNTLEY\_LAKEFIELD\GIS\MapIndex\MapIndex.mxd



	Proposed Substation/Expansion		Modified Route A		Existing 69 kV Lines		Civil Township		City
	Existing Substation Area		Project ROW		Existing 161 kV Lines		Township Sections		WMA
	Substation to be Removed		Associated Facilities		Existing 345 kV Lines		County Boundary		WPA
	Modified Route A- Alignment				Line to be Removed		State Boundary		WRP




ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Martin County  
Sheet 9 of 12

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

September 19, 2014

R:\ITC\6642\_HUNTLEY\_LAKEFIELD\GIS\MapIndex\MapIndex.mxd

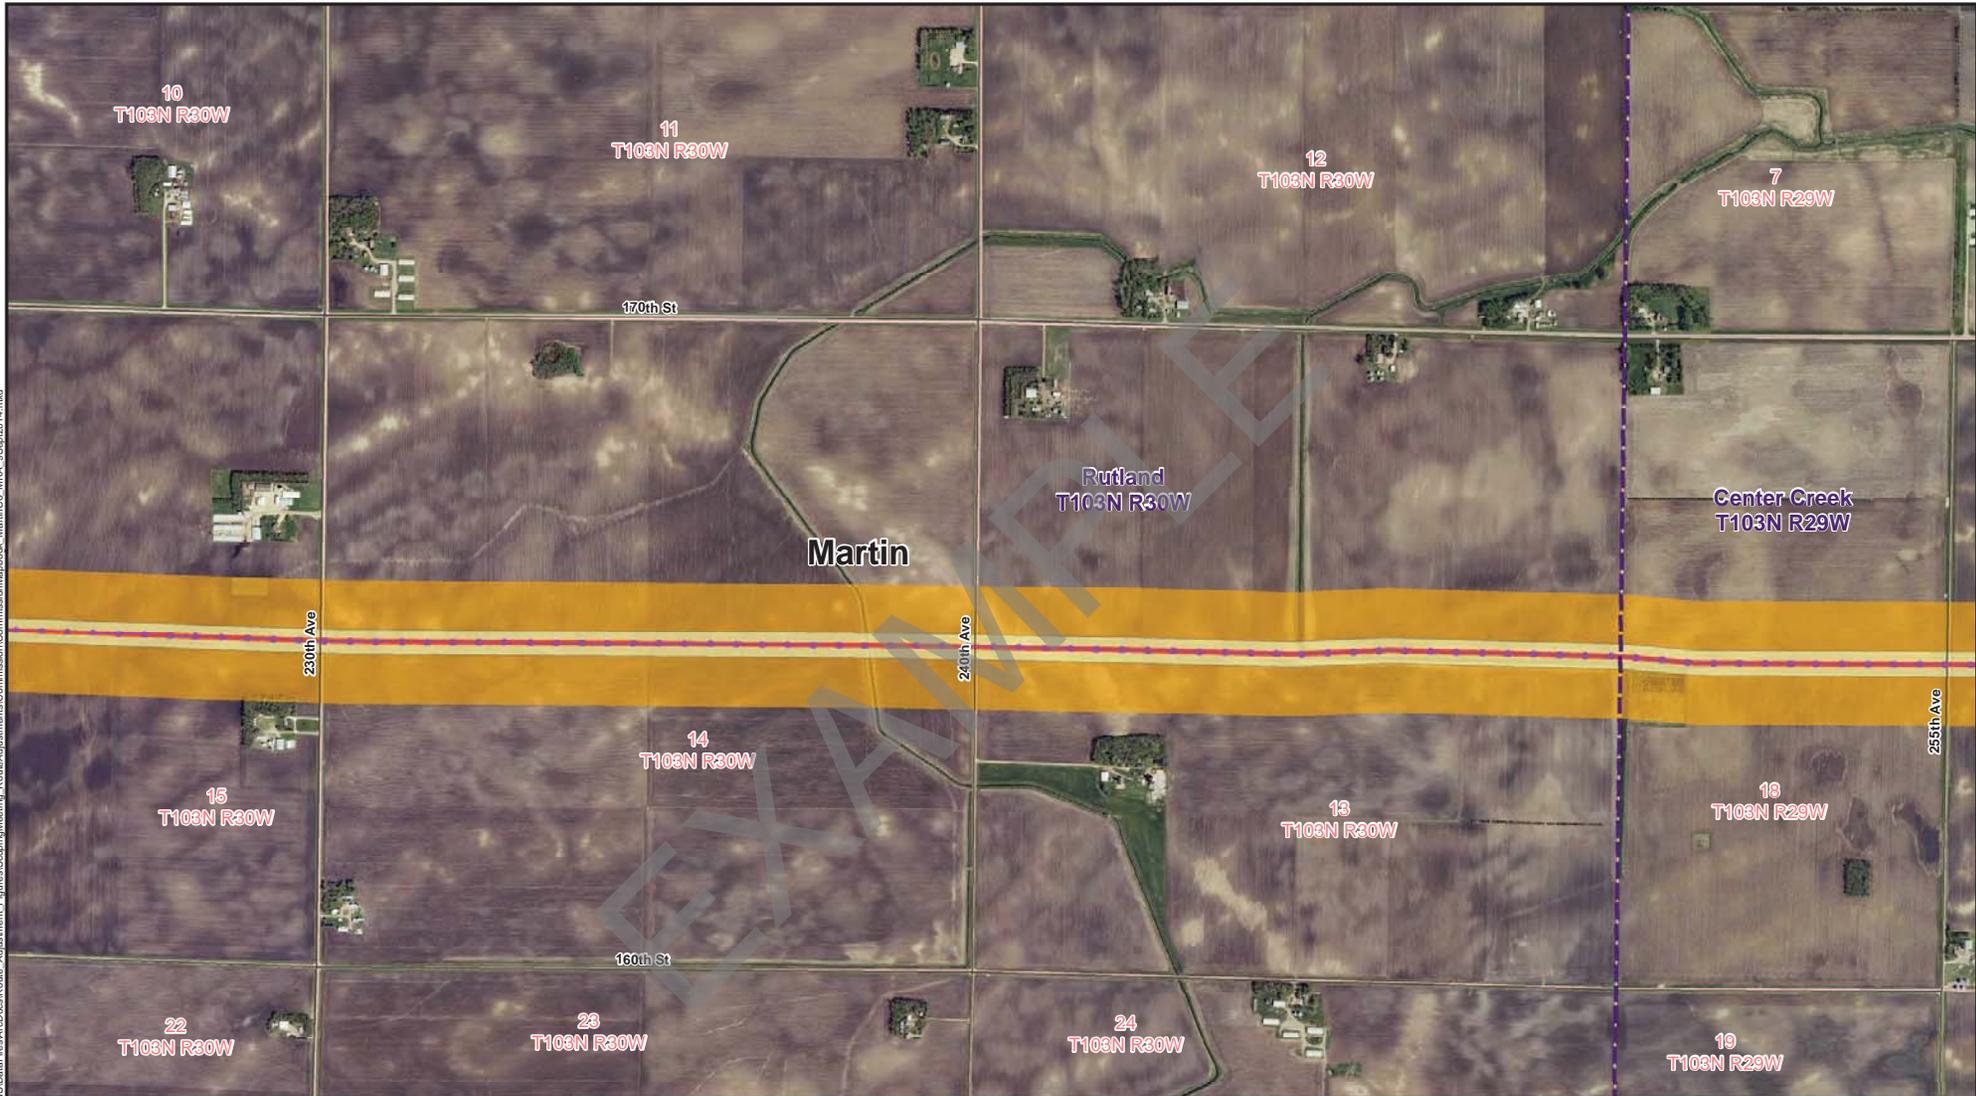

	Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
	Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
	Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
	Modified Route A- Alignment		Line to be Removed	State Boundary	WRP

Map Index

ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Martin County  
Sheet 10 of 12

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

September 19, 2014

R:\ITC\6642\_HUNTLEY\_LAKEFIELD\GIS\Aerials\Aerials\Adjustment\_Figures\Scrap\Meeting\_Route\Adjustments\Commission\CommissionMapbook\_MartinCo\_MRA\_9Sept2014.mxd



	Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
	Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
	Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
	Modified Route A- Alignment		Line to be Removed	State Boundary	WRP

Map Index

ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project


Modified Route A  
Martin County  
Sheet 11 of 12

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.


September 19, 2014



R:\ITC\66742\_HUNTLEY\_LAKEFIELD\GIS\MapIndex\MapIndex.mxd



Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
Modified Route A- Alignment		Line to be Removed	State Boundary	WRP




ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project


Modified Route A  
Martin County  
Sheet 12 of 12

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.




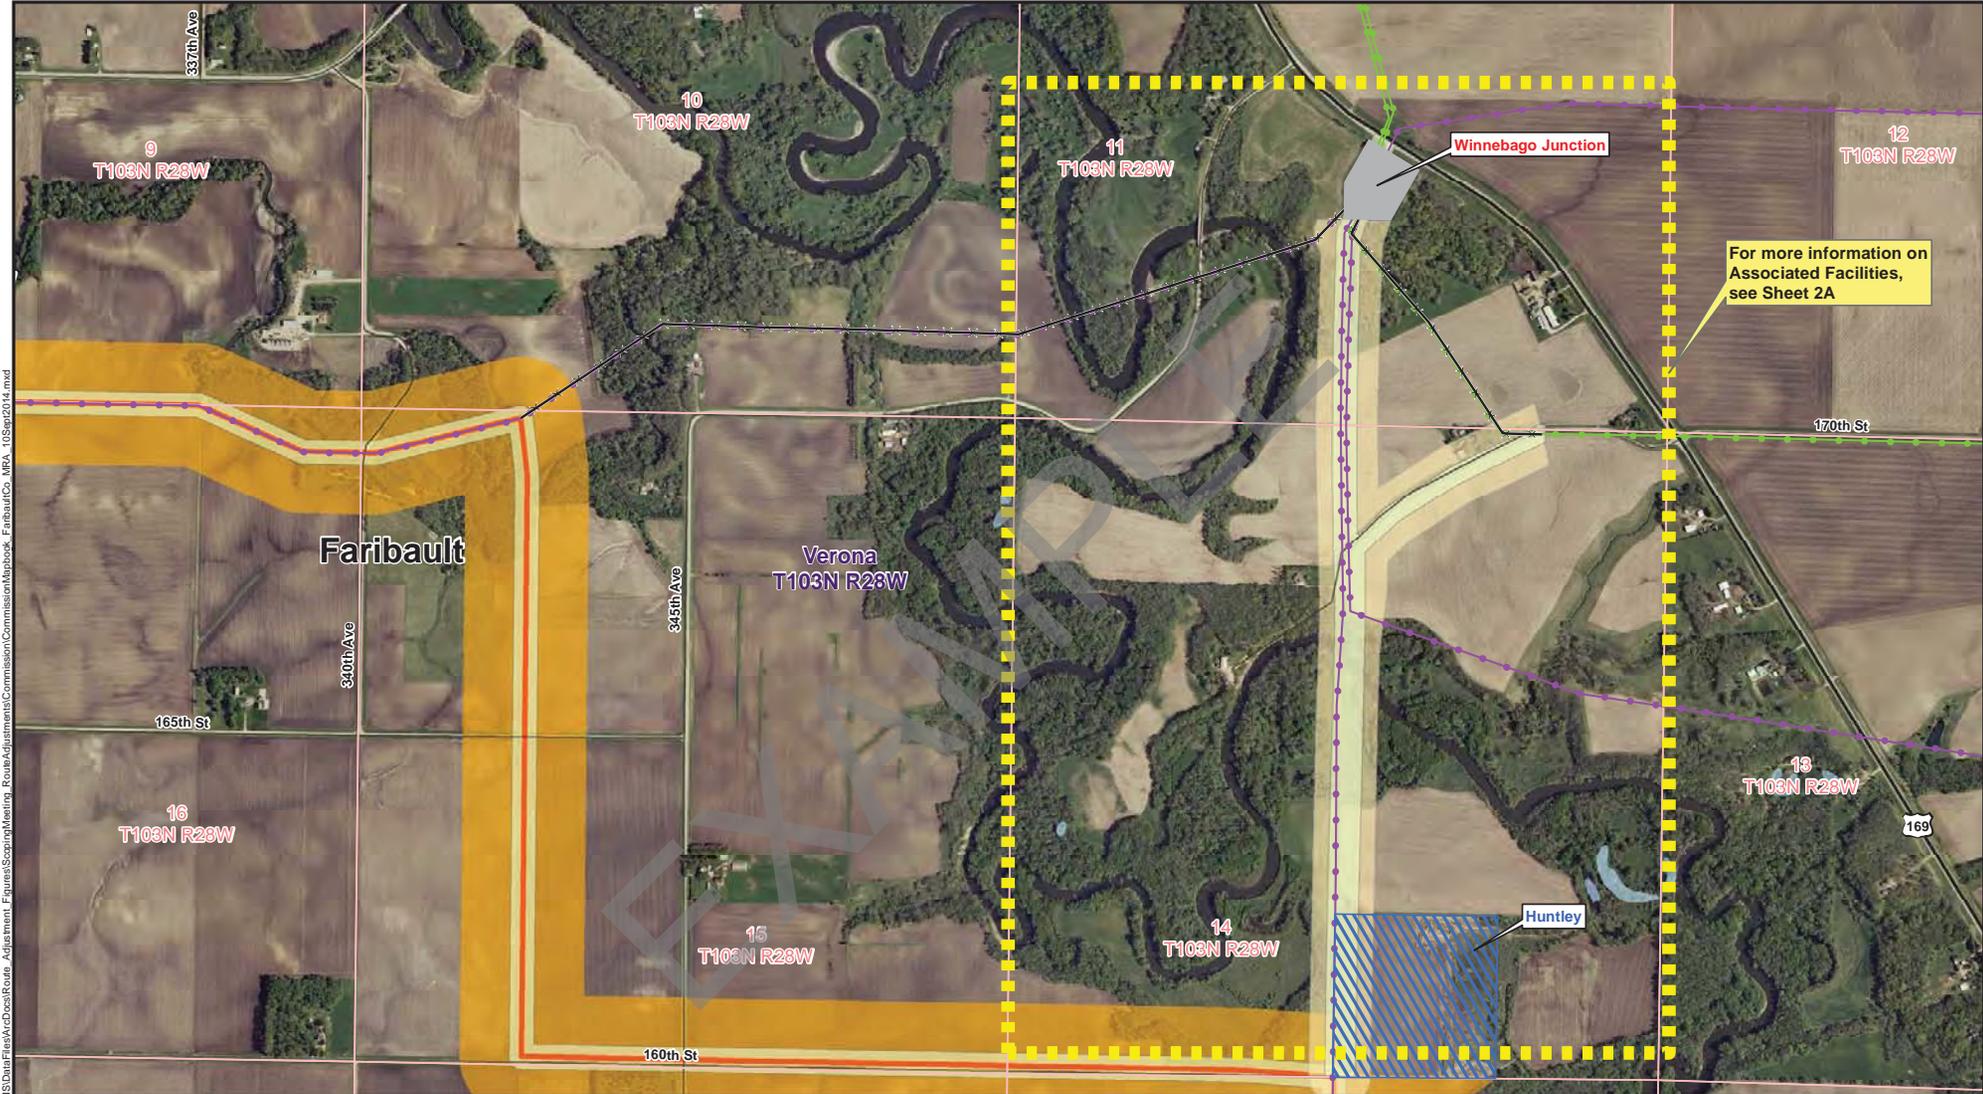

R:\ITC\6642\_HUNTLEY\_LAKEFIELD\GIS\MapBook\Adjustment\_Figures\Setup\Meeting\_Route\Adjustments\Commission\CommissionMapbook\_Faribault\CO\_MRA\_10Sep2014.mxd



- |                               |                       |                       |                   |      |
|-------------------------------|-----------------------|-----------------------|-------------------|------|
| Proposed Substation/Expansion | Modified Route A      | Existing 69 kV Lines  | Civil Township    | City |
| Existing Substation Area      | Project ROW           | Existing 161 kV Lines | Township Sections | WMA  |
| Substation to be Removed      | Associated Facilities | Existing 345 kV Lines | County Boundary   | WPA  |
| Modified Route A- Alignment   |                       | Line to be Removed    | State Boundary    | WRP  |



Faribault County

ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Faribault County  
Sheet 2 of 12

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

September 19, 2014

Path: E:\ITC\6672\_HUNTLEY\_LAKEFIELD\GIS\DataFiles\ArcDocs\Route\_Adjustment\_Figures\ScopingMeeting\_RouteAdjustments\CommissionCommission\_AssociatedFacilities\_MRF\Figure2A\_18Sep2014.mxd sbrmma\_9/19/2014




	Proposed Substation/Expansion	Modified Route A	161 kV	Line to be Removed	City	
	Existing Substation Area	Project ROW	69 kV	Civil Township	WMA	
	Substation to be Removed	Associated Facilities	New 69 kV Built to 161 kV Standards	Township Sections	WPA	<p>ITC Midwest Minnesota to Iowa 345 kV Transmission Project</p> <p>Modified Route A Faribault County Sheet 2A of 12</p>
	Modified Route A- Alignment		New Double Circuit 161/69 kV	County Boundary	WRP	
			New Double Circuit 345/161 kV	State Boundary		<p>Map Index</p>


Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

September 19, 2014

R:\ITC\6642\_HUNTLEY\_LAKEFIELD\GIS\Map\Mapbook - Faribault\Commission\CommissionMapbook - Faribault\Co\_MRA - 10Sep2014.mxd



Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
Modified Route A- Alignment		Line to be Removed	State Boundary	WRP



Faribault County



ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Faribault County  
Sheet 3 of 12


Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

September 19, 2014

R:\ITC\6642\_HUNTLEY\_LAKEFIELD\GIS\MapFiles\Aerial\Routes\_Adjustment\_Egures\Startup\Meeting\_RouteAdjustments\Commission\CommissionMapbook\_FaribaultCo\_MRA\_10Sep2014.mxd

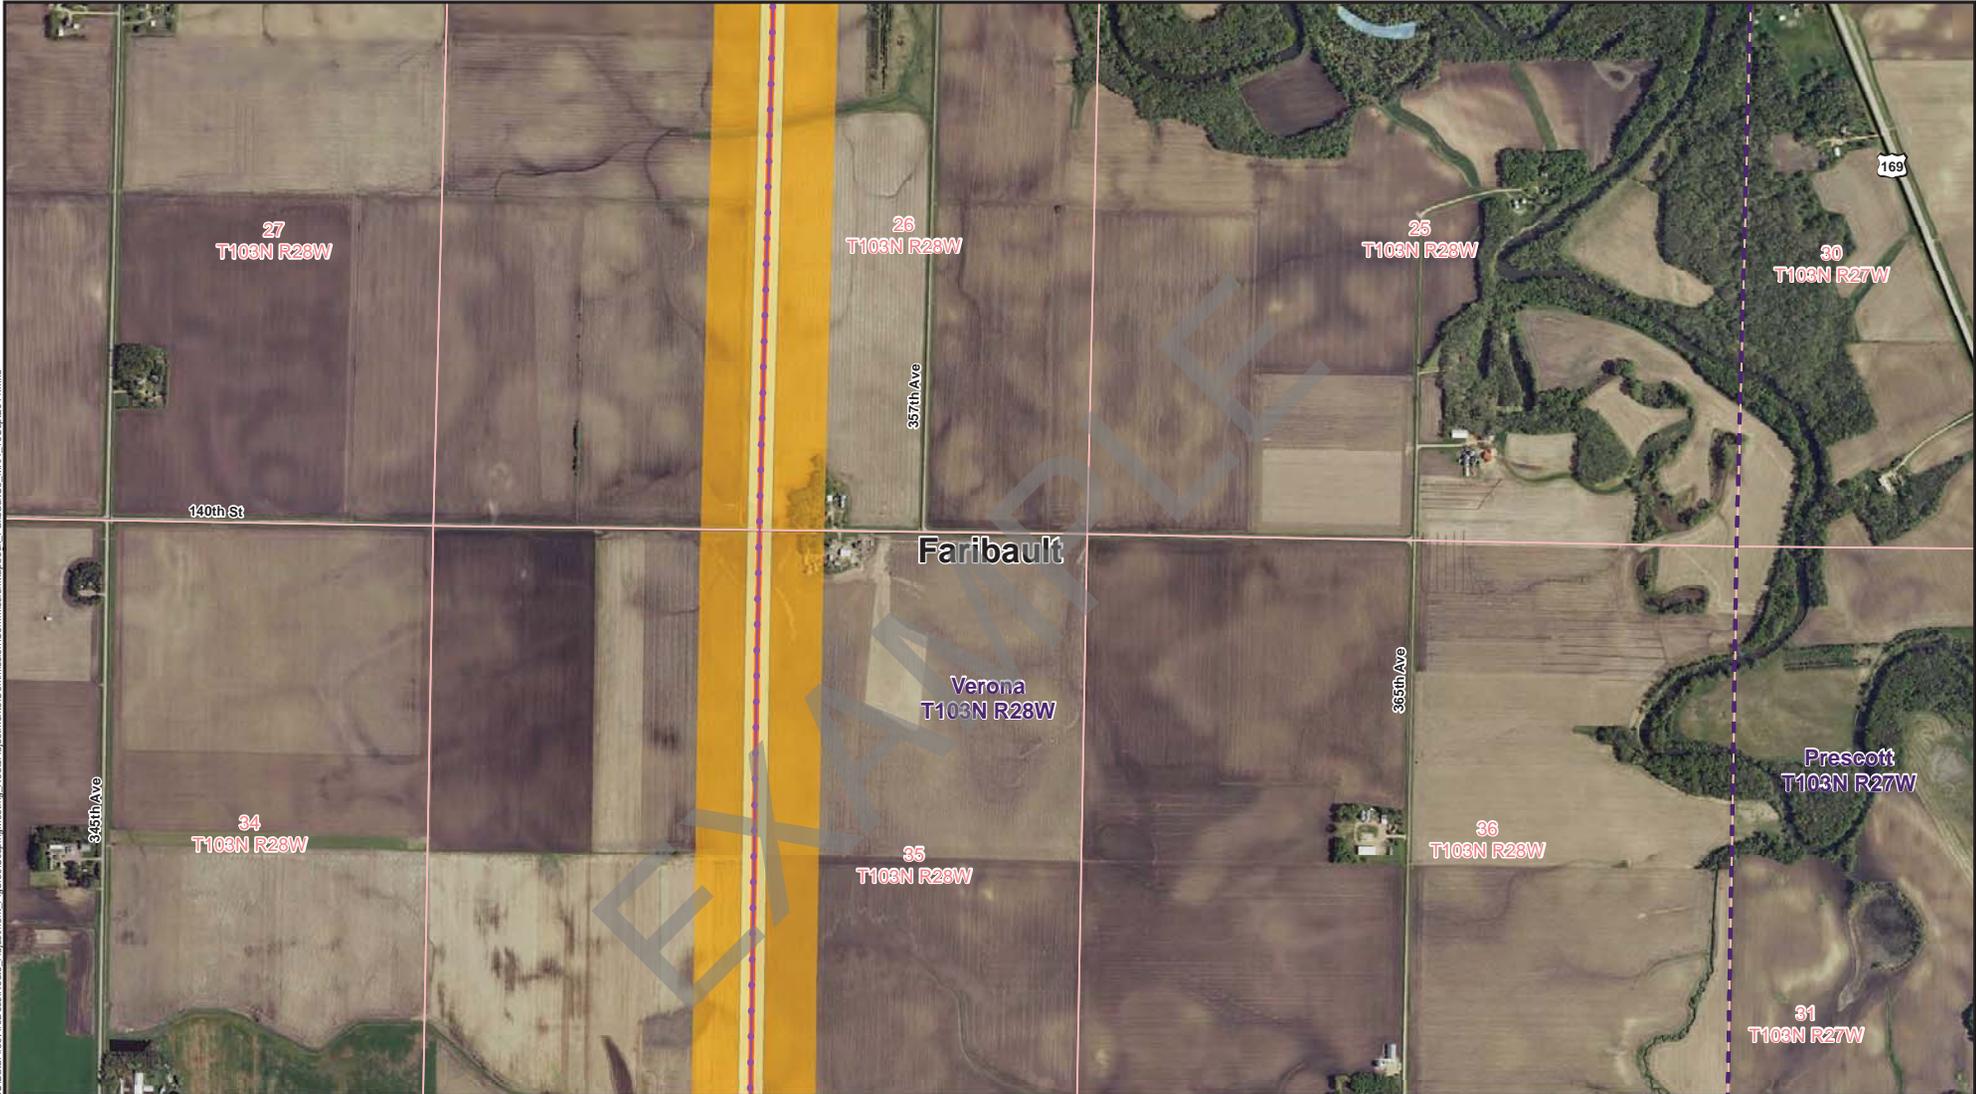

Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
Modified Route A- Alignment		Line to be Removed	State Boundary	WRP



Faribault County

ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Faribault County  
Sheet 4 of 12

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

September 19, 2014



R:\ITC\6642\_HUNTLEY\_LAKEFIELD\GIS\OutputFiles\AcDoc\Routes\_Adjustment\_Figures\Scrap\Mapbook\_Faribault\Commission\CommissionMapbook\_Faribault\Co\_MRA\_10Sep2014.mxd

	Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
	Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA	WRP
Modified Route A- Alignment		Line to be Removed	State Boundary		

Faribault County


ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Faribault County  
Sheet 5 of 12


Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

September 19, 2014

R:\ITC\6642\_HUNTLEY\_LAKEFIELD\GIS\MapFiles\AcDoc\Routes\_Adjustment\_Figures\Scrap\Meeting\_RouteAdjustments\Commission\Commission\Mapbook\_Faribault\Co\_MRA - 10Sep2014.mxd



Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
Modified Route A- Alignment		Line to be Removed	State Boundary	WRP




ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Faribault County  
Sheet 6 of 12


Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.



R:\ITC\6642\_HUNTLEY\_LAKEFIELD\GIS\OutputFiles\AcDoc\Routes\_Adjustment\_Egures\Steps\Meeting\_RouteAdjustments\Commission\CommissionMapbook\_FaribaultCo\_MRA\_10Sep2014.mxd



Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
Modified Route A- Alignment		Line to be Removed	State Boundary	WRP




ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project


Modified Route A  
Faribault County  
Sheet 7 of 12

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

R:\ITC\6642\_HUNTLEY\_LAKE\FIELD\GIS\DATA\Final\CD\BostRoute\_Adjustment\_Figures\Step\Map\Meeting\_RouteAdjustments\Commission\CommissionMapbook\_Faribault\Co\_MRA\_10\Sept2014.mxd



Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
Modified Route A- Alignment		Line to be Removed	State Boundary	WRP



Faribault County

ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project


Modified Route A  
Faribault County  
Sheet 8 of 12

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.


September 19, 2014



R:\ITC\6642\_HUNTLEY\_LAKE\FIELD\GIS\DATA\Files\Ac\Doc\Routes\_Adjustment\_Figures\Scripts\Meeting\_Route\_Adjustments\Commission\Commission\Mapbook\_FaribaultCo\_MRA\_10Sep2014.mxd



Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
Modified Route A- Alignment		Line to be Removed	State Boundary	WRP



ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Faribault County  
Sheet 9 of 12

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.



R:\ITC\6642\_HUNTLEY\_LAKE\FIELD\GIS\DATA\Files\Aerial\Source\_Adjustment\_Figures\Stepup\Meeting\_RouteAdjustments\Commission\CommissionMapbook\_Faribault\Co\_MRA - 10Sep2014.mxd



	Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
	Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
	Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
	Modified Route A- Alignment		Line to be Removed	State Boundary	WRP

Faribault County

ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Faribault County  
Sheet 11 of 12

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

September 19, 2014

R:\ITC\6642\_HUNTLEY\_LAKEFIELD\GIS\DATA\Files\ArcDoc\Routes\_Adjustment\_EPures\Scoping\Meeting\_RouteAdjustments\Commission\CommissionMapbook\_Faribault\Co\_MRA\_10(Sep2014).mxd



	Proposed Substation/Expansion	Modified Route A	Existing 69 kV Lines	Civil Township	City
	Existing Substation Area	Project ROW	Existing 161 kV Lines	Township Sections	WMA
	Substation to be Removed	Associated Facilities	Existing 345 kV Lines	County Boundary	WPA
	Modified Route A- Alignment		Line to be Removed	State Boundary	WRP

Faribault County

Map Index

ITC Midwest  
Minnesota to Iowa  
345 kV Transmission Project

Modified Route A  
Faribault County  
Sheet 12 of 12

Source: MN Geo 2011 Aerials; Minnesota DNR; Minnesota Geo GIS; Minnesota DOT; ITC; Burns & McDonnell.

September 19, 2014

**MINNESOTA PUBLIC UTILITIES COMMISSION  
COMPLAINT HANDLING PROCEDURES FOR  
HIGH-VOLTAGE TRANSMISSION LINES**

**A. Purpose**

To establish a uniform and timely method of reporting complaints received by the permittee concerning permit conditions for site preparation, construction, cleanup and restoration, operation, and resolution of such complaints.

**B. Scope**

This document describes complaint reporting procedures and frequency.

**C. Applicability**

The procedures shall be used for all complaints received by the permittee and all complaints received by the Minnesota Public Utilities Commission (Commission) under Minn. R. 7829.1500 or Minn. R. 7829.1700 relevant to this permit.

**D. Definitions**

**Complaint:** A verbal or written statement presented to the permittees by a person expressing dissatisfaction or concern regarding site preparation, cleanup or restoration or other route and associated facilities permit conditions. Complaints do not include requests, inquiries, questions or general comments.

**Substantial Complaint:** A written complaint alleging a violation of a specific permit condition that, if substantiated, could result in permit modification or suspension pursuant to the applicable regulations.

**Unresolved Complaint:** A complaint which, despite the good faith efforts of the permittee and a person, remains to both or one of the parties unresolved or unsatisfactorily resolved.

**Person:** An individual, partnership, joint venture, private or public corporation, association, firm, public service company, cooperative, political subdivision, municipal corporation, government agency, public utility district, or any other entity, public or private, however organized.

## **E. Complaint Documentation and Processing**

1. The permittee shall designate an individual to summarize complaints for the Commission. This person's name, phone number and email address shall accompany all complaint submittals.
2. A person presenting the complaint should to the extent possible, include the following information in their communications:
  - a. name, address, phone number, and email address;
  - b. date of complaint;
  - c. tract or parcel number; and
  - d. whether the complaint relates to a permit matter or a compliance issue.
3. The permittee shall document all complaints by maintaining a record of all applicable information concerning the complaint, including the following:
  - a. docket number and project name;
  - b. name of complainant, address, phone number and email address;
  - c. precise description of property or parcel number;
  - d. name of permittee representative receiving complaint and date of receipt;
  - e. nature of complaint and the applicable permit condition(s);
  - f. activities undertaken to resolve the complaint; and
  - g. final disposition of the complaint.

## **F. Reporting Requirements**

The permittee shall commence complaint reporting at the beginning of project construction and continue through the term of the permit. The permittee shall report all complaints to the Commission according to the following schedule:

**Immediate Reports:** All substantial complaints shall be reported to the Commission the same day received, or on the following working day for complaints received after working hours. Such reports are to be directed to the Commission's Consumer Affairs Office at 1-800-657-3782 (voice messages are acceptable) or [consumer.puc@state.mn.us](mailto:consumer.puc@state.mn.us). For e-mail reporting, the email subject line should read "PUC EFP Complaint" and include the appropriate project docket number.

**Monthly Reports:** By the 15th of each month, a summary of all complaints, including substantial complaints received or resolved during the preceding month, shall be filed to Dr. Burl W. Haar, Executive Secretary, Public Utilities Commission, using the eDockets system. The eDockets system is located at: <https://www.edockets.state.mn.us/EFiling/home.jsp>

If no complaints were received during the preceding month, the permittee shall file a summary indicating that no complaints were received.

#### **G. Complaints Received by the Commission**

Complaints received directly by the Commission from aggrieved persons regarding site preparation, construction, cleanup, restoration, operation and maintenance shall be promptly sent to the permittee.

#### **H. Commission Process for Unresolved Complaints**

Commission staff shall perform an initial evaluation of unresolved complaints submitted to the Commission. Complaints raising substantial permit issues shall be processed and resolved by the Commission. Staff shall notify the permittee and appropriate persons if it determines that the complaint is a substantial complaint. With respect to such complaints, each party shall submit a written summary of its position to the Commission no later than ten (10) days after receipt of the staff notification. The complaint will be presented to the Commission for a decision as soon as practicable.

#### **I. Permittee Contacts for Complaints and Complaint Reporting**

Complaints may be filed by mail or email to:

ITC Midwest LLC  
Jeanne Archie  
Senior Real Estate Specialist  
123 5th Street, S.E.  
Cedar Rapids, IA 52401  
Phone: 319-297-6764  
[jarchie@itctransco.com](mailto:jarchie@itctransco.com)

This information shall be maintained current by informing the Commission of any changes by eFiling, as they become effective.

**MINNESOTA PUBLIC UTILITIES COMMISSION  
COMPLIANCE FILING PROCEDURE FOR  
PERMITTED ENERGY FACILITIES**

**A. Purpose**

To establish a uniform and timely method of submitting information required by the Commission energy facility permits.

**B. Scope and Applicability**

This procedure encompasses all compliance filings required by permit.

**C. Definitions**

**Compliance Filing:** A filing of information to the Commission, where the information is required by a Commission site or route permit.

**D. Responsibilities**

1. The permittee shall eFile all compliance filings with Dr. Burl W. Haar, Executive Secretary, Public Utilities Commission, through the eDockets system. The eDockets system is located at: <https://www.edockets.state.mn.us/EFiling/home.jsp>

General instructions are provided on the eDockets website. Permittees must register on the website to eFile documents.

2. All filings must have a cover sheet that includes:
  - a. Date
  - b. Name of submitter/permittee
  - c. Type of permit (site or route)
  - d. Project location
  - e. Project docket number
  - f. Permit section under which the filing is made
  - g. Short description of the filing

3. Filings that are graphic intensive (e.g., maps, engineered drawings) must, in addition to being eFiled, be submitted as paper copies and on CD. Paper copies and CDs should be sent to: 1) Dr. Burl W. Haar, Executive Secretary, Minnesota Public Utilities Commission, 121 7th Place East, Suite 350, St. Paul, MN 55101-2147, and 2) Department of Commerce, Energy Environmental Review and Analysis, 85 7th Place East, Suite 500, St. Paul, MN 55101-2198.

The Commission may request a paper copy of any eFiled document.

EXAMPLE

## PERMIT COMPLIANCE FILINGS<sup>1</sup>

PERMITTEE: **ITC Midwest LLC**

PERMIT TYPE: **High-Voltage Transmission Line Route Permit**

PROJECT LOCATION: **Jackson, Martin, and Faribault Counties**

PUC DOCKET NUMBER: **ET-6675/TL-12-1337**

Filing Number	Permit Section	Description of Compliance Filing	Due Date
	5.1	Notification of Landowners	First contact after issuance of route permit.
	5.2.1	Field Representative	14 days prior to commencing construction.
	5.2.11	Restoration	60 days after completion of all construction activities.
	5.2.13	State Historic Preservation Office Consultation	After completion of consultation.
	5.4.2	Other Permits and Regulations	Upon request of the Commission.
	6.1	Construction Environmental Control Plan (CECP)	30 days prior to submitting the plan and profile for any segment of the Project.
	6.2	Agricultural Impact Mitigation Plan distribution	First contact after issuance of route permit in accordance with Section 4.1.
	6.3	Vegetation Management Plan	Submitted with CECP in accordance with Section 5.1.
	6.4	Avian Mitigation Plan	Submitted with CECP in accordance with Section 5.1.

<sup>1</sup> This compilation of permit compliance filings is provided for the convenience of the permittee and the Commission. It is not a substitute for the permit; the language of the permit controls.

Filing Number	Permit Section	Description of Compliance Filing	Due Date
	6.5	Des Moines River Crossing	Upon completion of consultation with DNR and as part of the plan and profile in accordance with Section 8.1.
	8.0	Complaint Procedures	Prior to the start of construction.
	9.1	Plan and Profile	30 days before right-of-way preparation.
	9.2	Periodic Status Reports	Monthly
	9.3	Completion of Construction and In-Service Date	Three days prior to in-service date.
	9.4	As-Builts	60 days after completion of construction.
	9.5	GPS Data	60 days after completion of construction.