



minnesota power / 30 west superior street / duluth, minnesota 55802-2093 / 218-722-5642 / www.mnpower.com

April 24, 2008

VIA E-FILING

Dr. Burl W. Haar
Executive Secretary
Minnesota Public Utilities Commission
121 7th Place East, Suite 350
St. Paul, MN 55101

RE: 138 kV Substation and Transmission Line Local Review
Amendment to Notice of Local Review Dated April 17, 2008
MPUC Docket Number E015/LR-08-442

Dear Dr. Haar:

This amendment is to correct erroneous information in the above referenced document. Specifically, the township and range numbers (used twice in the second paragraph) are incorrect. The notice indicates the proposed facilities would be sited in T. 58 N., R. 13 W. The correct Township and Range is as follows: T. 59 N., R. 14 W. Other geographic descriptors in the original notice, including section numbers, are correct. Please see the enclosed map for further clarification.

I apologize for any confusion or inconvenience this error may have caused. Please call me at (218) 343-9119 if you have any questions regarding this amendment.


Sincerely,

James B. Atkinson
Senior Environmental Compliance Specialist

JBA:sr

Enc.

cc: Rick Bradford, City of Hoyt Lakes

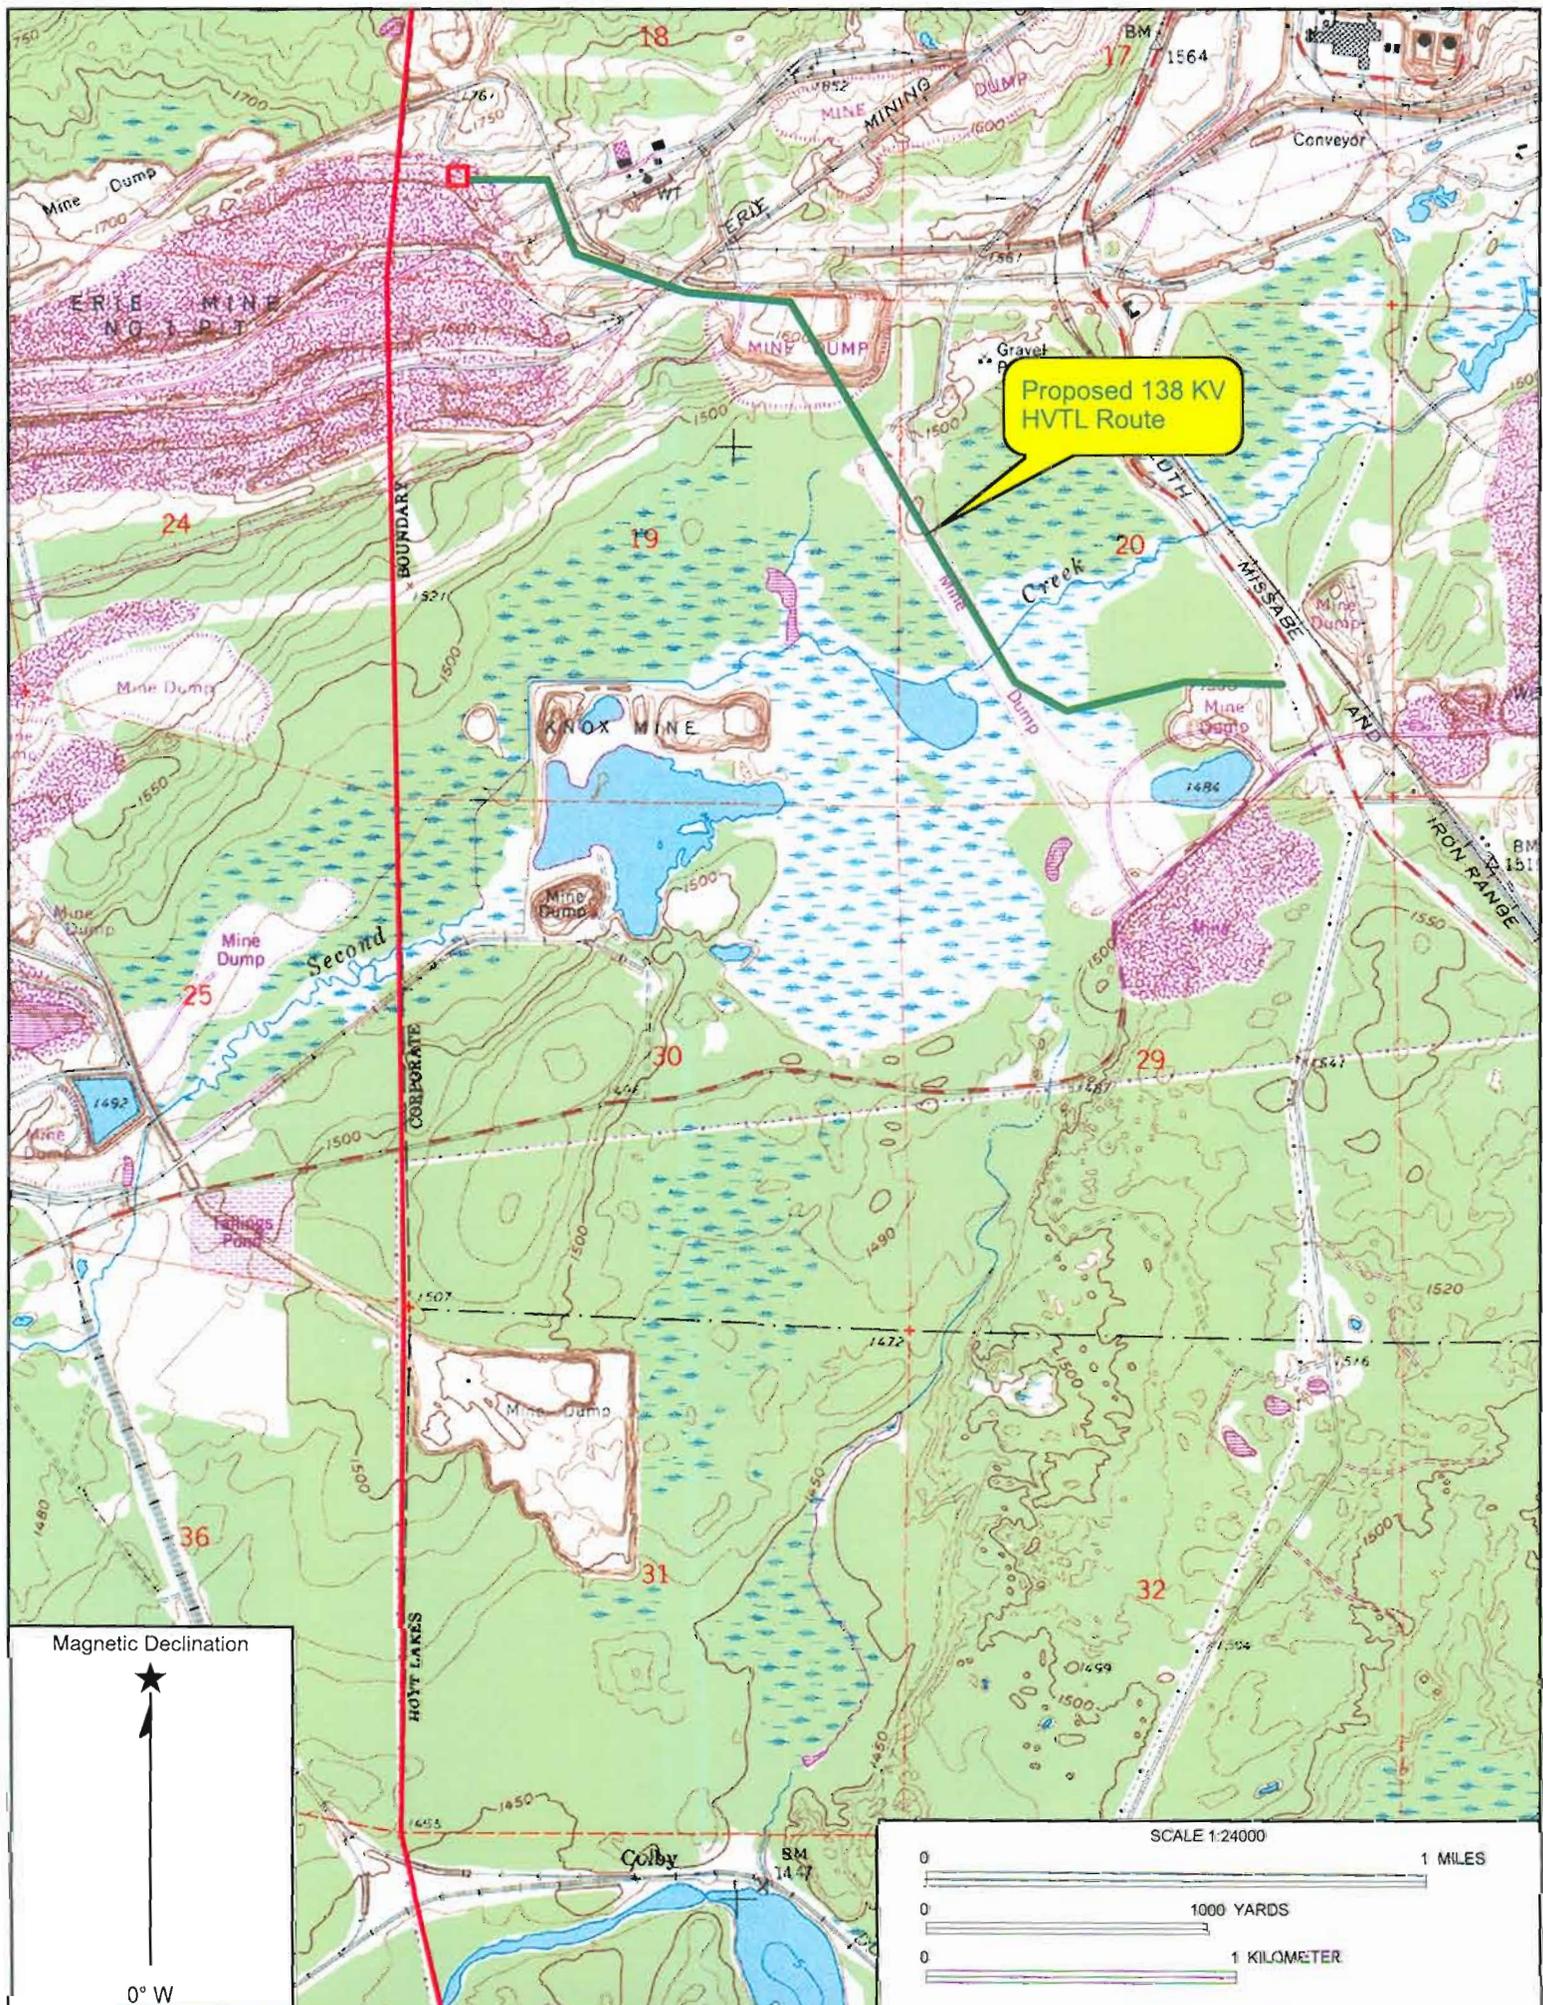

Proposed 138 KV HVTL Route

Magnetic Declination



0° W

SCALE 1:24000

